

Results


Uji Normalitas – ISO 9241–11 – N=30

Descriptive Statistics


	ToT_Diff	Satisfaction_Diff
Valid	30	30
Missing	0	0
Mean (arithmetic)	−5.970	1.700
Std. Deviation	43.54	1.601
Shapiro– Wilk	0.910	0.822
P-value of Shapiro– Wilk	.015	< .001
Minimum	−146.5	−1.000
Maximum	63.00	6.000

Distribution Plots

ToT_Diff

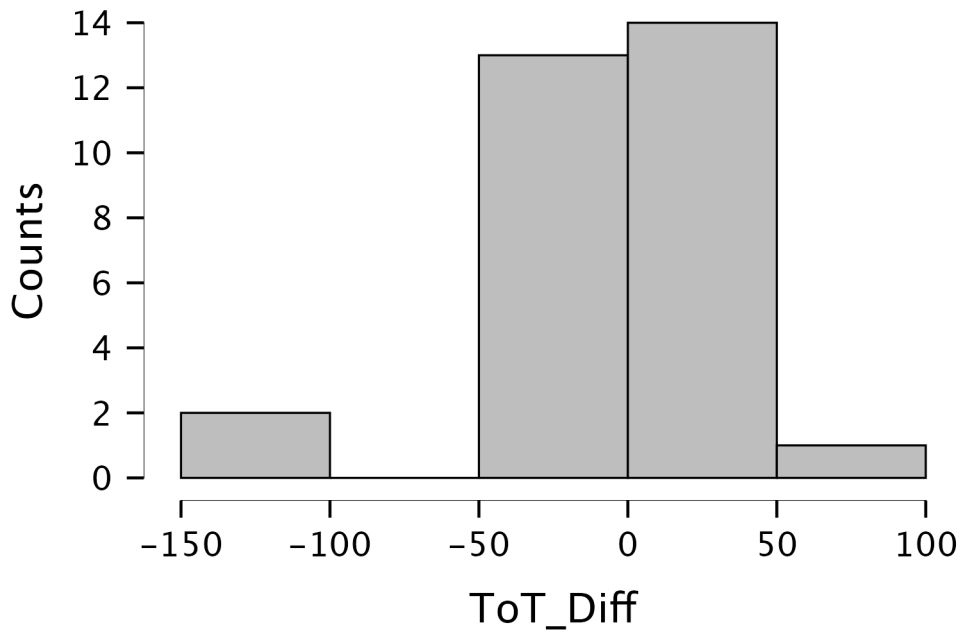


Satisfaction_Diff

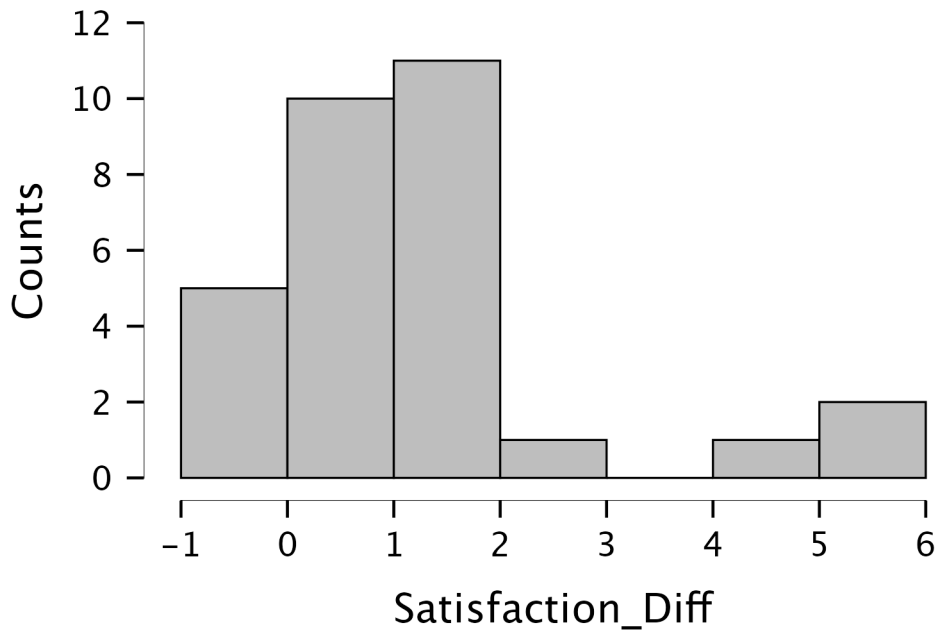

Q-Q Plots

ToT_Diff

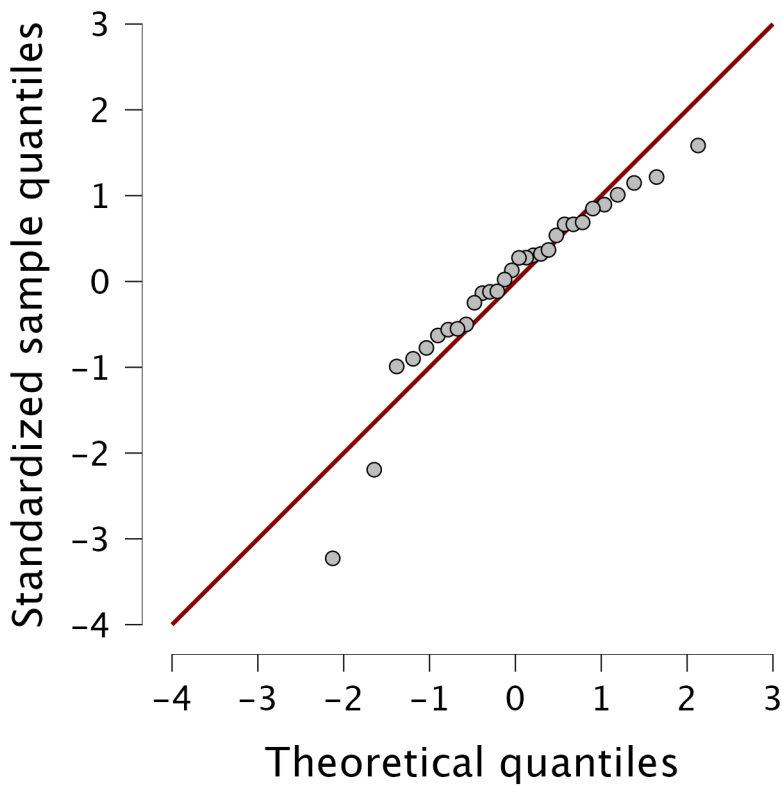

Satisfaction_Diff

