

Mycodo Manual

Contents

About Mycodo	3
Brief Overview	3
Frequently Asked Questions	4
Upgrading	6
Backup-Restore	6
Web Interface	6
REST API	6
Data Viewing	7
Live Measurements	7
Asynchronous Graphs	7
Dashboard	7
Graph Widget	7
Gauge Widget	8
Camera Widget	8
Indicator Widget	8
Measurement Widget	9
Output Widget	9
PID Control Widget	9
Data Acquisition	9
Input	9
Input Actions	10
Input Options	10
Custom Inputs	12
The Things Network	12
Math	13
Math Options	13
Output	14
Custom Outputs	15
Output Options	15
On/Off (GPIO)	16
Pulse-Width Modulation (PWM)	16
Pulse-Width Modulation (PWM) Options	16
Non-hardware PWM Pins	17
Hardware PWM Pins	17
Schematics for DC Fan Control	17
Schematics for AC Modulation	18
Peristaltic Pump	21
Generic Peristaltic Pump	21
Atlas Scientific Peristaltic Pump	22
Peristaltic Pump Options	22

Wireless 315/433 MHz	22
Linux Command	22
Python Command	22
Output Notes	22
Functions	23
Custom Controllers	23
PID Controller	23
PID Controller Options	23
PID Output Calculation	24
PID Tuning	24
PID Autotune	27
Conditional	29
Conditional Options	29
Conditional Setup Guide	30
Trigger	34
Output (On/Off) Options	34
Output (PWM) Options	34
Edge Options	34
Run PWM Method Options	35
Infrared Remote Input Options	35
Sunrise/Sunset Options	35
Timer (Duration) Options	35
Timer (Daily Time Point) Options	35
Timer (Daily Time Span) Options	36
Function Actions	36
Methods	36
Method Options	37
Time/Date Method	37
Duration Method	37
Daily (Time-Based) Method	37
Daily (Sine Wave) Method	37
Daily (Bezier Curve) Method	37
LCDs	38
Alerts	38
Notes	38
Tag Options	38
Note Options	38
Export-Import	39
Dependencies	39
Camera	39
Energy Usage	39
System Information	40
Mycodo Client	41
Infrared Remote	42
Translations	45
Configuration Settings	45
General Settings	45
Energy Usage Settings	46

Input Settings	46
Output Settings	46
Measurement Settings	46
Users	47
User Roles	47
Pi Settings	48
Alert Settings	48
Camera Settings	48
Diagnostic Settings	49
Troubleshooting	49
Daemon Not Running	49
Incorrect Database Version	49
More	50
Devices	50
Input Devices	50
Built-In Inputs (System-Specific)	50
Built-In Inputs (Sensors)	51
I2C Multiplexers	58
Analog-to-Digital Converters	59
I2C Information	59
1-Wire Information	59
UART Information	59
Output Devices	59
Built-In Outputs	59
Device Notes	60
Edge Detection	60
LCD Displays	60
Raspberry Pi	61
AM2315	61
K-30	61
USB Device Persistence Across Reboots	61
Diagrams	63
DHT11 Diagrams	63
DS18B20 Diagrams	64
Raspberry Pi and Relay Diagrams	65

About Mycodo

Mycodo is an automated monitoring and regulation system that was built to run on the Raspberry Pi.

Originally developed for cultivating edible mushrooms, Mycodo has grown to do much more. The system comprises a backend (daemon) and a frontend (web server). The backend acquires measurements from sensors and devices, and coordinates a diverse set of responses to those measurements, including the ability to modulate outputs (relays, PWM, pumps, wireless outlets, etc.), regulate environmental conditions with electrical devices under PID control (steady regulation or changing over time), schedule timers, capture photos and stream video, trigger actions when measurements meet certain conditions (modulate relays, execute commands, notify by email, etc.), and more. The frontend is a web interface that enables easy navigation and configuration from any browser-enabled device.

Brief Overview

There are a number of different uses for Mycodo. Some users simply store sensor measurements to monitor conditions remotely, others regulate the environmental conditions of a physical space, while others capture motion-activated or timelapse photography, among other uses.

Input controllers acquire measurements and store them in the InfluxDB time series database. Measurements typically come from sensors, but may also be configured to use the return value of linux or Python commands, or math equations, making a very powerful system for acquiring and generating data.

Output controllers produce changes to the general input/output (GPIO) pins or may be configured to execute linux or Python commands, enabling a large number of potential uses. There are a few different types of outputs: simple switching of GPIO pins (HIGH/LOW), generating pulse-width modulated (PWM) signals, switching 315/433 MHz wireless outlets, controlling Atlas Scientific peristaltic pumps, as well as executing linux and Python commands. The most common output is using a relay to switch electrical devices on and off.

When Inputs and Outputs are combined, PID controllers may be used to create a feedback loop that uses the Output device to modulate an environmental condition the Input measures. Certain Inputs may be coupled with certain Outputs to create a variety of different control and regulation applications. Beyond simple regulation, Methods may be used to create a changing setpoint over time, enabling such things as thermal cyclers, reflow ovens, environmental simulation for terrariums, food and beverage fermentation or curing, and cooking food (sous-vide), to name a few.

Triggers can be set to activate events based on specific dates and times, according to durations of time, or the sunrise/sunset at a specific latitude and longitude. Conditionals are used to activate certain events based on the truth of custom user conditional statements (e.g. "Sensor1 > 23 and 10 < Sensor2 < 30").

Frequently Asked Questions

Here are a few frequently asked questions about Mycodo. There is also an Question & Answer Forum that you can pose a question. However, do ensure it's relevant to the topic by reading the stickied Q&A Post to determine if it may be better suited for the General Discussion Forum.

What should I do if I have an issue?

First, read through this manual to make sure you understand how the system works and you're using the system properly. Also check out the Mycodo Wiki. You may even want to look through recent GitHub Issues. If you haven't resolved your issue by this point, make a New GitHub Issue describing the issue and attaching a sufficient amount of evidence (screenshots, log files, etc.) to aid in diagnosing the issue.

How do I add an Input (like a sensor) or an Output (like a water pump), or custom functions (to do my bidding) to the system if they're not currently supported?

Yes, Mycodo supports adding custom Inputs, Outputs, and Controllers. See the Custom Inputs, Custom Outputs, and Custom Controllers sections for more information.

Another way to add an Input is to create a bash or Python script that obtains and returns a numerical value when executed from the linux command line on the Raspberry Pi. This script may be configured to be executed by a "Linux Command" Input. The Input will periodically execute the command and store the returned measurement value to the database for use with the rest of the Mycodo system.

How do I set up simple environmental monitoring and regulation?

Here is how I generally set up Mycodo to monitor and regulate:

1. Determine what environmental condition you want to measure or regulate. Consider the devices that must be coupled to achieve this. For instance, temperature regulation would require a temperature sensor input and an electric heater (or cooler) output.
2. Determine what relays you will need to control power to your electric devices. The Raspberry Pi is capable of directly switching relays (using a controllable 3.3-volt signal from the Pi's GPIO pins). Remember to select a relay that can handle the electrical current load from your switched device and won't exceed the maximum current draw from the Raspberry Pi GPIO pin the relay is connected to.
3. See the Input Devices section for information about supported inputs. Acquire sensor(s) and relay(s) and connect them to the Raspberry Pi according to the manufacturer's instructions. For instance, a sensor that communicates via the I2C bus will connect the SDA, SCL, Power, and Ground pins of the sensor to the SDA, SCL, 3.3 volt, and Ground pins of the Raspberry Pi. Make sure to enable the I2C interface under **Configure -> Raspberry Pi**. Additionally, the simplest

way to connect a relay is to connect the controlling side of the relay to a GPIO pin and Ground of the Raspberry Pi (remember to select a relay that will not exceed the current limitation of the GPIO pin). Some relays require the proper polarity for the controlling voltage, so refer to the manufacturer's datasheet to determine if this is the case.

4. On the **Setup** -> **Data** page, add a new input using the drop-down menu. Configure the input with the correct communication pins and other options. Activate the input to begin recording measurements to the Mycodo measurement database.
5. Go to the **Data** -> **Live** page to ensure there are measurements being acquired from the input.
6. On the **Setup** -> **Output** page, add an On/Off GPIO Output and configure the GPIO pin that's connected to the relay, whether the relay switches On when the signal is HIGH or LOW, and what state (On or Off) to set the relay when Mycodo starts. There are a number of other Outputs to choose from, but this is the most basic to start with, that will simply switch the GPIO pin HIGH (3.3 volts) or LOW (0 volts) to switch the relay that's connected to the pin.
7. Connect your device to the relay. This can be done a number of ways, and will depend on a number of factors, including whether you're using DC or AC voltage, whether there are screw terminals or a connector/socket, etc. In the simplest scenario, AC mains voltage can be applied by cutting the live wire and connecting each of the newly-cut ends to each of the terminals on the switching side of the relay. This enables the relay to short/connect or break/disconnect the connection, which will power and depower your device.
8. Test the Output by switching it On and Off (or generating a PWM signal if it's a PWM Output) from the **Setup** -> **Output** page and make sure the device connected to the relay turns On when you select "On", and Off when you select "Off".
9. On the **Setup** -> **Function** page, create a PID controller with the appropriate input measurement, output, and other parameters. Activate the PID controller.
10. On the **Data** -> **Dashboard** page, create a graph that includes the input measurement, the output, and the PID output and setpoint. This provides a good visualization for tuning the PID. See Quick Setup Examples for a greater detail of this process and tuning tips.

Can I communicate with Mycodo from the command line?

Yes, ~/Mycodo/mycodo/mycodo_client.py has this functionality, but there's a lot to be desired. See Mycodo Client, but note it may not be the most current list of commands, so it's recommended to execute `mycodo-client --help` to see a full list of current options.

Can I variably-control the speed of motors or other devices with the PWM output signal from the PID?

Yes, as long as you have the proper hardware to do that. The PWM signal being produced by the PID should be handled appropriately, whether by a fast-switching solid state relay, AC modulation circuitry, DC modulation circuitry, or something else.

I have a PID controller that uses one temperature sensor. If this sensor stops working, my PID controller stops operating. Is there a way to prevent this by setting up a second sensor to be used as a backup in case the first one fails?

Yes, you can use as many sensors as you would like to create a redundant system so your PID or other functions don't stop working if one or more sensors fail. To do this, follow the below instructions:

1. Add and activate all your sensors. For this example, we will use three temperature sensors, Sensor1, Sensor2, and Sensor3, that return measurements in degrees Celsius.
2. Go to the **Setup** -> **Data** page and add the Redundancy Math controller.
3. In the options of the Redundancy controller, set the Period, Start Offset, and Max Age, then select Sensors 1, 2, and 3 for the Input option, then Save.
4. In the options of the Redundancy controller, change the order you wish to use the sensors under Order of Use. For this example, we will use the default order (Sensor1, Sensor2, Sensor3).
5. In the options of the Redundancy controller, under Measurement Settings, select Celsius for the Measurement Unit and click the Save under Measurement Settings (a different Save button from the general options).
6. Activate the Redundancy Math controller.
7. Go to the **Data** -> **Live** page and verify the Redundancy Math controller is working correctly by returning a value from the input you selected to be first. If the first sensor is working correctly, its value should be displayed. You can deactivate the first sensor (mimicking the first sensor stopped working) and see if the second sensor's value is then returned.
8. Go to the **Setup** -> **Function** page and select the new Redundancy Math controller for the PID Measurement option.

The PID controller will now use the measurement returned from the Redundancy Math controller, which in turn will acquire its measurement in the following way:

If a measurement can be found within the Max Age for Sensor1, the measurement for Sensor1 will be returned. If a measurement from Sensor1 could not be acquired, and if a measurement can be found within the Max Age for Sensor2, the measurement for Sensor2 will be returned. If a measurement from Sensor1 or Sensor2 could not be acquired, and if a measurement can be found within the Max Age for Sensor3, the measurement for Sensor3 will be returned. If a measurement from Sensor1, Sensor2, or Sensor3 could not be acquired, then the Redundancy Math controller will not return a measurement at all (indicating all three sensors are not working). It is advised to set up a Conditional Controller to send a notification email to yourself if one or more measurements are unable to be acquired so you can investigate the issue.

Upgrading

[Gear Icon] -> Upgrade

If you already have Mycodo installed, you can perform an upgrade to the latest Mycodo Release by either using the Upgrade option in the web interface (recommended) or by issuing the following command in a terminal. A log of the upgrade process is created at `/var/log/mycodo/mycodoupgrade.log` and is also available from the [Configure -> Mycodo Logs](#) page.

```
sudo mycodo-commands upgrade-mycodo
```

Backup-Restore

[Gear Icon] -> Backup Restore

A backup is made to `/var/Mycodo-backups` when the system is upgraded or instructed to do so from the web interface on the [\[Gear Icon\] -> Backup Restore](#) page.

If you need to restore a backup, this can be done on the [\[Gear Icon\] -> Backup Restore](#) page (recommended). Find the backup you would like restored and press the Restore button beside it. If you're unable to access the web interface, a restore can also be initialized through the command line. Use the following command to initialize a restore. The `[backup_location]` must be the full path to the backup to be restored (e.g. `"/var/Mycodo-backups/Mycodo-backup-2018-03-11_21-19-15-5.6.4/"` without quotes).

```
sudo mycodo-commands backup-restore [backup_location]
```

Web Interface

The main frontend of Mycodo is a web interface that allows any device with a web browser to view collected data and configure the backend, or the daemon, of the system. The web interface supports an authentication system with user/password credentials, user roles that grant/deny access to parts of the system, and SSL for encrypted browsing.

An SSL certificate with an expiration of 10 years will be generated and stored in `~/Mycodo/mycodo/mycodo_flask/ssl_certs/` during the install process to allow SSL to be used to securely connect to the web interface. If you want to use your own SSL certificates, replace them with your own.

If using the auto-generated certificate from the install, be aware that it will not be verified when visiting the web interface in your browser. You may continually receive a warning message about the security of your site unless you add the certificate to your browser's trusted list.

REST API

As of version 8, Mycodo has a REST API. Documentation is available at [API Information](#) and [API Endpoint Documentation](#).

Data Viewing

There are several ways to visualize collected data. Additionally, the dashboard can be used for both viewing data and manipulating the system, thanks to the numerous dashboard widgets available.

Live Measurements

Data -> Live

The Live page is the first page a user sees after logging in to Mycodo. It will display the current measurements being acquired from Input and Math controllers. If there is nothing displayed on the Live page, ensure an Input or Math controller is both configured correctly and activated. Data will be automatically updated on the page from the measurement database.

Asynchronous Graphs

Data -> Asynchronous Graphs

A graphical data display that is useful for viewing data sets spanning relatively long periods of time (weeks/months/years), which could be very data- and processor-intensive to view as a Live Graph. Select a time frame and data will be loaded from that time span, if it exists. The first view will be of the entire selected data set. For every view/zoom, 700 data points will be loaded. If there are more than 700 data points recorded for the time span selected, 700 points will be created from an averaging of the points in that time span. This enables much less data to be used to navigate a large data set. For instance, 4 months of data may be 10 megabytes if all of it were downloaded. However, when viewing a 4 month span, it's not possible to see every data point of that 10 megabytes, and aggregating of points is inevitable. With asynchronous loading of data, you only download what you see. So, instead of downloading 10 megabytes every graph load, only ~50kb will be downloaded until a new zoom level is selected, at which time only another ~50kb is downloaded.

Note: Live Graphs require measurements to be acquired, therefore at least one sensor needs to be added and activated in order to display live data.

Dashboard

Data -> Dashboard

Dashboards are where you can add widgets to display data and interact with the system. Multiple dashboards can be created. Widgets can be moved and arranged on the dashboards by dragging the top header and can be resized by dragging the bottom-left or bottom-right side of the widget. Specific options for widgets are below.

Graph Widget

A graphical data display that is useful for viewing data sets spanning relatively short periods of time (hours/days/weeks). Select a time frame to view data and continually updating data from new sensor measurements. Multiple graphs can be created on one page that enables a dashboard to be created of graphed sensor data. Each graph may have one or more data from inputs, outputs, or PIDs rendered onto it. To edit graph options, select the plus sign on the top-right of a graph.

Setting	Description
x-Axis (minutes)	The duration to display on the x-axis of the graph.
Enable Auto Refresh	Automatically refresh the data on the graph Refresh Period.
Refresh (seconds)	The duration between acquisitions of new data to display on the graph.
Inputs/Outputs/PIDs	The Inputs, Outputs, and PIDs to display on the graph.
Enable X-Axis Reset	Reset the x-axis min/max every time new data comes in during the auto refresh.
Enable Title	Show a title of the graph name.
Enable Navbar	Show a slidable navigation bar at the bottom of the graph.
Enable Export	Enable a button on the top right of the graph to allow exporting of the currently-displayed data as PNG, JPEG, PDF, SVG, CSV, XLS.

Setting	Description
Enable Range Selector	Show a set of navigation buttons at the top of the graph to quickly change the display duration.
Enable Graph Shift	If enabled, old data points are removed when new data is added to the graph. Only recommended to enable if Enable Navbar is enabled.
Enable Custom Colors	Use custom colors for Input, Output, and PID lines. Select the colors with the buttons that appear below this checkbox.
Enable Manual Y-Axis Min/Max	Set the minimum and maximum y-axes of a particular graph. Set both the minimum and maximum to 0 to disable for a particular y-axis.
Enable Y-Axis Align Ticks	Align the ticks of several y-axes of the same graph.
Enable Y-Axis Start On Tick	Start all y-axes of a graph on the same tick.
Enable Y-Axis End On Tick	End all y-axes of a graph on the same tick.

Gauge Widget

Gauges are visual objects that allow one to quickly see what the latest measurement is of an input. An example that you may be familiar with is a speedometer in a car.

Setting	Description
Refresh (seconds)	The duration between acquisitions of new data to display on the graph.
Max Age (seconds)	The maximum allowable age of the measurement. If the age is greater than this, the gauge will turn off, indicating there is an issue.
Gauge Min	The lowest value of the gauge.
Gauge Max	The highest value of the gauge.
Stops	The number of color ranges on the gauge.
Show Timestamp	Show the timestamp of the current gauge measurement.

Camera Widget

Cameras may be added to keep a continuous view on areas.

Setting	Description
Refresh (seconds)	The duration between acquisitions of new data to display on the graph.
Max Age (seconds)	The maximum allowed age of the image timestamp before a “No Recent Image” message is returned.
Acquire Image (and save new file)	Acquire a new images and save the previous image.
Acquire Image (and erase last file)	Acquire a new image but erase the previous image.
Display Live Video Stream	Automatically start a video stream and display it.
Display Latest Timelapse Image	Display the latest timelapse image that exists.
Add Timestamp	Append a timestamp to the image.

Indicator Widget

Shows a green or red button depending if the measurement value is 0 or not 0.

Setting	Description
Refresh (seconds)	The duration between acquisitions of new data to display on the graph.
Max Age (seconds)	The maximum allowable age of the measurement. If the age is greater than this, the gauge will turn off, indicating there is an issue.
Timestamp Font Size (em)	The font size of the timestamp value in em.
Invert	Invert/reverse the colors.

Setting	Description
Measurement	The device to display information about.

Measurement Widget

Setting	Description
Refresh (seconds)	The duration between acquisitions of new data to display on the graph.
Max Age (seconds)	The maximum allowable age of the measurement. If the age is greater than this, the gauge will turn off, indicating there is an issue.
Value Font Size (em)	The font size of the measurement value in em.
Timestamp Font Size (em)	The font size of the timestamp value in em.
Decimal Places	The number of digits to display to the right of the decimal.
Measurement	The device to display information about.

Output Widget

Setting	Description
Refresh (seconds)	The duration between acquisitions of new data to display on the graph.
Max Age (seconds)	The maximum allowable age of the measurement. If the age is greater than this, the gauge will turn off, indicating there is an issue.
Value Font Size (em)	The font size of the output value in em.
Timestamp Font Size (em)	The font size of the timestamp value in em.
Decimal Places	The number of digits to display to the right of the decimal.
Feature Output Controls	Display buttons to turn On and Off the relay from the dashboard element.
Output	The output to display information about.

PID Control Widget

Setting	Description
Refresh (seconds)	The duration between acquisitions of new data to display on the graph.
Max Age (seconds)	The maximum allowable age of the measurement. If the age is greater than this, the gauge will turn off, indicating there is an issue.
Value Font Size (em)	The font size of the measurement value in em.
Timestamp Font Size (em)	The font size of the timestamp value in em.
Decimal Places	The number of digits to display to the right of the decimal.
Show PID Information	Show extra PID information on the dashboard element.
Show Set Setpoint	Allow setting the PID setpoint on the dashboard element.
PID	The PID to display information about.

Data Acquisition

Input

Inputs, such as sensors, ADC signals, or even a response from a command, enable measuring conditions in the environment or elsewhere, which will be stored in a time-series database (InfluxDB). This database will provide measurements for Graphs, LCDs, PID Controllers, Conditional Statements, and other parts of Mycodo to operate from. Add, configure, and activate inputs to begin recording measurements to the database and allow them to be used throughout Mycodo.

Input Actions

Input Actions are functions within the Input module that can be executed from the Web UI. This is useful for things such as calibration or other functionality specific to the input. By default there is at least one action, Acquire Measurements Now, which will cause the input to acquire measurements rather than waiting until the next Period has elapsed. Note, actions can only be executed while the Input is active.

Input Options

In addition to several supported sensors and devices, a Linux command may be specified that will be executed and the return value stored in the measurement database to be used throughout the Mycodo system.

Setting	Description
Activate	After the sensor has been properly configured, activation begins acquiring measurements from the sensor. Any activated conditional statements will now be operating.
Deactivate	Deactivation stops measurements from being acquired from the sensor. All associated conditional statements will cease to operate.
Save	Save the current configuration entered into the input boxes for a particular sensor.
Delete	Delete a particular sensor.
Acquire Measurements Now	Force the input to conduct measurements and them in the database.
Up/Down	Move a particular sensor up or down in the order displayed.
Power Output	Select a output that powers the sensor. This enables powering cycling (turn off then on) when the sensor returns 3 consecutive errors to attempt to fix the issue. Transistors may also be used instead of a relay (note: NPN transistors are preferred over PNP for powering sensors).
Location	Depending on what sensor is being used, you will need to either select a serial number (DS18B20 temperature sensor), a GPIO pin (in the case of sensors read by a GPIO), or an I2C address. or other.
I2C Bus	The bus to be used to communicate with the I2C address.
Period (seconds)	After the sensor is successfully read and a database entry is made, this is the duration of time waited until the sensor is measured again.
Measurement Unit	Select the unit to save the measurement as (only available for select measurements).
Pre Output	If you require a output to be activated before a measurement is made (for instance, if you have a pump that extracts air to a chamber where the sensor resides), this is the output number that will be activated. The output will be activated for a duration defined by the Pre Duration, then once the output turns off, a measurement by the sensor is made.
Pre Output Duration (seconds)	This is the duration of time that the Pre Output runs for before the sensor measurement is obtained.
Pre Output During Measurement	If enabled, the Pre Output stays on during the acquisition of a measurement. If disabled, the Pre Output is turned off directly before acquiring a measurement.
Command	A linux command (executed as the user 'root') that the return value becomes the measurement
Command Measurement	The measured condition (e.g. temperature, humidity, etc.) from the linux command
Command Units	The units of the measurement condition from the linux command
Edge	Edge sensors only: Select whether the Rising or Falling (or both) edges of a changing voltage are detected. A number of devices to do this when in-line with a circuit supplying a 3.3-volt input signal to a GPIO, such as simple mechanical switch, a button, a magnet (reed/hall) sensor, a PIR motion detector, and more.

Setting	Description
Bounce Time (ms)	Edge sensors only: This is the number of milliseconds to bounce the input signal. This is commonly called debouncing a signal [1] and may be necessary if using a mechanical circuit.
Reset Period (seconds)	Edge sensors only: This is the period of time after an edge detection that another edge will not be recorded. This enables devices such as PIR motion sensors that may stay activated for longer periods of time.
Measurement	Analog-to-digital converter only: The type of measurement being acquired by the ADC. For instance, if the resistance of a photocell is being measured through a voltage divider, this measurement would be “light”.
Units	Analog-to-digital converter only: This is the unit of the measurement. With the above example of “light” as the measurement, the unit may be “lux” or “intensity”.
BT Adapter	The Bluetooth adapter to communicate with the input.
Clock Pin	The GPIO (using BCM numbering) connected to the Clock pin of the ADC
CS Pin	The GPIO (using BCM numbering) connected to the CS pin of the ADC
MISO Pin	The GPIO (using BCM numbering) connected to the MISO pin of the ADC
MOSI Pin	The GPIO (using BCM numbering) connected to the MOSI pin of the ADC
RTD Probe Type	Select to measure from a PT100 or PT1000 probe.
Resistor Reference (Ohm)	If your reference resistor is not the default (400 Ohm for PT100, 4000 Ohm for PT1000), you can manually set this value. Several manufacturers now use 430 Ohm resistors on their circuit boards, therefore it’s recommended to verify the accuracy of your measurements and adjust this value if necessary.
Channel	Analog-to-digital converter only: This is the channel to obtain the voltage measurement from the ADC.
Gain	Analog-to-digital converter only: set the gain when acquiring the measurement.
Sample Speed	Analog-to-digital converter only: set the sample speed (typically samples per second).
Volts Min	Analog-to-digital converter only: What is the minimum voltage to use when scaling to produce the unit value for the database. For instance, if your ADC is not expected to measure below 0.2 volts for your particular circuit, set this to “0.2”.
Volts Max	Analog-to-digital converter only: This is similar to the Min option above, however it is setting the ceiling to the voltage range. Units Min
Units Max	Analog-to-digital converter only: This value will be the lower value of a range that will use the Min and Max Voltages, above, to produce a unit output. For instance, if your voltage range is 0.0 -1.0 volts, and the unit range is 1 -60, and a voltage of 0.5 is measured, in addition to 0.5 being stored in the database, 30 will be stored as well. This enables creating calibrated scales to use with your particular circuit.
Weighting	Analog-to-digital converter only: This is similar to the Min option above, however it is setting the ceiling to the unit range.
Pulses Per Rev	The This is a number between 0 and 1 and indicates how much the old reading affects the new reading. It defaults to 0 which means the old reading has no effect. This may be used to smooth the data.
Port	The number of pulses for a complete revolution.
Times to Check	The server port to be queried (Server Port Open input).
Deadline (seconds)	The number of times to attempt to ping a server (Server Ping input).
Number of Measurement	The maximum amount of time to wait for each ping attempt, after which 0 (offline) will be returned (Server Ping input).
Application ID	The number of unique measurements to store data for this input.
	The Application ID on The Things Network.

Setting	Description
App API Key	The Application API Key on The Things Network.
Device ID	The Device ID of the Application on The Things Network.

1. Debouncing a signal

Custom Inputs

There is a Custom Input import system in Mycodo that allows user-created Inputs to be created and used in the Mycodo system. Custom Inputs can be uploaded and imported from the **Configure** -> **Inputs** page. After import, they will be available to use on the **Setup** -> **Data** page.

If you have a sensor that is not currently supported by Mycodo, you can build your own input module and import it into Mycodo. All information about an input is contained within the input module, set in the dictionaries 'INPUT_INFORMATION' and 'measurements_dict'. Each module will require at a minimum for these variables to be set in INPUT_INFORMATION: 'input_name_unique', 'input_manufacturer', 'input_name', 'measurements_name', and 'measurements_dict'. The measurements_dict dictionary contains the measurements that are acquired and stored, and require both the units and measurements to exist in the measurement/unit database (Add missing measurements/units on the **Configure** -> **Measurements** page).

Open any of the built-in modules located in the inputs directory (<https://github.com/kizniche/Mycodo/tree/master/mycodo/inputs/>) for examples of the proper formatting.

There's also a minimal input module template that generates random data as an example:

https://github.com/kizniche/Mycodo/tree/master/mycodo/inputs/examples/minimal_humidity_temperature.py

There's also an input module that includes all available INPUT_INFORMATION options along with descriptions:

https://github.com/kizniche/Mycodo/tree/master/mycodo/inputs/examples/example_all_options_temperature.py

Additionally, I have another github repository devoted to Custom Inputs and Controllers that are not included in the built-in set, at [kizniche/Mycodo-custom](https://github.com/kizniche/Mycodo-custom).

The Things Network

The Things Network (TTN) Input module enables downloading of data from TTN if the Data Storage Integration is enabled in your TTN Application. The Data Storage Integration will store data for up to 7 days. Mycodo will download this data periodically and store the measurements locally.

The payload on TTN must be properly decoded to variables that correspond to the "Name" option under "Select Measurements", in the lower section of the Input options. For instance, in your TTN Application, if a custom Payload Format is selected, the decoder code may look like this:

```
function Decoder(bytes, port) {
    var decoded = {};
    var rawTemp = bytes[0] + bytes[1] * 256;
    decoded.temperature = sflt162f(rawTemp) * 100;
    return decoded;
}

function sflt162f(rawSflt16) {
    rawSflt16 &= 0xFFFF;
    if (rawSflt16 === 0x8000)
        return -0.0;
    var sSign = ((rawSflt16 & 0x8000) !== 0) ? -1 : 1;
    var exp1 = (rawSflt16 >> 11) & 0xF;
    var mant1 = (rawSflt16 & 0x7FF) / 2048.0;
    return sSign * mant1 * Math.pow(2, exp1 - 15);
}
```

This will decode the 2-byte payload into a temperature float value with the name "temperature". Set "Number of Measurements" to "1", then set the "Name" for the first channel (CH0) to "temperature" and the "Measurement Unit" to "Temperature: Celsius (°C)".

Upon activation of the Input, data will be downloaded for the past 7 days. The latest data timestamp will be stored so any subsequent activation of the Input will only download new data (since the last known timestamp).

There are several example Input modules that, in addition to storing the measurements of a sensor in the influx database, will write the measurements to a serial device. This is useful if you have a LoRaWAN transmitter connected via serial to receive measurement information from Mycodo and transmit it to a LoRaWAN gateway (and subsequently to The Things Network). The data on TTN can then be downloaded elsewhere with the TTN Input. These example Input modules are located in the following locations:

~/Mycodo/mycodo/inputs/examples/bme280_ttn.py

~/Mycodo/mycodo/inputs/examples/k30_ttn.py

For example, the following excerpt from `bme_280.py` will write a set of comma-separated strings to the user-specified serial device with the first string (the letter “B”) used to denote the sensor/measurements, followed by the actual measurements (humidity, pressure, and temperature, in this case).

```
string_send = 'B,{},{},{}'.format(
    return_dict[1]['value'],
    return_dict[2]['value'],
    return_dict[0]['value'])
self.serial_send = self.serial.Serial(self.serial_device, 9600)
self.serial_send.write(string_send.encode())
```

This is useful if multiple data strings are to be sent to the same serial device (e.g. if both `bme280_ttn.py` and `k30_ttn.py` are being used at the same time), allowing the serial device to distinguish what data is being received.

The full code used to decode both `bme280_ttn.py` and `k30_ttn.py`, with informative comments, is located at `~/Mycodo/mycodo/inputs/examples/ttn_data_storage_decoder_example.js`.

These example Input modules may be modified to suit your needs and imported into Mycodo through the **Configure -> Inputs** page. After import, they will be available to use on the **Setup -> Data** page.

Math

Math controllers allow one or more Inputs to have math applied to produce a new value that may be used within Mycodo.

Note: “Last” means the controller will only acquire the last (latest) measurement in the database for performing math with. “Past” means the controller will acquire all measurements from the present until the “Max Age (seconds)” set by the user (e.g. if measurements are acquired every 10 seconds, and a Max Age is set to 60 seconds, there will on average be 6 measurements returned to have math performed).

Math Options

Types of math controllers.

Type	Description
Average (Last, Multiple Channels)	Stores the statistical mean of the last measurement of multiple selected measurement channels.
Average (Past, Single Channel)	Stores the statistical mean of one selected measurement channel over a duration of time determined by the Max Age (seconds) option.
Sum (Last, Multiple Channels)	Stores the sum of multiple selected measurement channels.
Sum (Past, Single Channel)	Stores the sum of one selected measurement channel over a duration of time determined by the Max Age(seconds) option.
Difference	Stores the mathematical difference (value_1 - value_2).
Equation	Stores the calculated value of an equation.
Redundancy	Select multiple Inputs and if one input isn't available, the next measurement will be used. For example, this is useful if an Input stops but you don't want a PID controller to stop working if there is another measurement that can be used. More than one Input can be and the preferred Order of Use can be defined.

Type	Description
Verification	Ensures the greatest difference between any selected Inputs is less than Max Difference, and if so, stores the average of the selected measurements.
Statistics	Calculates mean, median, minimum, maximum, standard deviation (SD), SD upper, and SD lower for a set of measurements.
Humidity (Wet/Dry-Bulb)	Calculates and stores the percent relative humidity from the dry-bulb and wet-bulb temperatures, and optional pressure.

Math controller options.

Setting	Description
Input	Select the Inputs to use with the particular Math controller
Period (seconds)	The duration of time between calculating and storing a new value
Max Age (seconds)	The maximum allowed age of the Input measurements. If an Input measurement is older than this period, the calculation is cancelled and the new value is not stored in the database. Consequently, if another controller has a Max Age set and cannot retrieve a current Math value, it will cease functioning. A PID controller, for instance, may stop regulating if there is no new Math value created, preventing the PID controller from continuing to run when it should not.
Start Offset (seconds)	Wait this duration before attempting the first calculation/measurement.
Measurement	This is the condition being measured. For instance, if all of the selected measurements are temperature, this should also be temperature. A list of the pre-defined measurements that may be used is below.
Units	This is the units to display along with the measurement, on Graphs. If a pre-defined measurement is used, this field will default to the units associated with that measurement.
Reverse Equation	For Difference calculations, this will reverse the equation order, from <code>value_1 - value_2</code> to <code>value_2 - value_1</code> .
Absolute Value	For Difference calculations, this will yield an absolute value (positive number).
Max Difference	If the difference between any selected Input is greater than this value, no new value will be stored in the database.
Dry-Bulb Temperature	The measurement that will serve as the dry-bulb temperature (this is the warmer of the two temperature measurements)
Wet-Bulb Temperature	The measurement that will serve as the wet-bulb temperature (this is the colder of the two temperature measurements)
Pressure	This is an optional pressure measurement that can be used to calculate the percent relative humidity. If disabled, a default 101325 Pa will be used in the calculation.
Equation	An equation that will be solved with Python's <code>eval()</code> function. Let "x" represent the input value. Valid equation symbols include: <code>+</code> <code>-</code> <code>*</code> <code>/</code> <code>^</code>
Order of Use	This is the order in which the selected Inputs will be used. This must be a comma separated list of Input IDs (integers, not UUIDs).

Output

Setup -> Output

Outputs are various signals that can be generated that operate devices. An output can be a HIGH/LOW signal on a GPIO pin, a pulse-width modulated (PWM) signal, a 315/433 MHz signal to switch a radio frequency-operated relay, driving of pumps and motors, or an execution of a linux or Python command, to name a few.

Custom Outputs

There is a Custom Output import system in Mycodo that allows user-created Outputs to be created and used in the Mycodo system. Custom Outputs can be uploaded and imported from the **Configure -> Outputs** page. After import, they will be available to use on the **Setup -> Output** page.

If you desire an Output that is not currently supported by Mycodo, you can build your own Output module and import it into Mycodo. All information about an Output is contained within the Output module. Open any of the built-in modules located in the outputs directory for examples of the proper formatting. There's also a minimal output module template as an example. For Outputs that require new measurements/units, they can be added on the **Configure -> Measurements** page.

Output Options

Setting	Description
Pin (GPIO)	This is the GPIO that will be the signal to the output, using BCM numbering.
WiringPi Pin	This is the GPIO that will be the signal to the output, using WiringPi numbering.
On State	This is the state of the GPIO to signal the output to turn the device on. HIGH will send a 3.3-volt signal and LOW will send a 0-volt signal. If you output completes the circuit (and the device powers on) when a 3.3-volt signal is sent, then set this to HIGH. If the device powers when a 0-volt signal is sent, set this to LOW.
Protocol	This is the protocol to use to transmit via 315/433 MHz. Default is 1, but if this doesn't work, increment the number.
UART Device	The UART device connected to the device.
Baud Rate	The baud rate of the UART device.
I2C Address	The I2C address of the device.
I2C Bus	The I2C bus the device is connected to.
Output Mode	The Output mode, if supported.
Flow Rate	The flow rate to dispense the volume (ml/min).
Pulse Length	This is the pulse length to transmit via 315/433 MHz. Default is 189 ms.
Bit Length	This is the bit length to transmit via 315/433 MHz. Default is 24-bit.
Execute as User	Select which user executes Linux Commands.
On Command	This is the command used to turn the output on. For wireless relays, this is the numerical command to be transmitted, and for command outputs this is the command to be executed. Commands may be for the linux terminal or Python 3 (depending on which output type selected).
Off Command	This is the command used to turn the output off. For wireless relays, this is the numerical command to be transmitted, and for command outputs this is the command to be executed. Commands may be for the linux terminal or Python 3 (depending on which output type selected).
Force Command	If an Output is already on, enabling this option will allow the On command to be executed rather than returning "Output is already On".
PWM Command	This is the command used to set the duty cycle. The string "((duty_cycle))" in the command will be replaced with the actual duty cycle before the command is executed. Ensure "((duty_cycle))" is included in your command for this feature to work correctly. Commands may be for the linux terminal or Python 3 (depending on which output type selected).
Current Draw (amps)	This is the amount of current the device powered by the output draws. Note: this value should be calculated based on the voltage set in the Energy Usage Settings.
Startup State	This specifies whether the output should be ON or OFF when mycodo initially starts. Some outputs have an additional options.

Setting	Description
Startup Value	If the Startup State is set to User Set Value (such as for PWM Outputs), then this value will be set when Mycodo starts up.
Shutdown State	This specifies whether the output should be ON or OFF when mycodo initially shuts down. Some outputs have an additional options.
Shutdown Value	If the Shutdown State is set to User Set Value (such as for PWM Outputs), then this value will be set when Mycodo shuts down.
Trigger at Startup	Select to enable triggering Functions (such as Output Triggers) when Mycodo starts and if Start State is set to ON.
Seconds to turn On	This is a way to turn a output on for a specific duration of time. This can be useful for testing the outputs and powered devices or the measured effects a device may have on an environmental condition.

On/Off (GPIO)

The On/Off (GPIO) output merely turns a GPIO pin High (3.3 volts) or Low (0 volts). This is useful for controlling things like electromechanical switches, such as relays, to turn electrical devices on and off.

Relays are electromechanical or solid-state devices that enable a small voltage signal (such as from a microprocessor) to activate a much larger voltage, without exposing the low-voltage system to the dangers of the higher voltage.

Add and configure outputs in the Output tab. Outputs must be properly set up before they can be used in the rest of the system.

To set up a wired relay, set the “GPIO Pin” (using BCM numbering) to the pin you would like to switch High (5 volts) and Low (0 volts), which can be used to activate relays and other devices. *On Trigger* should be set to the signal state (High or Low) that induces the device to turn on. For example, if your relay activates when the potential across the coil is 0-volts, set *On Trigger* to “Low”, otherwise if your relay activates when the potential across the coil is 5 volts, set it to “High”.

Pulse-Width Modulation (PWM)

Pulse-width modulation (PWM) is a modulation technique used to encode a message into a pulsing signal, at a specific frequency in Hertz (Hz). The average value of voltage (and current) fed to the load is controlled by turning the switch between supply and load on and off at a fast rate. The longer the switch is on compared to the off periods, the higher the total power supplied to the load.

The PWM switching frequency has to be much higher than what would affect the load (the device that uses the power), which is to say that the resultant waveform perceived by the load must be as smooth as possible. The rate (or frequency) at which the power supply must switch can vary greatly depending on load and application, for example

Switching has to be done several times a minute in an electric stove; 120 Hz in a lamp dimmer; between a few kilohertz (kHz) to tens of kHz for a motor drive; and well into the tens or hundreds of kHz in audio amplifiers and computer power supplies.

The term duty cycle describes the proportion of ‘on’ time to the regular interval or ‘period’ of time; a low duty cycle corresponds to low power, because the power is off for most of the time. Duty cycle is expressed in percent, with 0% being always off, 50% being off for half of the time and on for half of the time, and 100% being always on.

Pulse-Width Modulation (PWM) Options

Setting	Description
Library	Select the method for producing the PWM signal. Hardware pins can produce up to a 30 MHz PWM signal, while any other (non-hardware PWM) pin can produce up to a 40 kHz PWM signal. See the table, below, for the hardware pins on various Pi boards.
Pin (GPIO)	This is the GPIO pin that will output the PWM signal, using BCM numbering.
Frequency (Hertz)	This is frequency of the PWM signal.

Setting	Description
Invert Signal	Send an inverted duty cycle to the output controller.
Duty Cycle	This is the proportion of the time on to the time off, expressed in percent (0 -100).

Non-hardware PWM Pins

When using non-hardware PWM pins, there are only certain frequencies that can be used. These frequencies in Hertz are 40000, 20000, 10000, 8000, 5000, 4000, 2500, 2000, 1600, 1250, 1000, 800, 500, 400, 250, 200, 100, and 50 Hz. If you attempt to set a frequency that is not listed here, the nearest frequency from this list will be used.

Hardware PWM Pins


The exact frequency may be set when using hardware PWM pins. The same PWM channel is available on multiple GPIO. The latest frequency and duty cycle setting will be used by all GPIO pins which share a PWM channel.

BCM Pin	PWM Channel	Raspberry Pi Version
12	0	All models except A and B
13	1	All models except A and B
18	0	All models
19	1	All models except A and B
40	0	Compute module only
41	1	Compute module only
45	1	Compute module only
52	0	Compute module only
53	1	Compute module only

Schematics for DC Fan Control


Below are hardware schematics that enable controlling direct current (DC) fans from the PWM output from Mycodo.

PWM output controlling a 12-volt DC fan (such as a PC fan)

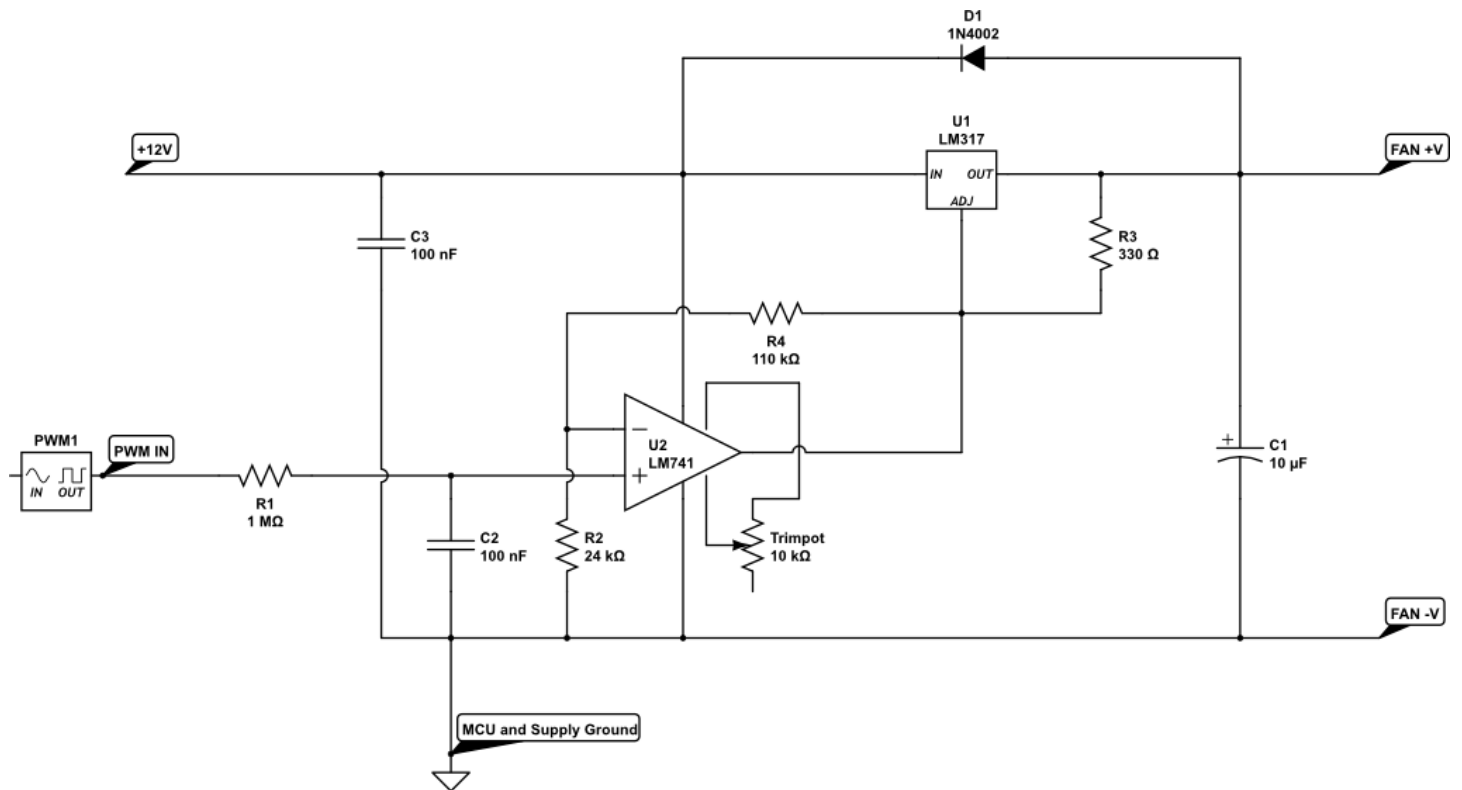


Schematics for AC Modulation


Below are hardware schematics that enable the modulation of alternating current (AC) from the PWM output from Mycodo. PWM output modulating alternating current (AC) at 1% duty cycle

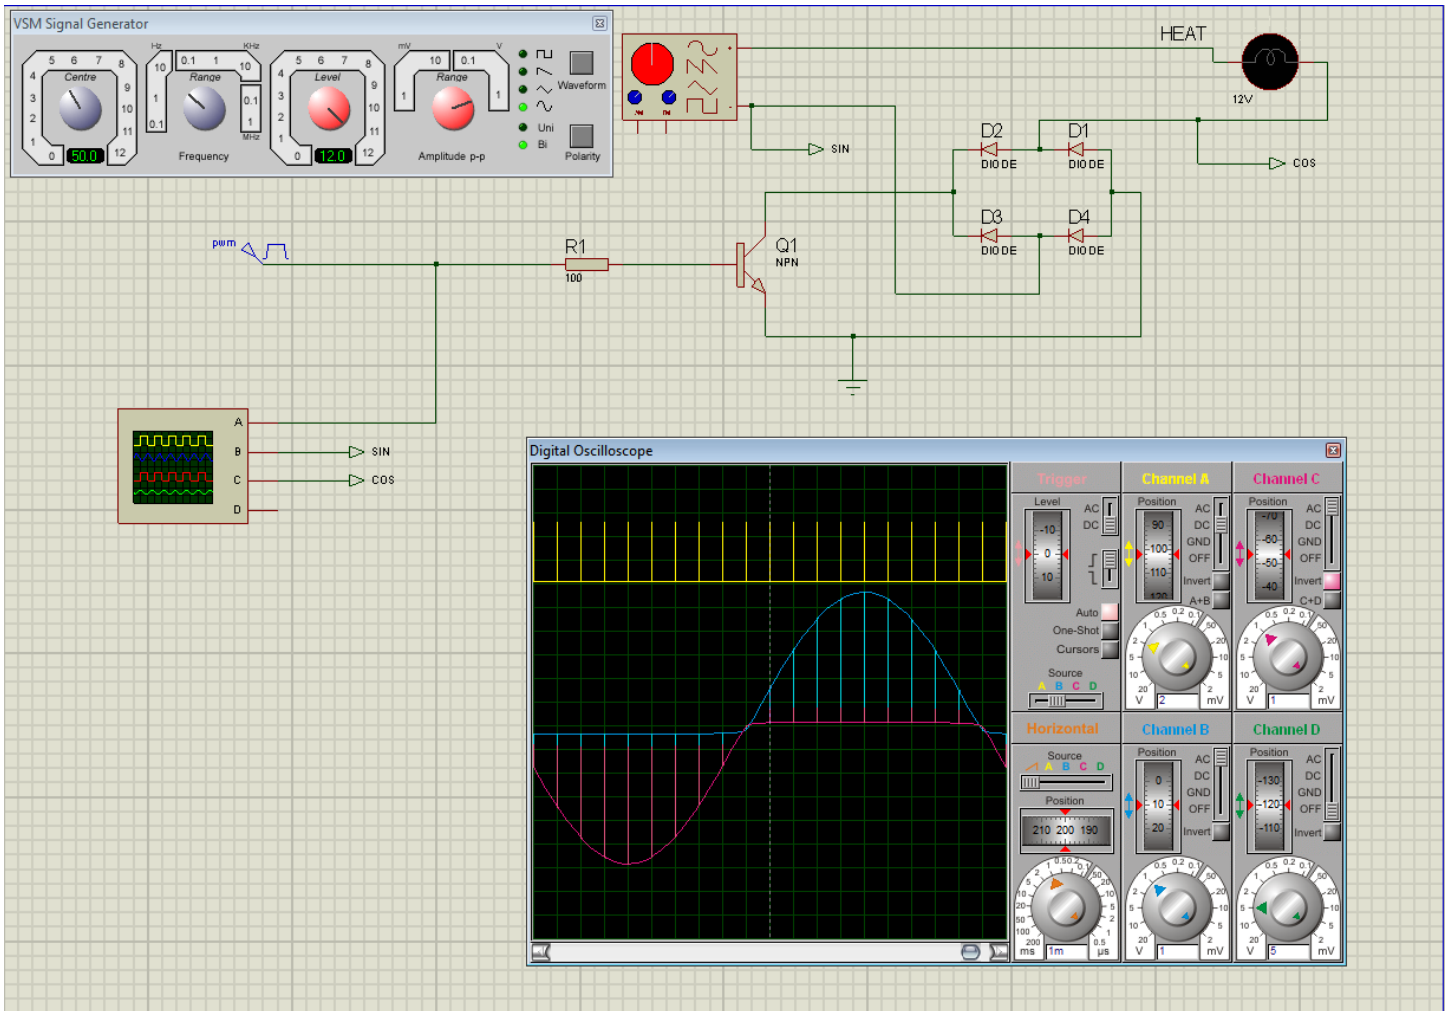

PWM output modulating alternating current (AC) at 50% duty cycle

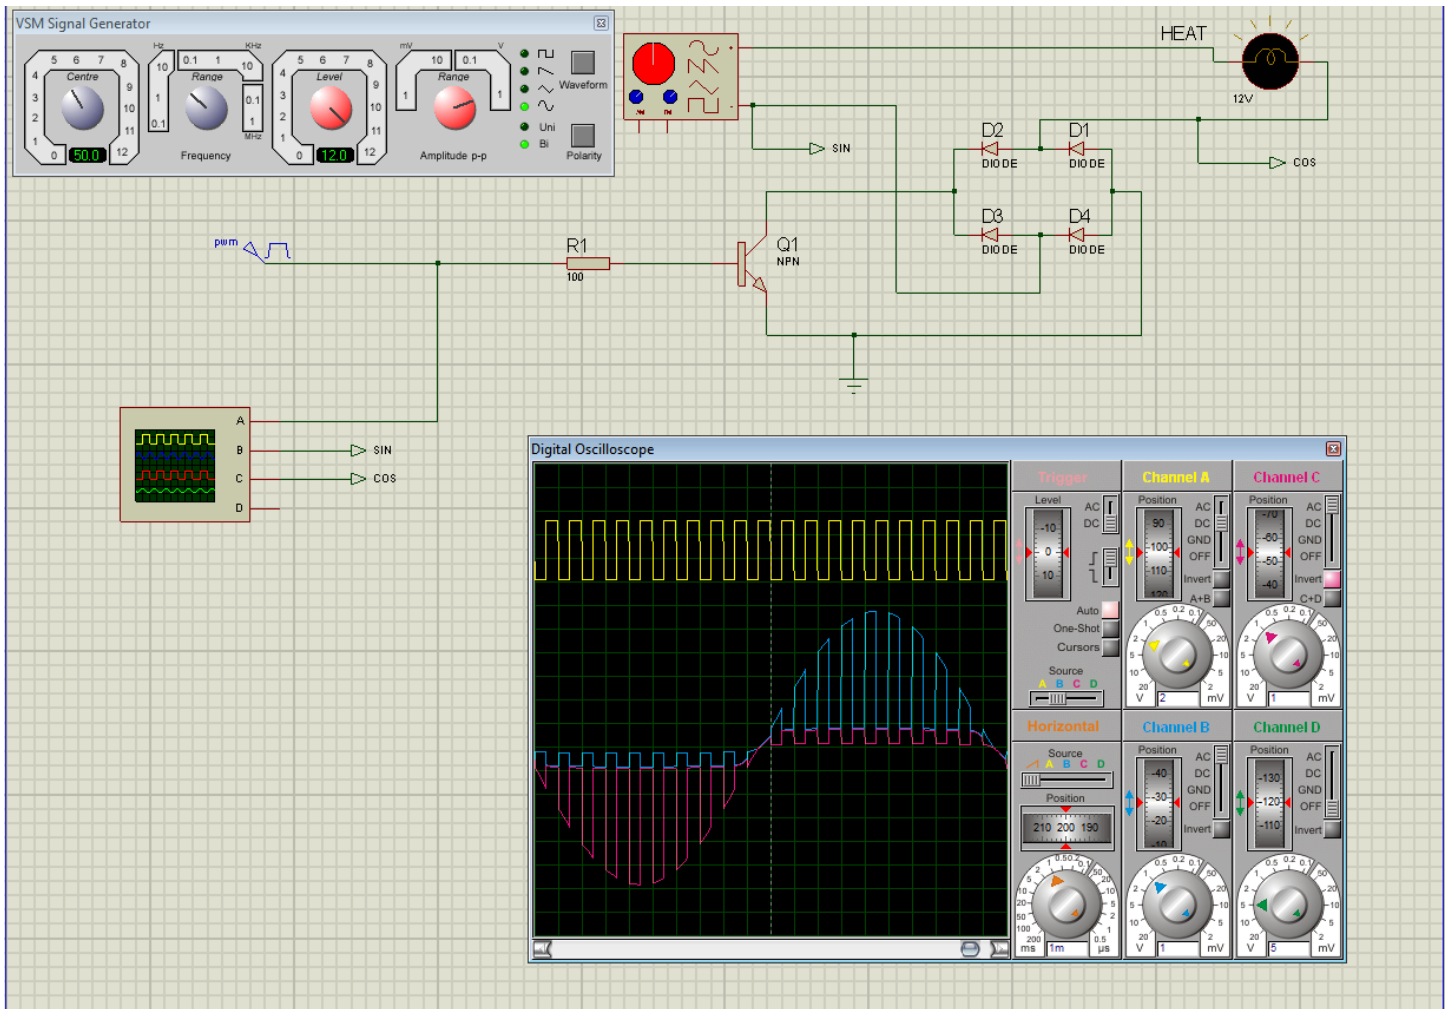

PWM output modulating alternating current (AC) at 99% duty cycle

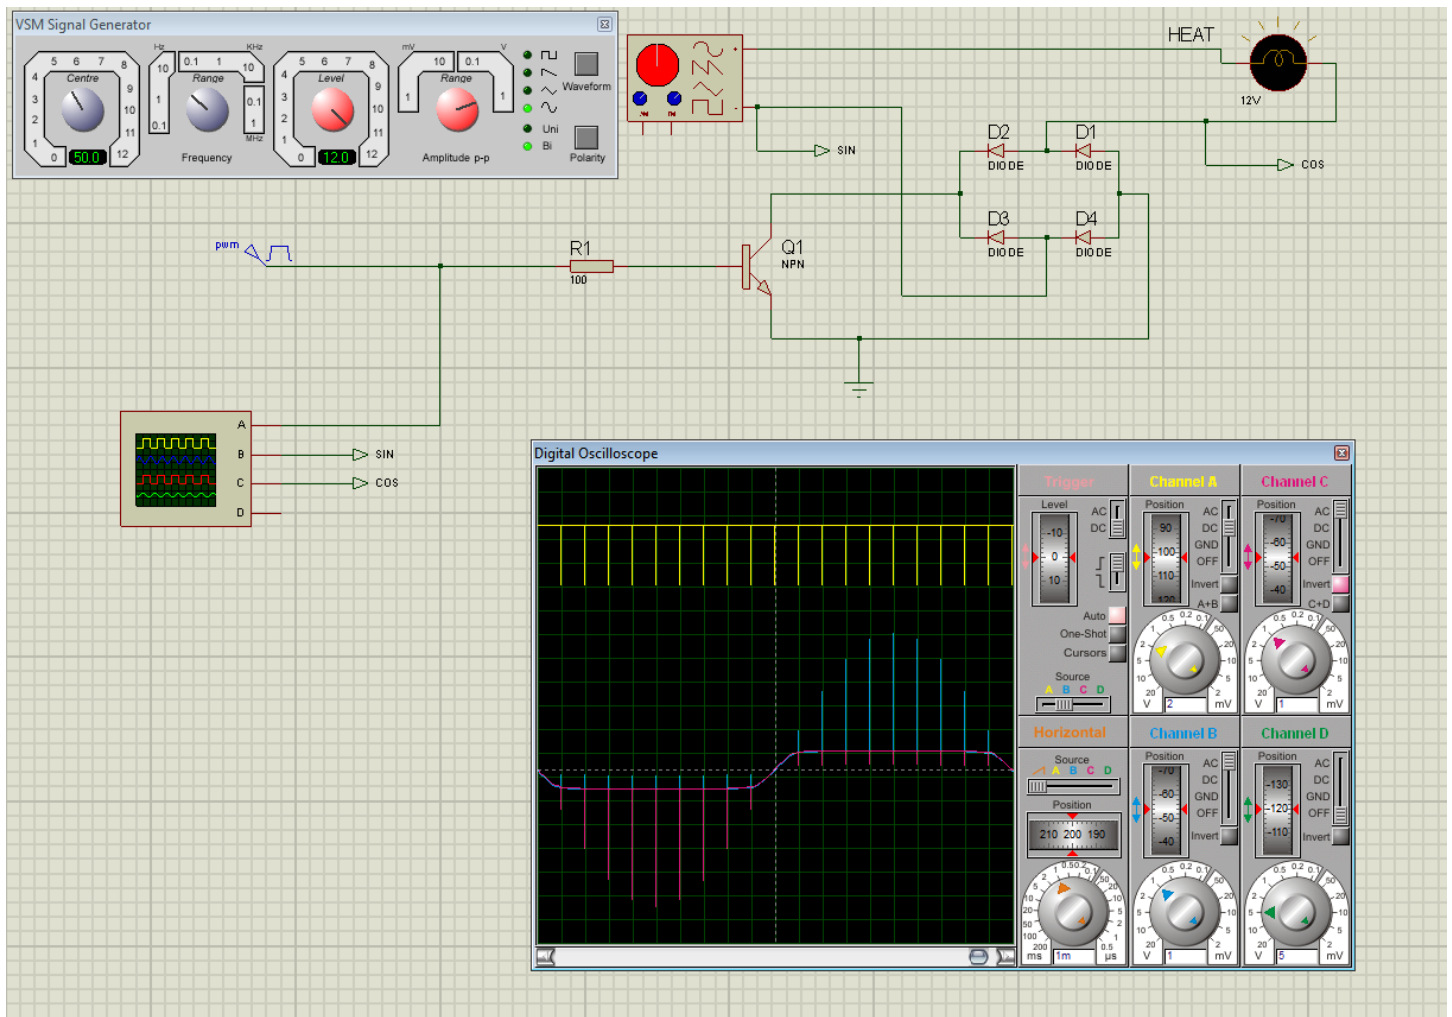

Peristaltic Pump

There are two peristaltic pump Output modules that Mycodo supports, a generic peristaltic pump Output, and the Atlas Scientific EZO-PMP peristaltic pump.

Generic Peristaltic Pump

Any peristaltic pump can be used with the Generic Peristaltic Pump Output to dispense liquids. The most basic dispensing abilities are to start dispensing, stop dispensing, or dispense for a duration of time. If the pump rate has been measured, this value can be entered into the Fastest Rate (ml/min) setting and the Output controller will then be able to dispense specific volumes rather than merely for durations of time. In order to dispense specific volumes, the Output Mode will also need to be set in addition to the Desired Flow Rate (ml/min), if the Output Mode has been set to Specify Flow Rate.

To determine your pump's flow rate, first purge all air from your pump's hose. Next, instruct the pump to dispense for 60 seconds and collect the liquid it dispenses. Once finished, measure the amount of liquid and enter this value, in milliliters into the Fastest Rate (ml/min) setting. Once your pump's flow rate is set, you can now start dispensing specific volumes rather than durations.

This Output module relies on switching a GPIO pin High and Low to switch the peristaltic pump on and off. This is most easily accomplished with the use of a relay in-line with your pump's power supply or using the GPIO as an input signal directly to the pump (if supported). When using a relay, it's important to develop your circuit to provide the fastest possible switching of the pump. Since the volume dispensed by the pump is dependent on time, the faster the pump switching can occur, the more accurate the dispensing will be. Many peristaltic pumps operate on DC voltage and require an AC-DC converter. These converters can take a significant amount of time to energize once power is applied as well as de-energize once power is removed, causing significant delays that can impact dispensing accuracy. To alleviate this issue, the DC power should be switched, rather than the AC power, which will remove this potential delay.

Atlas Scientific Peristaltic Pump

The Atlas Scientific peristaltic pump is a peristaltic pump and microcontroller combined that allows it to be communicated with via I2C or Serial and can accurately dispense specific volumes of fluid. There are several commands the pump can accept, including commands to calibrate, turn on, turn off, and dispense at a specific rate, among others. Atlas Scientific peristaltic pumps are good options, but are more expensive than generic peristaltic pumps.

Peristaltic Pump Options

Setting	Description
Output Mode	“Fastest low Rate” will pump liquid at the fastest rate the pump can perform. “Specify Flow Rate” will pump liquid at the rate set by the “Flow Rate (ml/min)” option.
Flow Rate (ml/min)	This is how fast liquid will be pumped if the “Specify Flow Rate” option is selected for the Output Mode option.
Fastest Rate (ml/min)	This is the rate at which the pump dispenses liquid, in ml/min.
Minimum On (sec/min)	This is the minimum duration (seconds) the pump should be turned on for every 60 second period of pumping. This option is only used when Specify Flow Rate is selected as the output Mode.

Wireless 315/433 MHz

Certain 315/433 MHz wireless relays may be used, however you will need to set the pin of the transmitter (using BCM numbering), pulse length, bit length, protocol, on command, and off command. To determine your On and Off commands, connect a 315/433 MHz receiver to your Pi, then run the receiver script, below, replacing 17 with the pin your receiver is connected to (using BCM numbering), and press one of the buttons on your remote (either on or off) to detect the numeric code associated with that button.

```
sudo ~/Mycodo/env/bin/python ~/Mycodo/mycodo/devices/wireless_rpi_rf.py -d 2 -g 17
```

433 MHz wireless relays have been successfully tested with SMAKN 433MHz RF Transmitters/Receivers and Etekcity Wireless Remote Control Electrical Outlets (see Issue 88 for more information). If you have a 315/433 MHz transmitter/receiver and a wireless relay that does not work with the current code, submit a new issue with details of your hardware.

Linux Command

Another option for output control is to execute a terminal command when the output is turned on, off, or a duty cycle is set. Commands will be executed as the user ‘root’. When a Linux Command output is created, example code is provided to demonstrate how to use the output.

Python Command

The Python Command output operates similarly to the Linux Command output, however Python 3 code is being executed. When a Python Command output is created, example code is provided to demonstrate how to use the output.

Output Notes

Wireless and Command (Linux/Python) Outputs: Since the wireless protocol only allows 1-way communication to 315/433 MHz devices, wireless relays are assumed to be off until they are turned on, and therefore will appear red (off) when added. If a wireless relay is turned off or on outside Mycodo (by a remote, for instance), Mycodo will ***not*** be able to determine the state of the relay and will indicate whichever state the relay was last. This is, if Mycodo turns the wireless relay on, and a remote is used to turn the relay off, Mycodo will still assume the relay is on.

Functions

Custom Controllers

There is a Custom Controller import system in Mycodo that allows user-created Controllers to be used in the Mycodo system. Custom Controllers can be uploaded on the **Configure -> Controllers** page. After import, they will be available to use on the **Setup -> Function** page.

There are also example Custom Controller files in `Mycodo/mycodo/controllers/custom_controllers/examples`

Additionally, I have another github repository devoted to Custom Inputs and Controllers that are not included in the built-in set. These can be found at [kizniche/Mycodo-custom](https://github.com/kizniche/Mycodo-custom).

PID Controller

A proportional-derivative-integral (PID) controller is a control loop feedback mechanism used throughout industry for controlling systems. It efficiently brings a measurable condition, such as the temperature, to a desired state and maintains it there with little overshoot and oscillation. A well-tuned PID controller will raise to the setpoint quickly, have minimal overshoot, and maintain the setpoint with little oscillation.

PID settings may be changed while the PID is activated and the new settings will take effect immediately. If settings are changed while the controller is paused, the values will be used once the controller resumes operation.

PID Controller Options

Setting	Description
Activate/Deactivate	Turn a particular PID controller on or off.
Pause	When paused, the control variable will not be updated and the PID will not turn on the associated outputs. Settings can be changed without losing current PID output values.
Hold	When held, the control variable will not be updated but the PID will turn on the associated outputs. Settings can be changed without losing current PID output values.
Resume	Resume a PID controller from being held or paused.
Direction	This is the direction that you wish to regulate. For example, if you only require the temperature to be raised, set this to "Up," but if you require regulation up and down, set this to "Both."
Period	This is the duration between when the PID acquires a measurement, the PID is updated, and the output is modulated.
Start Offset (seconds)	Wait this duration before attempting the first calculation/measurement.
Max Age	The time (in seconds) that the sensor measurement age is required to be less than. If the measurement is not younger than this age, the measurement is thrown out and the PID will not actuate the output. This is a safety measure to ensure the PID is only using recent measurements.
Setpoint	This is the specific point you would like the environment to be regulated at. For example, if you would like the humidity regulated to 60%, enter 60.
Band (+/- Setpoint)	Hysteresis option. If set to a non-0 value, the setpoint will become a band, which will be between the <code>band_max=setpoint+band</code> and <code>band_min=setpoint-band</code> . If Raising, the PID will raise above <code>band_max</code> , then wait until the condition falls below <code>band_min</code> to resume regulation. If Lowering, the PID will lower below <code>band_min</code> , then wait until the condition rises above <code>band_max</code> to resume regulating. If set to Both, regulation will only occur to the outside min and max of the band, and cease when within the band. Set to 0 to disable Hysteresis.

Setting	Description
Store Lower as Negative	Checking this will store all output variables (PID and output duration/duty cycle) as a negative values in the measurement database. This is useful for displaying graphs that indicate whether the PID is currently lowering or raising. Disable this if you desire all positive values to be stored in the measurement database.
K _P Gain	Proportional coefficient (non-negative). Accounts for present values of the error. For example, if the error is large and positive, the control output will also be large and positive.
K _I Gain	Integral coefficient (non-negative). Accounts for past values of the error. For example, if the current output is not sufficiently strong, the integral of the error will accumulate over time, and the controller will respond by applying a stronger action.
K _D Gain	Derivative coefficient (non-negative). Accounts for predicted future values of the error, based on its current rate of change.
Integrator Min	The minimum allowed integrator value, for calculating Ki_total: (Ki_total = Ki * integrator; and PID output = Kp_total + Ki_total + Kd_total)
Integrator Max	The maximum allowed integrator value, for calculating Ki_total: (Ki_total = Ki * integrator; and PID output = Kp_total + Ki_total + Kd_total)
Output (Raise/Lower)	This is the output that will cause the particular environmental condition to rise or lower. In the case of raising the temperature, this may be a heating pad or coil.
Min On Duration, Duty Cycle, or Amount (Raise/Lower)	This is the minimum value that the PID output must be before Output (Lower) turns on. If the PID output is less than this value, Duration Outputs will not turn on, and PWM Outputs will be turned off unless Always Min is enabled.
Max On Duration, Duty Cycle, or Amount (Raise/Lower)	This is the maximum duration, volume, or duty cycle the Output (Raise) can be set to. If the PID output is greater than this value, the Max value set here will be used.
Min Off Duration (Raise/Lower)	For On/Off (Duration) Outputs, this is the minimum amount of time the Output must have been off for before it is allowed to turn back on. This is useful for devices that can be damaged by rapid power cycling (e.g. fridges).
Always Min (Raise/Lower)	For PWM Outputs only. If enabled, the duty cycle will never be set below the Min value.
Setpoint Tracking Method	Set a method to change the setpoint over time.

PID Output Calculation

PID Controllers can output as a duration or a duty cycle.

When outputting a duration, $\text{Duration} = \text{Control_Variable}$

When outputting a duty cycle, $\text{Duty Cycle} = (\text{Control_Variable} / \text{Period}) * 100$

Note: $\text{Control_Variable} = \text{P_Output} + \text{I_Output} + \text{D_Output}$. Duty cycle is limited within the 0 - 100 % range and the set Min Duty Cycle and Max Duty Cycle. Duration is limited by the set Min On Duration and Max On Duration.

PID Tuning

PID tuning is a complex process, but not unattainable if enough time and effort is invested to learn how a PID operates. Below is a primer for understanding how a PID controller operates and a few examples of how to tune a PID controller. For further discussion, join the Mycodo PID Tuning forum.


PID Control Theory

The PID controller is the most common regulatory controller found in industrial settings, for it's ability to handle both simple and complex regulation. The PID controller has three paths, the proportional, integral, and derivative.

The **Proportional** takes the error and multiplies it by the constant K_P , to yield an output value. When the error is large, there will be a large proportional output.

The **Integral** takes the error and multiplies it by K_I , then integrates it ($K_I \cdot 1/s$). As the error changes over time, the integral will continually sum it and multiply it by the constant K_I . The integral is used to remove perpetual error in the control system. If using K_P alone produces an output that produces a perpetual error (i.e. if the sensor measurement never reaches the Set Point), the integral will increase the output until the error decreases and the Set Point is reached.

The **Derivative** multiplies the error by K_D , then differentiates it ($K_D \cdot s$). When the error rate changes over time, the output signal will change. The faster the change in error, the larger the derivative path becomes, decreasing the output rate of change. This has the effect of dampening overshoot and undershoot (oscillation) of the Set Point.

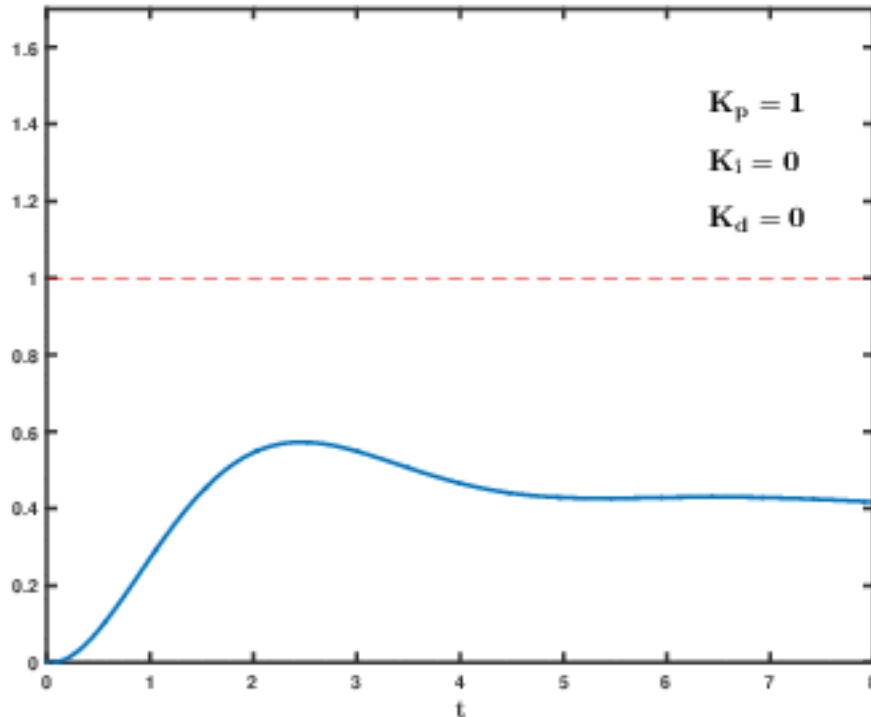

The K_P , K_I , and K_D gains determine how much each of the P, I, and D variables influence the final PID output value. For instance, the greater the value of the gain, the more influence that variable has on the output.

$$u(t) = \underbrace{K_p e(t)}_{\text{Proportional}} + \underbrace{K_i \int_0^t e(\tau) d\tau}_{\text{Integral}} + \underbrace{K_d \frac{d}{dt} e(t)}_{\text{Derivative}}$$

The output from the PID controller can be used in a number of ways. A simple use is to use this value as the number of seconds an output is turned on during a periodic interval (Period). For instance, if the Period is set to 30 seconds, the PID equation has the desired measurement and the actual measurement used to calculate the PID output every 30 seconds. The more the output is on during this period, the more it will affect the system. For example, an output on for 15 seconds every 30 seconds is at a 50 % duty cycle, and would affect the system roughly half as much as when the output is on for 30 seconds every 30 seconds, or at at 100 % duty cycle. The PID controller will calculate the output based on the amount of error (how far the actual measurement is from the desired measurement). If the error increases or persists, the output increases, causing the output to turn on for a longer duration within the Period, which usually in term causes the measured condition to change and the error to reduce. When the error reduces, the control variable decreases, meaning the output is turned on for a shorter duration of time. The ultimate goal of a well-tuned PID controller is to bring the actual measurement to the desired measurement quickly, with little overshoot, and maintain the setpoint with minimal oscillation.

Using temperature as an example, the Process Variable (PV) is the measured temperature, the Setpoint (SP) is the desired temperature, and the Error (e) is the distance between the measured temperature and the desired temperature (indicating if the actual temperature is too hot or too cold and to what degree). The error is manipulated by each of the three PID components, producing an output, called the Manipulated Variable (MV) or Control Variable (CV). To allow control of how much each path contributes to the output value, each path is multiplied by a gain (represented by K_P , K_I , and K_D). By adjusting the gains, the sensitivity of the system to each path is affected. When all three paths are summed, the PID output is produced. If a gain is set to 0, that path does not contribute to the output and that path is essentially turned off.

The output can be used a number of ways, however this controller was designed to use the output to affect the measured value (PV). This feedback loop, with a *properly tuned* PID controller, can achieve a set point in a short period of time, maintain regulation with little oscillation, and respond quickly to disturbance.

Therefore, if one would be regulating temperature, the sensor would be a temperature sensor and the feedback device(s) would be able to heat and cool. If the temperature is lower than the Set Point, the output value would be positive and a heater would activate. The temperature would rise toward the desired temperature, causing the error to decrease and a lower output to be produced. This feedback loop would continue until the error reaches 0 (at which point the output would be 0). If the temperature continues to rise past the Set Point (this is may be acceptable, depending on the degree), the PID would produce a negative output, which could be used by the cooling device to bring the temperature back down, to reduce the error. If the temperature would normally lower without the aid of a cooling device, then the system can be simplified by omitting a cooler and allowing it to lower on its own.

Implementing a controller that effectively utilizes K_P , K_I , and K_D can be challenging. Furthermore, it is often unnecessary. For instance, the K_I and K_D can be set to 0, effectively turning them off and producing the very popular and simple P controller. Also popular is the PI controller. It is recommended to start with only K_P activated, then experiment with K_P and K_I , before finally using all three. Because systems will vary (e.g. airspace volume, degree of insulation, and the degree of impact from the connected device, etc.), each path will need to be adjusted through experimentation to produce an effective output.

Quick Setup Examples

These example setups are meant to illustrate how to configure regulation in particular directions, and not to achieve ideal values to configure your K_P , K_I , and K_D gains. There are a number of online resources that discuss techniques and methods that have been developed to determine ideal PID values (such as [here](#), [here](#), [here](#), [here](#), and [here](#)) and since there are no universal values that will work for every system, it is recommended to conduct your own research to understand the variables and essential to conduct your own experiments to effectively implement them.

Provided merely as an example of the variance of PID values, one of my setups had temperature PID values (up regulation) of $K_P = 30$, $K_I = 1.0$, and $K_D = 0.5$, and humidity PID values (up regulation) of $K_P = 1.0$, $K_I = 0.2$, and $K_D = 0.5$. Furthermore, these values may not have been optimal but they worked well for the conditions of my environmental chamber.

Exact Temperature Regulation

This will set up the system to raise and lower the temperature to a certain level with two regulatory devices (one that heats and one that cools).

Add a sensor, then save the proper device and pin/address for each sensor and activate the sensor.

Add two outputs, then save each GPIO and On Trigger state.

Add a PID, then select the newly-created sensor. Change *Setpoint* to the desired temperature, *Regulate Direction* to “Both”. Set *Raise Output* to the relay attached to the heating device and the *Lower Relay* to the relay attached to the cooling device.

Set $K_P = 1$, $K_I = 0$, and $K_D = 0$, then activate the PID.

If the temperature is lower than the Set Point, the heater should activate at some interval determined by the PID controller until the temperature rises to the set point. If the temperature goes higher than the Set Point (or Set Point + Buffer), the cooling device will activate until the temperature returns to the set point. If the temperature is not reaching the Set Point after a reasonable amount of time, increase the K_P value and see how that affects the system. Experiment with different configurations involving only *Read Interval* and K_P to achieve a good regulation. Avoid changing the K_I and K_D from 0 until a working regulation is achieved with K_P alone.

View graphs in the 6 to 12 hour time span to identify how well the temperature is regulated to the Setpoint. What is meant by well-regulated will vary, depending on your specific application and tolerances. Most applications of a PID controller would like to see the proper temperature attained within a reasonable amount of time and with little oscillation around the Setpoint.

Once regulation is achieved, experiment by reducing K_P slightly (~25%) and increasing K_I by a low amount to start, such as 0.1 (or lower, 0.01), then start the PID and observe how well the controller regulates. Slowly increase K_I until regulation becomes both quick and with little oscillation. At this point, you should be fairly familiar with experimenting with the system and the K_D value can be experimented with once both K_P and K_I have been tuned.

High Temperature Regulation

Often the system can be simplified if two-way regulation is not needed. For instance, if cooling is unnecessary, this can be removed from the system and only up-regulation can be used.

Use the same configuration as the Exact Temperature Regulation example, except change *Regulate Direction* to “Raise” and do not touch the “Down Relay” section.


PID Autotune

Note: This is an experimental feature. It is best not used until you are familiar with the operation and tuning of a PID.

The Autotune feature is useful for determining appropriate K_p , K_i , and K_d gains of a PID controller. The autotuner will manipulate an output and measure the response in the environment being measured by a sensor. It will take several cycles to determine the gains according to several rules. In order to use this feature, the PID controller must be properly configured, and a Noise Band and Outstep selected, then select “Start Autotune”. The output of the autotuner will appear in the daemon log (Config -> Mycodo Logs -> Daemon). While the autotune is being performed, it is recommended to create a graph that includes the Input, Output, and PID Setpoint/Output in order to see what the PID Autotuner is doing and to notice any issues. If your autotune is taking a long time to complete, there may not be enough stability in the system being manipulated to calculate a reliable set of PID gains. This may be because there are too many disturbances to the system, or conditions are changing too rapidly to acquire consistent measurement oscillations. If this is the case, try modifying your system to reduce disturbances. Once the autotune successfully completes, disturbances may be reintroduced in order to further tune the PID controller to handle them.

Setting	Description
Noise Band	This is the amount above the setpoint the measured condition must reach before the output turns off. This is also how much below the setpoint the measured condition must fall before the output turns back on.
Outstep	This is how many seconds the output will turn on every PID Period. For instance, to autotune with 50% power, ensure the Outstep is half the value of the PID Period.

Typical graph output will look like this:

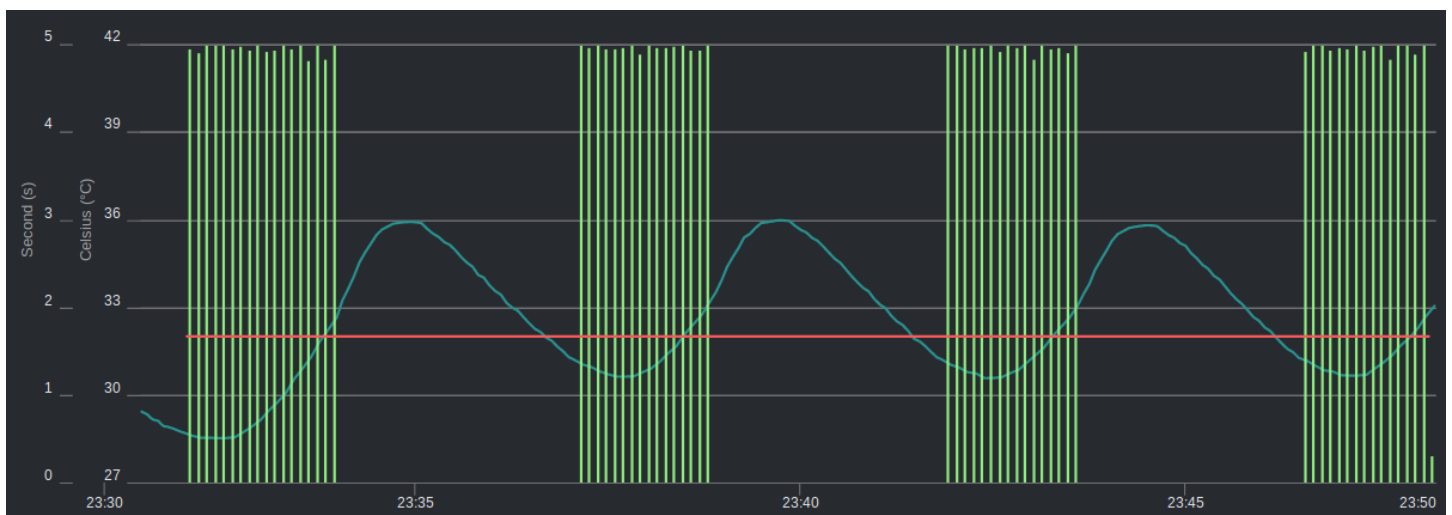

And typical Daemon Log output will look like this:

```
2018-08-04 23:32:20,876 - mycodo.pid_3b533dff - INFO - Activated in 187.2 ms
2018-08-04 23:32:20,877 - mycodo.pid_autotune - INFO - PID Autotune started
2018-08-04 23:33:50,823 - mycodo.pid_autotune - INFO -
2018-08-04 23:33:50,830 - mycodo.pid_autotune - INFO - Cycle: 19
2018-08-04 23:33:50,831 - mycodo.pid_autotune - INFO - switched state: relay step down
2018-08-04 23:33:50,832 - mycodo.pid_autotune - INFO - input: 32.52
2018-08-04 23:36:00,854 - mycodo.pid_autotune - INFO -
2018-08-04 23:36:00,860 - mycodo.pid_autotune - INFO - Cycle: 45
2018-08-04 23:36:00,862 - mycodo.pid_autotune - INFO - found peak: 34.03
2018-08-04 23:36:00,863 - mycodo.pid_autotune - INFO - peak count: 1
2018-08-04 23:37:20,802 - mycodo.pid_autotune - INFO -
2018-08-04 23:37:20,809 - mycodo.pid_autotune - INFO - Cycle: 61
2018-08-04 23:37:20,810 - mycodo.pid_autotune - INFO - switched state: relay step up
2018-08-04 23:37:20,811 - mycodo.pid_autotune - INFO - input: 31.28
2018-08-04 23:38:30,867 - mycodo.pid_autotune - INFO -
2018-08-04 23:38:30,874 - mycodo.pid_autotune - INFO - Cycle: 75
2018-08-04 23:38:30,876 - mycodo.pid_autotune - INFO - found peak: 32.17
2018-08-04 23:38:30,878 - mycodo.pid_autotune - INFO - peak count: 2
2018-08-04 23:38:40,852 - mycodo.pid_autotune - INFO -
2018-08-04 23:38:40,858 - mycodo.pid_autotune - INFO - Cycle: 77
2018-08-04 23:38:40,860 - mycodo.pid_autotune - INFO - switched state: relay step down
2018-08-04 23:38:40,861 - mycodo.pid_autotune - INFO - input: 32.85
2018-08-04 23:40:50,834 - mycodo.pid_autotune - INFO -
2018-08-04 23:40:50,835 - mycodo.pid_autotune - INFO - Cycle: 103
2018-08-04 23:40:50,836 - mycodo.pid_autotune - INFO - found peak: 33.93
2018-08-04 23:40:50,836 - mycodo.pid_autotune - INFO - peak count: 3
2018-08-04 23:42:05,799 - mycodo.pid_autotune - INFO -
2018-08-04 23:42:05,805 - mycodo.pid_autotune - INFO - Cycle: 118
2018-08-04 23:42:05,806 - mycodo.pid_autotune - INFO - switched state: relay step up
2018-08-04 23:42:05,807 - mycodo.pid_autotune - INFO - input: 31.27
2018-08-04 23:43:15,816 - mycodo.pid_autotune - INFO -
2018-08-04 23:43:15,822 - mycodo.pid_autotune - INFO - Cycle: 132
2018-08-04 23:43:15,824 - mycodo.pid_autotune - INFO - found peak: 32.09
2018-08-04 23:43:15,825 - mycodo.pid_autotune - INFO - peak count: 4
2018-08-04 23:43:25,790 - mycodo.pid_autotune - INFO -
2018-08-04 23:43:25,796 - mycodo.pid_autotune - INFO - Cycle: 134
2018-08-04 23:43:25,797 - mycodo.pid_autotune - INFO - switched state: relay step down
2018-08-04 23:43:25,798 - mycodo.pid_autotune - INFO - input: 32.76
2018-08-04 23:45:30,802 - mycodo.pid_autotune - INFO -
2018-08-04 23:45:30,808 - mycodo.pid_autotune - INFO - Cycle: 159
2018-08-04 23:45:30,810 - mycodo.pid_autotune - INFO - found peak: 33.98
2018-08-04 23:45:30,811 - mycodo.pid_autotune - INFO - peak count: 5
2018-08-04 23:45:30,812 - mycodo.pid_autotune - INFO -
2018-08-04 23:45:30,814 - mycodo.pid_autotune - INFO - amplitude: 0.9099999999999999
2018-08-04 23:45:30,815 - mycodo.pid_autotune - INFO - amplitude deviation: 0.06593406593406595
2018-08-04 23:46:40,851 - mycodo.pid_autotune - INFO -
2018-08-04 23:46:40,857 - mycodo.pid_autotune - INFO - Cycle: 173
2018-08-04 23:46:40,858 - mycodo.pid_autotune - INFO - switched state: relay step up
2018-08-04 23:46:40,859 - mycodo.pid_autotune - INFO - input: 31.37
2018-08-04 23:47:55,860 - mycodo.pid_autotune - INFO -
2018-08-04 23:47:55,866 - mycodo.pid_autotune - INFO - Cycle: 188
2018-08-04 23:47:55,868 - mycodo.pid_autotune - INFO - found peak: 32.36
2018-08-04 23:47:55,869 - mycodo.pid_autotune - INFO - peak count: 6
2018-08-04 23:47:55,870 - mycodo.pid_autotune - INFO -
2018-08-04 23:47:55,871 - mycodo.pid_autotune - INFO - amplitude: 0.9149999999999999
2018-08-04 23:47:55,872 - mycodo.pid_autotune - INFO - amplitude deviation: 0.032786885245900406
2018-08-04 23:47:55,873 - mycodo.pid_3b533dff - INFO - time: 16 min
2018-08-04 23:47:55,874 - mycodo.pid_3b533dff - INFO - state: succeeded
```

```

2018-08-04 23:47:55,874 - mycodo.pid_3b533dff - INFO -
2018-08-04 23:47:55,875 - mycodo.pid_3b533dff - INFO - rule: ziegler-nichols
2018-08-04 23:47:55,876 - mycodo.pid_3b533dff - INFO - Kp: 0.40927018474290117
2018-08-04 23:47:55,877 - mycodo.pid_3b533dff - INFO - Ki: 0.05846588600007114
2018-08-04 23:47:55,879 - mycodo.pid_3b533dff - INFO - Kd: 0.7162385434443115
2018-08-04 23:47:55,880 - mycodo.pid_3b533dff - INFO -
2018-08-04 23:47:55,881 - mycodo.pid_3b533dff - INFO - rule: tyreus-luyben
2018-08-04 23:47:55,887 - mycodo.pid_3b533dff - INFO - Kp: 0.3162542336649691
2018-08-04 23:47:55,889 - mycodo.pid_3b533dff - INFO - Ki: 0.010165091543194185
2018-08-04 23:47:55,890 - mycodo.pid_3b533dff - INFO - Kd: 0.7028026111719073
2018-08-04 23:47:55,891 - mycodo.pid_3b533dff - INFO -
2018-08-04 23:47:55,892 - mycodo.pid_3b533dff - INFO - rule: ciancone-marlin
2018-08-04 23:47:55,892 - mycodo.pid_3b533dff - INFO - Kp: 0.21083615577664605
2018-08-04 23:47:55,893 - mycodo.pid_3b533dff - INFO - Ki: 0.06626133746674728
2018-08-04 23:47:55,893 - mycodo.pid_3b533dff - INFO - Kd: 0.3644161687558038
2018-08-04 23:47:55,894 - mycodo.pid_3b533dff - INFO -
2018-08-04 23:47:55,894 - mycodo.pid_3b533dff - INFO - rule: pessen-integral
2018-08-04 23:47:55,895 - mycodo.pid_3b533dff - INFO - Kp: 0.49697093861638
2018-08-04 23:47:55,895 - mycodo.pid_3b533dff - INFO - Ki: 0.0887428626786794
2018-08-04 23:47:55,896 - mycodo.pid_3b533dff - INFO - Kd: 1.04627757151908
2018-08-04 23:47:55,896 - mycodo.pid_3b533dff - INFO -
2018-08-04 23:47:55,897 - mycodo.pid_3b533dff - INFO - rule: some-overshoot
2018-08-04 23:47:55,898 - mycodo.pid_3b533dff - INFO - Kp: 0.23191977135431066
2018-08-04 23:47:55,898 - mycodo.pid_3b533dff - INFO - Ki: 0.03313066873337365
2018-08-04 23:47:55,899 - mycodo.pid_3b533dff - INFO - Kd: 1.0823160212047374
2018-08-04 23:47:55,899 - mycodo.pid_3b533dff - INFO -
2018-08-04 23:47:55,900 - mycodo.pid_3b533dff - INFO - rule: no-overshoot
2018-08-04 23:47:55,900 - mycodo.pid_3b533dff - INFO - Kp: 0.1391518628125864
2018-08-04 23:47:55,901 - mycodo.pid_3b533dff - INFO - Ki: 0.01987840124002419
2018-08-04 23:47:55,901 - mycodo.pid_3b533dff - INFO - Kd: 0.6493896127228425
2018-08-04 23:47:55,902 - mycodo.pid_3b533dff - INFO -
2018-08-04 23:47:55,902 - mycodo.pid_3b533dff - INFO - rule: brewing
2018-08-04 23:47:55,903 - mycodo.pid_3b533dff - INFO - Kp: 5.566074512503456
2018-08-04 23:47:55,904 - mycodo.pid_3b533dff - INFO - Ki: 0.11927040744014512
2018-08-04 23:47:55,904 - mycodo.pid_3b533dff - INFO - Kd: 4.101408080354794

```

Conditional

Conditional controllers are used to perform certain actions based on whether a conditional statement is true, which is typically based on a measurement or GPIO state.

Conditional Options

Check if the latest measurement is above or below the set value.

Setting	Description
Conditional Statement	The text string that includes device IDs enclosed in curly brackets ({}) that will be converted to the actual measurement before being evaluated by python to determine if it is True or False. If True, the associated actions will be executed.
Period (seconds)	The period (seconds) between conditional checks.
Start Offset (seconds)	The duration (seconds) to wait before executing the Conditional for the first after it is activated.
Log Level: Debug	Show debug lines in the daemon log.
Message Includes Code	Include Conditional Statement code in the message that is passed to actions.

Conditions are variables that can be used within the Conditional Statement.

Condition	Description
Measurement (Single, Last)	Acquires the latest measurement from an Input or device. Set Max Age (seconds) to restrict how long to accept values. If the latest value is older than this duration, "None" is returned.
Measurement (Single, Past, Average)	Acquires the past measurements from an Input or device, then averages them. Set Max Age (seconds) to restrict how long to accept values. If all values are older than this duration, "None" is returned.
Measurement (Single, Past, Sum)	Acquires the past measurements from an Input or device, then sums them. Set Max Age (seconds) to restrict how long to accept values. If all values are older than this duration, "None" is returned.
Measurement (Multiple, Past)	Acquires the past measurements from an Input or device. Set Max Age (seconds) to restrict how long to accept values. If no values are found in this duration, "None" is returned. This differs from the "Measurement (Single)" Condition because it returns a list of dictionaries with 'time' and 'value' key pairs.
GPIO State	Acquires the current GPIO state and returns 1 if HIGH or 0 if LOW. If the latest value is older than this duration, "None" is returned.
Output State	Returns 'on' if the output is currently on, and 'off' if it's currently off.
Output Duration On	Returns how long the output has currently been on, in seconds. Returns 0 if off.
Controller Running	Returns True if the controller is active, False if inactive.
Max Age (seconds)	The minimum age (seconds) the measurement can be. If the last measurement is older than this, "None" will be returned instead of a measurement.

Conditional Setup Guide

Python 3 is the environment that these conditionals will be executed. The following functions can be used within your code.

Note: Indentation must use 4 spaces (not 2 spaces, tabs, or other).

Function	Description
<code>self.condition("{ID}")</code>	Returns a measurement for the Condition with ID.
<code>self.condition_dict("{ID }")</code>	Returns a dictionary of measurement for the Condition with ID.
<code>self.run_action("{ID}")</code>	Executes the Action with ID.
<code>self.run_all_actions()</code>	Executes all actions.
<code>self.logger.info()</code>	Writes a log line to the daemon log. 'info' may also be changed to 'error' or 'debug'.

There are additional functions that can be used, but these must use the full UUID (not an abridged version as the functions above). See `/home/pi/Mycodo/mycodo/mycodo_client.py` for the functions available for use. These may be accessed via the 'control' object. An example, below, will return how long the output has been on (or 0 if it's currently off):

```
output_on_seconds = control.output_sec_currently_on('1b6ada50-1e69-403a-9fa6-ec748b16dc23')
```

Since the Python code contained in the Conditional Statement must be formatted properly, it's best to familiarize yourself with the basics of Python.

Note that there are two different IDs in use here, one set of IDs are for the measurements, under the **Conditions** section of the Conditional, and one set of IDs are for the Actions, under the **Actions** section of the Conditional. Read all of this section, including the examples, below, to fully understand how to configure a conditional properly.

IMPORTANT: If a measurement hasn't been acquired within the Max Age that is set, "None" will be returned when `self.condition("{ID}")` is called in the code. It is very important that you account for this. All examples below incorporate a test for the measurement being None, and this should not be removed. If an error occurs (such as if the statement resolves to comparing None to a numerical value, such as "if None < 23"), then the code will stop there and an error will be logged in the daemon log. Accounting for None is useful for determining if an Input is no longer acquiring measurements (e.g. dead


sensor, malfunction, etc.).

To create a basic conditional, follow these steps, using the numbers in the screenshots, below, that correspond to the numbers in parentheses:

- Navigate to the **Setup -> Function** page.
- Select “Controller: Conditional”, then click **Add**.
- Under Conditions (1), select a condition option, then click **Add Condition**.
- Configure the newly-added Condition then click **Save**.
- Under Actions (2), select an action option, then click **Add Action**.
- Configure the newly-added Action then click **Save**.
- Notice that each Condition and each Action has its own ID (underlined).
- The default Conditional Statement (3) contains placeholder IDs that need to be changed to your Condition and Action IDs. Change the ID in `self.condition("{asdf1234}")` to your Condition ID. Change the ID in `self.run_action("{qwer5678}", message=message)` to your Action ID. Click **Save** at the top of the Conditional.
- The logic used in the Conditional Statement will need to be adjusted to suit your particular needs. Additionally, you may add more Conditions or Actions. See the **Advanced Conditional Statement examples**, below, for usage examples.

If your **Conditional Statement** has been formatted correctly, your Conditional will save and it will be ready to activate. If an error is returned, your options will not have been saved. Inspect the error for which line is causing the issue and read the error message itself to try to understand what the problem is and how to fix it. There are an unfathomable number of ways to configure a Conditional, but this should hopefully get you started to developing one that suits your needs.

Note: Mycodo is constantly changing, so the screenshots below may not match what you see exactly. Be sure to read this entire section of the manual to understand how to use Conditionals.

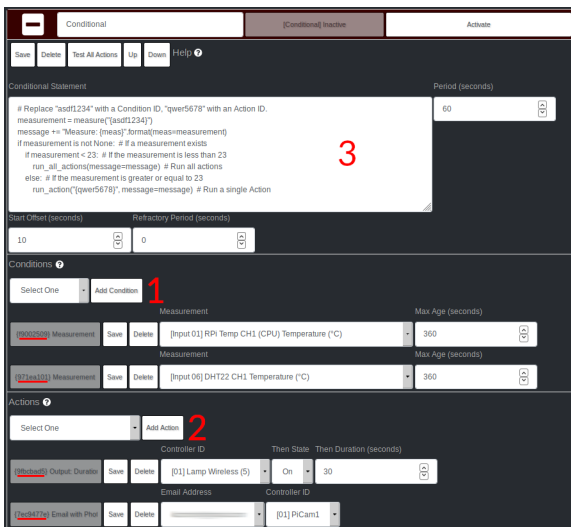

Simple Conditional Statement examples:

Each `self.condition("{ID}")` will return the most recent measurement obtained from that particular measurement under the **Conditions** section of the Conditional, as long as it's within the set Max Age.

```
# Example 1, no measurement, useful to notify by email when an Input stops working
if self.condition("{asdf1234}") is None:
    self.run_all_actions()
```

```
# Example 2, test two measurements
measure_1 = self.condition("{asdf1234}")
measure_2 = self.condition("{hjk15678}")
if None not in [measure_1, measure_2]:
    if measure_1 < 20 and measure_2 > 10:
        self.run_all_actions()
```

```
# Example 3, test two measurements and sum of measurements
measure_1 = self.condition("{asdf1234}")
measure_2 = self.condition("{hjk15678}")
if None not in [measure_1, measure_2]:
```

```

sum = measure_1 + measure_2
if measure_1 > 2 and 10 < measure_2 < 23 and sum < 30.5:
    self.run_all_actions()

# Example 4, combine into one conditional
measurement = self.condition("{asdf1234}")
if measurement != None and 20 < measurement < 30:
    self.run_all_actions()

# Example 5, test two measurements and convert Edge Input from 0 or 1 to True or False
measure_1 = self.condition("{asdf1234}")
measure_2 = self.condition("{hjdkl5678}")
if None not in [measure_1, measure_2]:
    if bool(measure_1) and measure_2 > 10:
        self.run_all_actions()

# Example 6, test measurement with "or" and a rounded measurement
measure_1 = self.condition("{asdf1234}")
measure_2 = self.condition("{hjdkl5678}")
if None not in [measure_1, measure_2]:
    if measure_1 > 20 or int(round(measure_2)) in [20, 21, 22]:
        self.run_all_actions()

# Example 7, use self to store variables
measurement = self.condition("{asdf1234}")
if not hasattr(self, "stored_measurement"): # Initialize variable
    self.stored_measurement = measurement
if measurement is not None:
    if abs(measurement - self.stored_measurement) > 10:
        self.run_all_actions() # if difference is greater than 10
    self.stored_measurement = measurement # Store measurement

```

“Measurement (Multiple)” is useful if you need to check if a particular value has been stored in any of the past measurements (within the set Max Age), not just the last measurement. This is useful if you have an alert system that each numerical value represents a different alert that you need to check each past value if it occurred. Here is an example that retrieves all measurements from the past 30 minutes and checks if each measurement value is equal to “119”. If “119” exists, the Actions are executed and `break` is used to exit the `for` loop. `each_measure[‘time’]` may also be used to retrieve the timestamp for the particular measurement.

```

# Example 1, find a particular measurement in the past 30 minutes (set Max Age to 1800 seconds)
measurements = self.condition_dict("{asdf1234}")
if measurements:
    for each_measure in measurements:
        if each_measure['value'] == 119:
            self.run_all_actions()
            break

```

Advanced Conditional Statement examples:

These examples expand on the simple examples, above, by activating specific actions. The following examples will reference actions with IDs that can be found under the **Actions** section of the Conditional. Two example action ID will be used: “qwer1234” and “uiop5678”. Additionally, `self.run_all_actions()` is used here, which will run all actions in the order in which they appear in the Actions section of the Conditional.

```

# Example 1
measurement = self.condition("{asdf1234}")
if measurement is None:
    self.run_action("{qwer1234}")
elif measurement > 23:
    self.run_action("{uiop5678}")
else:
    self.run_all_actions()

```



```

# Example 2, test two measurements
measure_1 = self.condition("{asdf1234}")
measure_2 = self.condition("{hjk15678}")
if None not in [measure_1, measure_2]:
    if measure_1 < 20 and measure_2 > 10:
        self.run_action("{qwer1234}")
        self.run_action("{uiop5678}")

# Example 3, test two measurements and sum of measurements
measure_1 = self.condition("{asdf1234}")
measure_2 = self.condition("{hjk15678}")
if None not in [measure_1, measure_2]:
    sum = measure_1 + measure_2
    if measure_1 > 2 and 10 < measure_2 < 23 and sum < 30.5:
        self.run_action("{qwer1234}")
    else:
        self.run_action("{uiop5678}")

# Example 4, combine into one conditional
measurement = self.condition("{asdf1234}")
if measurement != None and 20 < measurement < 30:
    self.run_action("{uiop5678}")

# Example 5, test two measurements and convert Edge Input from 0 or 1 to True or False
measure_1 = self.condition("{asdf1234}")
measure_2 = self.condition("{hjk15678}")
if None not in [measure_1, measure_2]:
    if bool(measure_1) and measure_2 > 10:
        self.run_all_actions()

# Example 6, test measurement with "or" and a rounded measurement
measure_1 = self.measure("{asdf1234}")
measure_2 = self.measure("{hjk15678}")
if None not in [measure_1, measure_2]:
    if measure_1 > 20 or int(round(measure_2)) in [20, 21, 22]:
        self.run_action("{qwer1234}")
    if measure_1 > 30:
        self.run_action("{uiop5678}")

```

If your action is a type that receives a message (E-Mail or Note), you can modify this message to include extra information before it is added to the Note or E-Mail. To do this, append a string to the variable `self.message` and add this to the message parameter of `self.run_action()` or `self.run_all_actions()`. Below are some examples. Note the use of “+=” instead of “=”, which appends the string to the variable `self.message`.

```

# Example 1
measurement = self.measure("{asdf1234}")
if measurement is None and measurement > 23:
    self.message += "Measurement was {}".format(measurement)
    self.run_action("{uiop5678}", message=self.message)

# Example 2
measure_1 = self.measure("{asdf1234}")
measure_2 = self.measure("{hjk15678}")
if None not in [measure_1, measure_2]:
    if measure_1 < 20 and measure_2 > 10:
        self.message += "Measurement 1: {m1}, Measurement 2: {m2}".format(m1=measure_1, m2=measure_2)
        self.run_all_actions(message=self.message)

```

Logging can also be used to log messages to the daemon log using `self.logger`:

```

# Example 1

```

```

measurement = self.measure("{asdf1234}")
if measurement is None and measurement > 23:
    self.logging.error("Warning, measurement was {}".format(measurement))
    self.message += "Measurement was {}".format(measurement)
    self.run_action("{uiop5678}", message=self.message)

```

Before activating any conditionals, it's advised to thoroughly explore all possible scenarios and plan a configuration that eliminates conflicts. Some devices or outputs may respond atypically or fail when switched on and off in rapid succession. Therefore, trial run your configuration before connecting devices to any outputs.

Trigger

A Trigger Controller will execute actions when events are triggered, such as an output turning on or off, a GPIO pin changing it's voltage state, or timed events, including various timers (duration, time period, time point, etc), or the sunrise or sunset time at a specific latitude and longitude. One the trigger is defined, add any number of Actions to be executed when that event is triggered.

Output (On/Off) Options

Monitor the state of an output.

Setting	Description
If Output	The Output to monitor for a change of state.
If State	If the state of the output changes to On or Off the conditional will trigger. If "On (any duration)" is selected, the trigger will occur no matter how long the output turns on for, whereas if only "On" is selected, the conditional will trigger only when the output turns on for a duration of time equal to the set "Duration (seconds)".
If Duration (seconds)	If "On" is selected, an optional duration (seconds) may be set that will trigger the conditional only if the Output is turned on for this specific duration.

Output (PWM) Options

Monitor the state of a PWM output.

Setting	Description
If Output	The Output to monitor for a change of state.
If State	If the duty cycle of the output is greater than, less than, or equal to the set value, trigger the Conditional Actions.
If Duty Cycle (%)	The duty cycle for the Output to be checked against.

Edge Options

Monitor the state of a pin for a rising and/or falling edge.

Setting	Description
If Edge Detected	The conditional will be triggered if a change in state is detected, either Rising when the state changes from LOW (0 volts) to HIGH (3.5 volts) or Falling when the state changes from HIGH (3.3 volts) to LOW (0 volts), or Both (Rising and Falling).

Run PWM Method Options

Select a Duration Method and this will set the selected PWM Output to the duty cycle specified by the method.

Setting	Description
Duration Method	Select which Method to use.
PWM Output	Select which PWM Output to use.
Period (seconds)	Select the interval of time to calculate the duty cycle, then apply to the PWM Output.
Trigger Every Period	Trigger Conditional Actions every period.
Trigger when Activated	Trigger Conditional Actions when the Conditional is activated.

Infrared Remote Input Options

Mycodo uses lirc to detect Infrared signals. Follow the lirc setup guide before using this feature.

Note: Raspbian Buster broke this feature. Work is in progress to restore functionality.

Setting	Description
Program	This is the variable 'program' in ~/.lircrc
Word	This is the variable 'config' in ~/.lircrc

Sunrise/Sunset Options

Trigger events at sunrise or sunset (or a time offset of those), based on latitude and longitude.

Setting	Description
Rise or Set	Select which to trigger the conditional, at sunrise or sunset.
Latitude (decimal)	Latitude of the sunrise/sunset, using decimal format.
Longitude (decimal)	Longitude of the sunrise/sunset, using decimal format.
Zenith	The Zenith angle of the sun.
Date Offset (days)	Set a sunrise/sunset offset in days (positive or negative).
Time Offset (minutes)	Set a sunrise/sunset offset in minutes (positive or negative).

Timer (Duration) Options

Run a timer that triggers Conditional Actions every period.

Setting	Description
Period (seconds)	The period of time between triggering Conditional Actions.
Start Offset (seconds)	Set this to start the first trigger a number of seconds after the Conditional is activated.

Timer (Daily Time Point) Options

Run a timer that triggers Conditional Actions at a specific time every day.

Setting	Description
Start Time (HH:MM)	Set the time to trigger Conditional Actions, in the format "HH:MM", with HH denoting hours, and MM denoting minutes. Time is in 24-hour format.

Timer (Daily Time Span) Options

Run a timer that triggers Conditional Actions at a specific period if it's between the set start and end times. For example, if the Start Time is set to 10:00 and End Time set to 11:00 and Period set to 120 seconds, the Conditional Actions will trigger every 120 seconds when the time is between 10 AM and 11 AM.

This may be useful, for instance, if you desire an Output to remain on during a particular time period and you want to prevent power outages from interrupting the cycle (which a simple Time Point Timer could not prevent against because it only triggers once at the Start Time). By setting an Output to turn the lights on every few minutes during the Start -> End period, it ensured the Output remains on during this period.

Setting	Description
Start Time (HH:MM)	Set the start time to trigger Conditional Actions, in the format "HH:MM", with HH denoting hours, and MM denoting minutes. Time is in 24-hour format.
End Time (HH:MM)	Set the end time to trigger Conditional Actions, in the format "HH:MM", with HH denoting hours, and MM denoting minutes. Time is in 24-hour format.
Period (seconds)	The period of time between triggering Conditional Actions.

Function Actions

These are the actions that can be added to Function controllers (i.e. Conditional, Trigger).

Setting	Description
Actions: Pause	Pause executing actions for a duration of time (seconds).
Camera: Capture Photo	Capture a photo with the selected camera.
Create Note	Create a note containing the conditional statement and actions, using a particular tag.
Controller: Activate	Activate a particular controller.
Controller: Deactivate	Deactivate a particular controller.
E-Mail	Send an email containing the conditional statement and actions.
E-Mail with Photo Attachment	Send an email containing the conditional statement, actions, and captured photo.
E-Mail with Video Attachment	Send an email containing the conditional statement, actions, and captured video.
Execute Command	Execute a command in the linux shell (as user 'root').
Infrared Remote Send	Send an infrared signal. See Infrared Remote for details.
LCD: Backlight	Turn the LCD backlight on or off. Note: Only some LCDs are supported.
LCD: Flash	Start or stop the LCD flashing to indicate an alert. Note: Only some LCDs are supported.
Output: Duration	Turn an output on, off, or on for a duration of time.
Output: Duty Cycle	Turn a PWM output off or on for a duty cycle.
PID: Pause	Pause a particular PID controller.
PID: Hold	Hold a particular PID controller.
PID: Resume	Resume a particular PID controller.
PID: Set Method	Set the Method of a particular PID controller.
PID: Set Setpoint	Set the Setpoint of a particular PID controller.
System: Restart	Restart the System.
System: Shutdown	Shutdown the System.

Methods

Setup -> Method

Methods enable Setpoint Tracking in PIDs and time-based duty cycle changes in timers. Normally, a PID controller will regulate an environmental condition to a specific setpoint. If you would like the setpoint to change over time, this is called setpoint tracking. Setpoint Tracking is useful for applications such as reflow ovens, thermal cyclers (DNA replication), mimicking natural daily cycles, and more. Methods may also be used to change a duty cycle over time when used with a Run PWM Method Conditional.

Method Options

These options are shared with several method types.

Setting	Description
Start Time/Date	This is the start time of a range of time.
End Time/Date	This is the end time of a range of time.
Start Setpoint	This is the start setpoint of a range of setpoints.
End Setpoint	This is the end setpoint of a range of setpoints.

Time/Date Method

A time/date method allows a specific time/date span to dictate the setpoint. This is useful for long-running methods, that may take place over the period of days, weeks, or months.

Duration Method

A Duration Method allows a ***Setpoint*** (for PIDs) or ***Duty Cycle*** (for Conditional) to be set after specific durations of time. Each new duration added will stack, meaning it will come after the previous duration, meaning a newly-added ***Start Setpoint*** will begin after the previous entry's ***End Setpoint***.

If the "Repeat Method" option is used, this will cause the method to repeat once it has reached the end. If this option is used, no more durations may be added to the method. If the repeat option is deleted then more durations may be added. For instance, if your method is 200 seconds total, if the Repeat Duration is set to 600 seconds, the method will repeat 3 times and then automatically turn off the PID or Conditional.

Daily (Time-Based) Method

The daily time-based method is similar to the time/date method, however it will repeat every day. Therefore, it is essential that only the span of one day be set in this method. Begin with the start time at 00:00:00 and end at 23:59:59 (or 00:00:00, which would be 24 hours from the start). The start time must be equal or greater than the previous end time.

Daily (Sine Wave) Method

The daily sine wave method defines the setpoint over the day based on a sinusoidal wave. The sine wave is defined by $y = [A * \sin(B * x + C)] + D$, where A is amplitude, B is frequency, C is the angle shift, and D is the y-axis shift. This method will repeat daily.

Daily (Bezier Curve) Method

A daily Bezier curve method define the setpoint over the day based on a cubic Bezier curve. If unfamiliar with a Bezier curve, it is recommended you use the graphical Bezier curve generator and use the 8 variables it creates for 4 points (each a set of x and y). The x-axis start (x3) and end (x0) will be automatically stretched or skewed to fit within a 24-hour period and this method will repeat daily.

LCDs

Setup -> LCD

Data may be output to a liquid crystal display (LCD) for easy viewing. Please see LCD Displays for specific information regarding compatibility.

There may be multiple displays created for each LCD. If there is only one display created for the LCD, it will refresh at the set period. If there is more than one display, it will cycle from one display to the next every set period.

Setting	Description
Reset Flashing	If the LCD is flashing to alert you because it was instructed to do so by a triggered Conditional Statement, use this button to stop the flashing.
Type	Select either a 16x2 or 20x4 character LCD display.
I2C Address	Select the I2C to communicate with the LCD.
Period	This is the period of time (in seconds) between redrawing the LCD with new data or switching to the next set of displays (if multiple displays are used).
Add Display Set	Add a set of display lines to the LCD.
Display Line #	Select which measurement to display on each line of the LCD.
Max Age (seconds)	The maximum age the measurement is allowed to be. If no measurement was acquired in this time frame, the display will indicate "NO DATA".

Alerts

Alerts can be used to notify users about the state of the system. For things like sensor monitoring, this could be a threshold that indicates something needs attention. E-Mail notifications are built-in to Mycodo in a number of places, however there are several places (Inputs, Outputs, Controllers) that allow custom Python code to be used, enabling many other notification options to be built.

See Alert Settings for more information about setting up Alerts.

Notes

More -> Notes

Notes may be created that can then be displayed on graphs or referenced at a later time. All notes are timestamped with the date/time of creation or may be created with a custom date/time. Each note must have at least one tag selected. Tags are what are selected to be displayed on a graph and all notes with that tag will appear in the time frame selected on the graph.

Tag Options

Setting	Description
Name	A name for the tag. Must not contain spaces.
Rename	Rename the tag.

Note Options

Setting	Description
Name	A name for the note.
Use Custom Date/Time	Check to enter a custom date/time for the note.

Setting	Description
Custom Date/Time	Store the note with this custom date/time.
Attached Files	Attach one or more files to the note.
Tags	Associate the note with at least one tag.
Note	The text body of the note. The text will appear monospaced, so code will format properly.

Export-Import

More -> Export Import

Measurements that fall within the selected date/time frame may be exported as CSV with their corresponding timestamps.

Additionally, the entire measurement database (influxdb) may be exported as a ZIP archive backup. This ZIP may be imported back in any Mycodo system to restore these measurements. Note that an import will override the current data (i.e. destroying it).

Mycodo settings may be exported as a ZIP file containing the Mycodo settings database (sqlite). This ZIP file may be used to restore the settings database to another Mycodo install, as long as the Mycodo version and database versions are the same. Future support for installing older (or newer) databases and performing an automatic upgrade/downgrade is in the works.

Dependencies

[Gear Icon] -> Dependencies

The dependency page allows viewing of dependency information and the ability to initiate their installation.

Camera

More -> Camera

Cameras can be used to capture still images, create time-lapses, and stream video. Cameras may also be used by Functions to trigger a camera image or video capture (as well as the ability to email the image/video with a notification).

Cameras can be accessed by the following libraries: picamera (Raspberry Pi Camera), fswebcam, opencv, urllib, and requests.

This enables images to be acquired from the Raspberry Pi camera, USB cameras and webcams, and IP cameras that are accessible by a URL. Furthermore, using the urllib and request libraries, any image URL can be used to acquire images.

Energy Usage

More -> Energy Usage

There are two methods for calculating energy usage. The first relies on determining how long Outputs have been on. Based on this, if the number of Amps the output draws has been set in the output Settings, then the kWh and cost can be calculated. Discovering the number of amps the device draws can be accomplished by calculating this from the output typically given as watts on the device label, or with the use of a current clamp while the device is operating. The limitation of this method is PWM Outputs are not currently used to calculate these figures due to the difficulty determining the current consumption of devices driven by PWM signals.

The second method for calculating energy consumption is more accurate and is the recommended method if you desire the most accurate estimation of energy consumption and cost. This method relies on an Input or Math measuring Amps. One way to do this is with the use of an analog-to-digital converter (ADC) that converts the voltage output from a transformer into current (Amps). One wire from the AC line that powers your device(s) passes thorough the transformer and the device converts the current that passes through that wire into a voltage that corresponds to the amperage. For instance, the below sensor converts 0 -50 amps input to 0 - 5 volts output. An ADC receives this output as its input. One would set this conversion range in Mycodo and the calculated amperage will be stored. On the Energy Usage page, add this ADC Input

measurement and a report summary will be generated. Keep in mind that for a particular period (for example, the past week) to be accurate, there needs to be a constant measurement of amps at a periodic rate. The faster the rate the more accurate the calculation will be. This is due to the amperage measurements being averaged for this period prior to calculating kWh and cost. If there is any time turing this period where amp measurements aren't being acquired when in fact there are devices consuming current, the calculation is likely to not be accurate.



Greystone CS-650-50 AC Solid Core Current Sensor (Transformer)

The following settings are for calculating energy usage from an amp measurement. For calculating based on Output duration, see Energy Usage Settings.

Setting	Description
Select Amp Measurement	This is a measurement with the amp (A) units that will be used to calculate energy usage.

System Information

[Gear Icon] -> System Information

This page serves to provide information about the Mycodo frontend and backend as well as the linux system it's running on. Several commands and their output are listed to give the user information about how their system is running.

Command	Description
Mycodo Version	The current version of Mycodo, reported by the configuration file.
Python Version	The version of python currently running the web user interface.
Database Version	The current version of the settings database. If the current version is different from what it should be, an error will appear indicating the issue and a link to find out more information about the issue.
Daemon Status	This will be a green "Running" or a red "Stopped". Additionally, the Mycodo version and hostname text at the top-left of the screen May be Green, Yellow, or Red to indicate the status. Green = daemon running, yellow = unable to connect, and red = daemon not running.

Command	Description
...	Several other status indicators and commands are listed to provide information about the health of the system. Use these in addition to others to investigate software or hardware issues.

Mycodo Client

```
pi@raspberrypi:~ $ mycodo-client --help
usage: mycodo-client [-h] [--activatecontroller CONTROLLER ID]
                    [--deactivatecontroller CONTROLLER ID] [--pid_pause ID]
                    [--pid_hold ID] [--pid_resume ID] [--pid_get_setpoint ID]
                    [--pid_get_error ID] [--pid_get_integrator ID]
                    [--pid_get_derivator ID] [--pid_get_kp ID]
                    [--pid_get_ki ID] [--pid_get_kd ID]
                    [--pid_set_setpoint ID SETPOINT]
                    [--pid_set_integrator ID INTEGRATOR]
                    [--pid_set_derivator ID DERIVATOR] [--pid_set_kp ID KP]
                    [--pid_set_ki ID KI] [--pid_set_kd ID KD] [-c] [--ramuse]
                    [--input_force_measurements INPUTID]
                    [--lcd_backlight_on LCDID] [--lcd_backlight_off LCDID]
                    [--lcd_reset LCDID] [--output_state OUTPUTID]
                    [--output_currently_on OUTPUTID] [--outputoff OUTPUTID]
                    [--outputon OUTPUTID] [--duration SECONDS]
                    [--dutycycle DUTYCYCLE] [--trigger_action ACTIONID]
                    [--trigger_all_actions FUNCTIONID] [-t]
```

Client for Mycodo daemon.

optional arguments:

```
-h, --help            show this help message and exit
--activatecontroller CONTROLLER ID
                    Activate controller. Options: Conditional, LCD, Math,
                    PID, Input
--deactivatecontroller CONTROLLER ID
                    Deactivate controller. Options: Conditional, LCD,
                    Math, PID, Input
--pid_pause ID        Pause PID controller.
--pid_hold ID         Hold PID controller.
--pid_resume ID       Resume PID controller.
--pid_get_setpoint ID
                    Get the setpoint value of the PID controller.
--pid_get_error ID    Get the error value of the PID controller.
--pid_get_integrator ID
                    Get the integrator value of the PID controller.
--pid_get_derivator ID
                    Get the derivator value of the PID controller.
--pid_get_kp ID       Get the Kp gain of the PID controller.
--pid_get_ki ID       Get the Ki gain of the PID controller.
--pid_get_kd ID       Get the Kd gain of the PID controller.
--pid_set_setpoint ID SETPOINT
                    Set the setpoint value of the PID controller.
--pid_set_integrator ID INTEGRATOR
                    Set the integrator value of the PID controller.
--pid_set_derivator ID DERIVATOR
                    Set the derivator value of the PID controller.
--pid_set_kp ID KP    Set the Kp gain of the PID controller.
--pid_set_ki ID KI    Set the Ki gain of the PID controller.
```

```

--pid_set_kd ID KD      Set the Kd gain of the PID controller.
-c, --checkdaemon      Check if all active daemon controllers are running
--ramuse               Return the amount of ram used by the Mycodo daemon
--input_force_measurements INPUTID
                        Force acquiring measurements for Input ID
--lcd_backlight_on LCDID
                        Turn on LCD backlight with LCD ID
--lcd_backlight_off LCDID
                        Turn off LCD backlight with LCD ID
--lcd_reset LCDID      Reset LCD with LCD ID
--output_state OUTPUTID
                        State of output with output ID
--output_currently_on OUTPUTID
                        How many seconds an output has currently been active
                        for
--outputoff OUTPUTID   Turn off output with output ID
--outputon OUTPUTID    Turn on output with output ID
--duration SECONDS     Turn on output for a duration of time (seconds)
--dutyicycle DUTYCYCLE
                        Turn on PWM output for a duty cycle (%)
--trigger_action ACTIONID
                        Trigger action with Action ID
--trigger_all_actions FUNCTIONID
                        Trigger all actions belonging to Function with ID
-t, --terminate        Terminate the daemon

```

Infrared Remote

NOTE: This functionality may or may not work. Since Raspbian upgraded to Buster, I have not been able to get it to work. I will try to restore functionality.

Note 1: As of 4/8/2019, the Raspberry Pi kernel no longer supports `lirc-rpi` as an overlay in `/boot/config.txt` (use `gpio-ir`, details below). To ensure the below instructions work, make sure you are using the latest kernel by running `sudo rpi-update`

Note 2: Currently only receiving IR commands is working. IR sending is not working. When I get time to test and develop an implementation of this feature that both sends and receives IR signals, I will remove this note.

Infrared (IR) light is a common way to send and receive signals across distances. This is typically done with IR remotes with several buttons configured to send different signals. These signals can be detected by the Raspberry Pi with the use of an IR receiver diode and used to perform actions within the linux environment and Mycodo. This is done with `lirc`, and needs to be properly configured before IR signals can be detected and interpreted.

The IR receiver typically has three connections, power (3.3 volts), ground, and data (GPIO pin), and should be connected to the appropriate pins of your Raspberry Pi. Make sure your IR receiver can operate at 3.3 volts, which is the appropriate voltage GPIOs operate at. For testing, I used the Sparkfun Infrared Control Kit, which has an Information Guide, however there are cheaper alternatives.

Adding an Infrared Output device or an Infrared Send function action will automatically install the dependencies, otherwise it can be done manually:

```
sudo apt install liblircclient-dev lirc
```

```
~/Mycodo/env/bin/pip install python-lirc py-irsend
```

Edit `/boot/config.txt` and add to the end of the file, replacing “17” with the GPIO (BCM numbering) connected to your IR LED and “18” with the GPIO connected to the IR receiver. You can omit either of these options if you aren’t using either the IR receiver or transmitting LED:

```
dtoverlay=gpio-ir,gpio_pin=18 dtoverlay=gpio-ir-tx,gpio_pin=17
```

Edit `/etc/lirc/lirc_options.conf` and ensure the following settings are set:

```
driver = default
device = /dev/lirc1
```

Restart your system:

```
sudo shutdown now -r
```

Check this remote database for your remote, and if it's found, place it in `/etc/lirc/lircd.conf.d/`, otherwise you will need to generate a config file for your remote.

To generate a config file for your remote, lirc must first be stopped:

```
sudo service lircd stop
```

Then, issue the following command:

```
sudo irrecord -n -d /dev/lirc1
```

You will be prompted with a very specific set of instructions in order to map your remote. If you successfully finish the config generation, you will have a `*.lirc.conf` file that you should place in `/etc/lirc/lircd.conf.d/`

If `irrecord` is unable to parse the remote code (due to complexity or other issue), you can still use the raw data to create a config file. To obtain the raw code data, run the following command, and press a button on the remote once.

```
mode2 -m
```

You should see output similar to the following, with data represented in 6 columns.

```
pi@rapsberry:~ $ mode2 -m
Using driver default on device /dev/lirc0
Trying device: /dev/lirc0
Using device: /dev/lirc0
16777215

    3431    1747    444    1313    441    1312
    444     471    441     474    440     474
    440    1315    439     476    438     480
    444    1312    442    1313    441     475
    438    1317    439     476    437     477
```

Use the 6-column data to generate your config file, with the following as an example `example_remote.lircd.conf`, that should be placed in `/etc/lirc/lircd.conf.d/`.

```
begin remote
  name example_remote
  flags RAW_CODES
  eps      30
  aeps     100

  ptrail   0
  repeat   0 0
  gap      107902

  begin raw_codes
    name KEY_POWER
      3431    1747    444    1313    441    1312
      444     471    441     474    440     474
      440    1315    439     476    438     480
      444    1312    442    1313    441     475
      438    1317    439     476    437     477
    end raw_codes
  end remote
```

Start lirc back up to load all the remote config files:

```
sudo service lirc start
```

Now, start `irw` and press a button on your remote. If everything works, you should see information appear when you press each button, such as below:

```
pi@raspberrypi:~ $ irw
0000000000ff629d 00 KEY_POWER simple_remote
0000000000ff22dd 01 KEY_A simple_remote
0000000000ff02fd 01 KEY_B simple_remote
0000000000ffc23d 00 KEY_C simple_remote
0000000000ff9867 00 KEY_UP simple_remote
0000000000ff38c7 00 KEY_DOWN simple_remote
0000000000ff30cf 01 KEY_LEFT simple_remote
0000000000ff7a85 00 KEY_RIGHT simple_remote
0000000000ff18e7 01 KEY_SELECT simple_remote
```

Now that we have the remote detected and mapped, we can set commands to be executed or what word is returned to Mycodo. Create a file `~/.lirc`:

```
nano ~/.lircrc
```

and configure the responses to button presses

```
begin
    button = KEY_POWER
    prog = mycodo
    config = power
    repeat = 0
end
begin
    button = KEY_A
    prog = mycodo
    config = a
    repeat = 0
end
```

To test this with Python, create the test program `infrared_receive.py`:

```
import lirc
import time

sockid = lirc.init("mycodo", blocking=False)
while True:
    code = lirc.nextcode()
    if code:
        print(code[0])
        time.sleep(0.05)
```

Execute this using the Mycodo virtualenv:

```
~/Mycodo/env/bin/python infrared_receive.py
```

And press the buttons defined in `~/.lirc` and see if the output appears on the console:

```
pi@raspberrypi:~ $ ~/Mycodo/env/bin/python ./test_IR.py
power
a
```

From here, you can create any Python code to react to button presses on your remote. You can also set up the Mycodo Function Trigger: Infrared Remote Input and trigger events in response to Mycodo detecting specific button presses. See Infrared Remote Input Options for configuring this trigger.

In order to send an IR signal to your IR LED, connect your LED to the GPIO defined with `gpio_out_pin=17` in `/boot/config.txt`. You can test if your LED is working by creating a file, `LED_blink.py`, replacing 17 with the pin connected to your LED:

```
import RPi.GPIO as GPIO
import time
```

```
pin = 17
GPIO.setwarnings(False)
GPIO.setmode(GPIO.BCM)
GPIO.setup(pin, GPIO.OUT, initial=GPIO.LOW)

while True:
    GPIO.output(pin, GPIO.HIGH)
    time.sleep(1)
    GPIO.output(pin, GPIO.LOW)
    time.sleep(1)
```

Since IR LEDs produce a wavelength of light that humans can't see, you'll need to aim a video camera that lacks an infrared filter and see if the LED is blinking.

If your LED is working, then issue the following command, replacing `simple_remote` with the name of your remote defined in your config file:

```
irsend SEND_ONCE simple_remote KEY_POWER
```

You can verify this is working by running `infrared_receive.py`, then executing the `irsend` command while it's still running, and you should see it print the button command that was sent.

IR codes can be sent from Mycodo using the Infrared Remote Send Function Action. The `Remote` option should to match the remote name in the config file in `/etc/lirc/lircd.conf.d/` and the `Code` option should match a code that's in `/home/pi/.lircrc`. If `Times to Send` is set larger than 1, the code will be sent multiple times at intervals of 0.5 seconds.

Translations

Mycodo has been translated to several languages. By default, the language of the browser will determine which language is used, but may be overridden in the General Settings, at `[Gear Icon] -> Configure -> General`. If you find an issue with a translation or would like to add another language, see the Translations section of the Wiki and consider making a Pull Request or Creating an Issue.

Configuration Settings

`[Gear Icon] -> Configure`

The settings menu, accessed by selecting the gear icon in the top-right, then the Configure link, is a general area for various system-wide configuration options.

General Settings

`[Gear Icon] -> Configure -> General`

Setting	Description
Language	Set the language that will be displayed in the web user interface.
Force HTTPS	Require web browsers to use SSL/HTTPS. Any request to <code>http://</code> will be redirected to <code>https://</code> .
Hide success alerts	Hide all success alert boxes that appear at the top of the page.
Hide info alerts	Hide all info alert boxes that appear at the top of the page.
Hide warning alerts	Hide all warning alert boxes that appear at the top of the page.
Opt-out of statistics	Turn off sending anonymous usage statistics. Please consider that this helps the development to leave on.
Check for Updates	Automatically check for updates every 2 days and notify through the web interface. If there is a new update, the Configure (Gear Icon) as well as the Upgrade menu will turn the color red.

Energy Usage Settings

[Gear Icon] -> Configure -> General

In order to calculate accurate energy usage statistics, a few characteristics of your electrical system needs to be know. These variables should describe the characteristics of the electrical system being used by the relays to operate electrical devices. Note: Proper energy usage calculations also rely on the correct current draw to be set for each output (see Output Settings).

Setting	Description
Max Amps	Set the maximum allowed amperage to be switched on at any given time. If a output that's instructed to turn on will cause the sum of active devices to exceed this amount, the output will not be allowed to turn on, to prevent any damage that may result from exceeding current limits.
Voltage	Alternating current (AC) voltage that is switched by the outputs. This is usually 120 or 240.
Cost per kWh	This is how much you pay per kWh.
Currency Unit	This is the unit used for the currency that pays for electricity.
Day of Month	This is the day of the month (1-30) that the electricity meter is read (which will correspond to the electrical bill).
Generate Usage/Cost Report	These options define when an Energy Usage Report will be generated. Currently these Only support the Output Duration calculation method. For more information about the methods, see Energy Usage.

Input Settings

[Gear Icon] -> Configure -> Inputs

Input modules may be imported and used within Mycodo. These modules must follow a specific format. See Custom Inputs for more details.

Setting	Description
Import Input Module	Select your input module file, then click this button to begin the import.

Output Settings

[Gear Icon] -> Configure -> Outputs

Output modules may be imported and used within Mycodo. These modules must follow a specific format. See Custom Outputs for more details.

Setting	Description
Import Output Module	Select your output module file, then click this button to begin the import.

Measurement Settings

[Gear Icon] -> Configure -> Measurements

New measurements, units, and conversions can be created that can extend functionality of Mycodo beyond the built-in types and equations. Be sure to create units before measurements, as units need to be selected when creating a measurement. A measurement can be created that already exists, allowing additional units to be added to a pre-existing measurement. For example, the measurement 'altitude' already exists, however if you wanted to add the unit 'fathom', first create the unit 'fathom', then create the measurement 'altitude' with the 'fathom' unit selected. It is okay to create a custom measurement for a measurement that already exist (this is how new units for a currently-installed measurement is added).

Setting	Description
Measurement ID	ID for the measurement to use in the measurements_dict of input modules (e.g. “length”, “width”, “speed”).
Measurement Name	Common name for the measurement (e.g. “Length”, “Weight”, “Speed”).
Measurement Units	Select all the units that are associated with the measurement.
Unit ID	ID for the unit to use in the measurements_dict of input modules (e.g. “K”, “g”, “m”).
Unit Name	Common name for the unit (e.g. “Kilogram”, “Meter”).
Unit Abbreviation	Abbreviation for the unit (e.g. “kg”, “m”).
Convert From Unit	The unit that will be converted from.
Convert To Unit	The unit that will be converted to.
Equation	The equation used to convert one unit to another. The lowercase letter “x” must be included in the equation (e.g. “x/1000+20”, “250*(x/3)”). This “x” will be replaced with the actual measurement being converted.

Users

[Gear Icon] -> Configure -> Users

Mycodo requires at least one Admin user for the login system to be enabled. If there isn’t an Admin user, the web server will redirect to an Admin Creation Form. This is the first page you see when starting Mycodo for the first time. After an Admin user has been created, additional users may be created from the User Settings page.

Setting	Description
Username	Choose a user name that is between 2 and 64 characters. The user name is case insensitive (all user names are converted to lower-case).
Email	The email associated with the new account.
Password/Repeat	Choose a password that is between 6 and 64 characters and only contains letters, numbers, and symbols.
Role	Roles are a way of imposing access restrictions on users, to either allow or deny actions. See the table below for explanations of the four default Roles.
Theme	The web user interface theme to apply, including colors, themes, and other design elements.

User Roles

Roles define the permissions of each user. There are 4 default roles that determine if a user can view or edit particular areas of Mycodo. Four roles are provided by default, but custom roles may be created.

Role	Admin	Editor	Monitor	Guest
Edit Users	X			
Edit Controllers	X	X		
Edit Settings	X	X		
View Settings	X	X	X	
View Camera	X	X	X	
View Stats	X	X	X	
View Logs	X	X	X	

The **Edit Controllers** permission protects the editing of Conditionals, Graphs, LCDs, Methods, PIDs, Outputs, and Inputs.

The **View Stats** permission protects the viewing of usage statistics and the System Information and Energy Usage pages.

Pi Settings

[Gear Icon] -> Configure -> Raspberry Pi

Pi settings configure parts of the linux system that Mycodo runs on.

pigpiod is required if you wish to use PWM Outputs, as well as PWM, RPM, DHT22, DHT11, HTU21D Inputs.

Setting	Description
Enable/Disable Feature	These are system interfaces that can be enabled and disabled from the web UI via the <code>raspi-config</code> command.
pigpiod Sample Rate	This is the sample rate the pigpiod service will operate at. The lower number enables faster PWM frequencies, but may significantly increase processor load on the Pi Zeros. pigpiod may also be disabled completely if it's not required (see note, above).

Alert Settings

[Gear Icon] -> Configure -> Alerts

Alert settings set up the credentials for sending email notifications.

Setting	Description
SMTP Host	The SMTP server to use to send emails from.
SMTP Port	Port to communicate with the SMTP server (465 for SSL, 587 for TLS).
Enable SSL	Check to enable SSL, uncheck to enable TLS.
SMTP User	The user name to send the email from. This can be just a name or the entire email address.
SMTP Password	The password for the user.
From Email	What the from email address be set as. This should be the actual email address for this user.
Max emails (per hour)	Set the maximum number of emails that can be sent per hour. If more notifications are triggered within the hour and this number has been reached, the notifications will be discarded.
Send Test Email	Test the email configuration by sending a test email.

Camera Settings

[Gear Icon] -> Configure -> Camera

Many cameras can be used simultaneously with Mycodo. Each camera needs to be set up in the camera settings, then may be used throughout the software. Note that not every option (such as Hue or White Balance) may be able to be used with your particular camera, due to manufacturer differences in hardware and software.

Setting	Description
Type	Select whether the camera is a Raspberry Pi Camera or a USB camera.
Library	Select which library to use to communicate with the camera. The Raspberry Pi Camera uses picamera, and USB cameras should be set to fswebcam.
Device	The device to use to connect to the camera. fswebcam is the only library that uses this option.
Output	This output will turn on during the capture of any still image (which includes timelapses).
Output Duration	Turn output on for this duration of time before the image is captured.
Rotate Image	The number of degrees to rotate the image.

Setting	Description
...	Image Width, Image Height, Brightness, Contrast, Exposure, Gain, Hue, Saturation, White Balance. These options are self-explanatory. Not all options will work with all cameras.
Pre Command	A command to execute (as user 'root') before a still image is captured.
Post Command	A command to execute (as user 'root') after a still image is captured.
Flip horizontally	Flip, or mirror, the image horizontally.
Flip vertically	Flip, or mirror, the image vertically.

Diagnostic Settings

[Gear Icon] -> Configure -> Diagnostics

Sometimes issues arise in the system as a result of incompatible configurations, either the result of a misconfigured part of the system (Input, Output, etc.) or an update that didn't properly handle a database upgrade, or other unforeseen issue. Sometimes it is necessary to perform diagnostic actions that can determine the cause of the issue or fix the issue itself. The options below are meant to alleviate issues, such as a misconfigured dashboard element causing an error on the **Data -> Dashboard** page, which may cause an inability to access the **Data -> Dashboard** page to correct the issue. Deleting all Dashboard Elements may be the most economical method to enable access to the **Data -> Dashboard** page again, at the cost of having to readd all the Dashboard Elements that were once there.

Setting	Description
Delete All Dashboard Elements	Delete all saved Dashboard Elements from the Dashboard.
Delete All Notes and Note Tags	Delete all notes and note tags.

Troubleshooting

Daemon Not Running

- Check the Logs: From the [Gear Icon] -> Mycodo Logs page, check the Daemon Log for any errors. If the issue began after an upgrade, also check the Upgrade Log for indications of an issue.
- Determine if the Daemon is Running: Execute `ps aux | grep '/var/mycodo-root/env/bin/python /var/mycodo-root/myco` in a terminal and look for an entry to be returned. If nothing is returned, the daemon is not running.
- Daemon Lock File: If the daemon is not running, make sure the daemon lock file is deleted at `/var/lock/mycodo.pid`. The daemon cannot start if the lock file is present.
- If a solution could not be found after investigating the above suggestions, submit a New Mycodo Issue on github.

Incorrect Database Version

- Check the [Gear Icon] -> System Information page or select the mycodo logo in the top-left.
- An incorrect database version error means the version stored in the Mycodo settings database (`~/Mycodo/databases/mycodo.db`) is not correct for the latest version of Mycodo, determined in the Mycodo config file (`~/Mycodo/mycodo/config.py`).
- This can be caused by an error in the upgrade process from an older database version to a newer version, or from a database that did not upgrade during the Mycodo upgrade process.
- Check the Upgrade Log for any issues that may have occurred. The log is located at `/var/log/mycodo/mycodoupgrade.log` but may also be accessed from the web UI (if you're able to): select [Gear Icon] -> Mycodo Logs -> Upgrade Log.
- Sometimes issues may not immediately present themselves. It is not uncommon to be experiencing a database issue that was actually introduced several Mycodo versions ago, before the latest upgrade.
- Because of the nature of how many versions the database can be in, correcting a database issue may be very difficult. It may be much easier to delete your database and let Mycodo generate a new one.
- Use the following commands to rename your database and restart the web UI. If both commands are successful, refresh your web UI page in your browser in order to generate a new database and create a new Admin user.

```
mv ~/Mycodo/databases/mycodo.db ~/Mycodo/databases/mycodo.db.backup
sudo service mycodoflask restart
```

More

Check out the [Diagnosing Mycodo Issues Wiki Page](#) on github for more information about diagnosing issues.

Devices

Input Devices

Supported Input devices are listed below.

Built-In Inputs (System-Specific)

Linux: Bash Command

Measurements: Return Value

This Input will execute a command in the shell and store the output as a float value. Perform any unit conversions within your script or command. A measurement/unit is required to be selected.

Linux: Python 3 Code

Measurements: Store Value(s)

Mycodo: MQTT Protocol (paho)

Measurements: Variable measurements

Dependencies: paho-mqtt

Mycodo: Mycodo RAM

Measurements: Size RAM in Use

Mycodo: Mycodo Version

Measurements: Version as Major.Minor.Revision

Mycodo: TTN Integration: Data Storage

Measurements: Variable measurements

Dependencies: requests

This Input receives and stores measurements from the Data Storage Integration on The Things Network.

Raspberry Pi: CPU/GPU Temperature

Measurements: Temperature

Dependencies: subprocess

The internal CPU and GPU temperature of the Raspberry Pi.

Raspberry Pi: Edge

Measurements: Rising/Falling Edge

Dependencies: RPi.GPIO

Raspberry Pi: GPIO State

Measurements: GPIO State

Dependencies: RPi.GPIO

Raspberry Pi: Signal (PWM)

Measurements: Frequency/Pulse Width/Duty Cycle

Dependencies: pigpio

Raspberry Pi: Signal (Revolutions)

Measurements: RPM

Dependencies: pigpio

System: CPU Load

Measurements: CPULoad

System: Free Space

Measurements: Unallocated Disk Space

System: Server Ping

Measurements: Boolean

This Input executes the bash command “ping -c [times] -w [deadline] [host]” to determine if the host can be pinged.

System: Server Port Open

Measurements: Boolean

This Input executes the bash command “nc -zv [host] [port]” to determine if the host at a particular port is accessible.

Built-In Inputs (Sensors)

AMS: AS7262

Measurements: Light at 450, 500, 550, 570, 600, 650 nm

Dependencies: as7262

Manufacturer URL: [Link](#)

Datasheet URL: [Link](#)

Product URL: [Link](#)

AMS: CCS811

Measurements: CO2/VOC/Temperature

Dependencies: Adafruit_CCS811, Adafruit_GPIO

Manufacturer URL: [Link](#)

Datasheet URL: [Link](#)

Product URLs: [Link 1](#), [Link 2](#)

AMS: TSL2561

Measurements: Light

Dependencies: Adafruit_GPIO, Adafruit_PureIO, tsl2561

Manufacturer URL: [Link](#)

Datasheet URL: [Link](#)

Product URL: [Link](#)

AMS: TSL2591

Measurements: Light
Dependencies: tsl2591
Manufacturer URL: [Link](#)
Datasheet URL: [Link](#)
Product URL: [Link](#)

AOSONG: AM2315/AM2320

Measurements: Humidity/Temperature
Dependencies: quick2wire-api
Datasheet URL: [Link](#)
Product URL: [Link](#)

AOSONG: DHT11

Measurements: Humidity/Temperature
Dependencies: pigpio
Datasheet URL: [Link](#)
Product URL: [Link](#)

AOSONG: DHT22

Measurements: Humidity/Temperature
Dependencies: pigpio
Datasheet URL: [Link](#)
Product URL: [Link](#)

Analog Devices: ADT7410

Measurements: Temperature
Dependencies: Adafruit_CircuitPython_ADT7410, Adafruit_Extended_Bus
Datasheet URL: [Link](#)
Product URL: [Link](#)

Analog Devices: ADXL34x (343, 344, 345, 346)

Measurements: Acceleration
Dependencies: Adafruit_CircuitPython_ADXL34x, Adafruit_Extended_Bus
Datasheet URLs: [Link 1](#), [Link 2](#), [Link 3](#), [Link 4](#)
Product URLs: [Link 1](#), [Link 2](#), [Link 3](#), [Link 4](#)

Atlas Scientific: Atlas Color

Measurements: RGB, CIE, LUX, Proximity
Dependencies: pylibftdi
Manufacturer URL: [Link](#)
Datasheet URL: [Link](#)

Atlas Scientific: Atlas DO

Measurements: Dissolved Oxygen
Dependencies: pylibftdi
Manufacturer URL: [Link](#)
Datasheet URL: [Link](#)

Atlas Scientific: Atlas EC

Measurements: Electrical Conductivity
Dependencies: pylibftdi
Manufacturer URL: [Link](#)
Datasheet URL: [Link](#)

Atlas Scientific: Atlas Flow Meter

Measurements: Total Volume, Flow Rate
Dependencies: pylibftdi
Manufacturer URL: [Link](#)
Datasheet URL: [Link](#)

Set the Measurement Time Base to a value most appropriate for your anticipated flow (it will affect accuracy). This flow rate time base that is set and returned from the sensor will be converted to liters per minute, which is the default unit for this input module. If you desire a different rate to be stored in the database (such as liters per second or hour), then use the Convert to Unit option.

Atlas Scientific: Atlas ORP

Measurements: Oxidation Reduction Potential
Dependencies: pylibftdi
Manufacturer URL: [Link](#)
Datasheet URL: [Link](#)

Atlas Scientific: Atlas PT-1000

Measurements: Temperature
Dependencies: pylibftdi
Manufacturer URL: [Link](#)
Datasheet URL: [Link](#)

Atlas Scientific: Atlas Pressure

Measurements: Pressure
Dependencies: pylibftdi
Manufacturer URL: [Link](#)
Datasheet URL: [Link](#)

Atlas Scientific: Atlas pH

Measurements: Ion Concentration
Dependencies: pylibftdi
Manufacturer URL: [Link](#)
Datasheet URL: [Link](#)

Calibration Measurement is an optional setting that provides a temperature measurement (in Celsius) of the water that the pH is being measured from.

BOSCH: BME280

Measurements: Pressure/Humidity/Temperature
Dependencies: Input Variant 1: Adafruit_GPIO, Adafruit_BME280; Input Variant 2: RPi.bme280
Manufacturer URL: [Link](#)
Datasheet URL: [Link](#)
Product URLs: [Link 1](#), [Link 2](#)

BOSCH: BME680

Measurements: Temperature/Humidity/Pressure/Gas
Dependencies: bme680, smbus2
Manufacturer URL: [Link](#)
Datasheet URL: [Link](#)
Product URLs: [Link 1](#), [Link 2](#)

BOSCH: BMP180

Measurements: Pressure/Temperature
Dependencies: Adafruit_BMP, Adafruit_GPIO
Datasheet URL: [Link](#)

BOSCH: BMP280

Measurements: Pressure/Temperature
Dependencies: Adafruit_GPIO
Manufacturer URL: [Link](#)
Datasheet URL: [Link](#)
Product URL: [Link](#)

CO2Meter: K30

Measurements: CO2
Manufacturer URL: [Link](#)
Datasheet URL: [Link](#)

Catnip Electronics: Chirp

Measurements: Light/Moisture/Temperature
Dependencies: smbus2
Manufacturer URL: [Link](#)
Product URL: [Link](#)

Cozir: Cozir CO2

Measurements: CO2/Humidity/Temperature
Dependencies: cozir
Manufacturer URL: [Link](#)
Datasheet URL: [Link](#)

MAXIM: DS1822

Measurements: Temperature
Dependencies: w1thermsensor
Manufacturer URL: [Link](#)
Datasheet URL: [Link](#)

MAXIM: DS1825

Measurements: Temperature
Dependencies: w1thermsensor
Manufacturer URL: [Link](#)
Datasheet URL: [Link](#)

MAXIM: DS18B20

Measurements: Temperature

Dependencies: Input Variant 1: ow-shell, subprocess; Input Variant 2: w1thermsensor

Manufacturer URL: [Link](#)

Datasheet URL: [Link](#)

Product URLs: [Link 1](#), [Link 2](#), [Link 3](#)

Additional URL: [Link](#)

Warning: Counterfeit DS18B20 sensors are common and can cause a host of issues. Review the Additional URL for more information about how to determine if your sensor is authentic.

MAXIM: DS18S20

Measurements: Temperature

Dependencies: w1thermsensor

Manufacturer URL: [Link](#)

Datasheet URL: [Link](#)

MAXIM: DS28EA00

Measurements: Temperature

Dependencies: w1thermsensor

Manufacturer URL: [Link](#)

Datasheet URL: [Link](#)

MAXIM: MAX31850K

Measurements: Temperature

Dependencies: w1thermsensor

Manufacturer URL: [Link](#)

Datasheet URL: [Link](#)

Product URL: [Link](#)

MAXIM: MAX31855

Measurements: Temperature (Object/Die)

Dependencies: Adafruit_MAX31855, Adafruit_GPIO

Manufacturer URL: [Link](#)

Datasheet URL: [Link](#)

Product URL: [Link](#)

MAXIM: MAX31856

Measurements: Temperature (Object/Die)

Dependencies: RPi.GPIO

Manufacturer URL: [Link](#)

Datasheet URL: [Link](#)

Product URL: [Link](#)

MAXIM: MAX31865

Measurements: Temperature

Dependencies: RPi.GPIO

Manufacturer URL: [Link](#)

Datasheet URL: [Link](#)

Product URL: [Link](#)

Melexis: MLX90614

Measurements: Temperature (Ambient/Object)
Dependencies: smbus2
Manufacturer URL: [Link](#)
Datasheet URL: [Link](#)
Product URL: [Link](#)

Microchip: MCP3008

Measurements: Voltage (Analog-to-Digital Converter)
Dependencies: Adafruit_MCP3008
Manufacturer URL: [Link](#)
Datasheet URL: [Link](#)
Product URL: [Link](#)

Microchip: MCP342x (x=2,3,4,6,7,8)

Measurements: Voltage (Analog-to-Digital Converter)
Dependencies: smbus2, MCP342x
Manufacturer URLs: [Link 1](#), [Link 2](#), [Link 3](#), [Link 4](#), [Link 5](#)
Datasheet URLs: [Link 1](#), [Link 2](#)

Microchip: MCP9808

Measurements: Temperature
Dependencies: Adafruit_GPIO, Adafruit_MCP9808
Manufacturer URL: [Link](#)
Datasheet URL: [Link](#)
Product URL: [Link](#)

Panasonic: AMG8833

Measurements: 8x8 Temperature Grid
Dependencies: libjpeg-dev, zlib1g-dev, colour, Pillow, Adafruit_AMG88xx

ROHM: BH1750

Measurements: Light
Dependencies: smbus2
Datasheet URL: [Link](#)
Product URL: [Link](#)

Ruuvi: RuuviTag

Measurements: Acceleration/Humidity/Pressure/Temperature
Dependencies: python3-dev, python3-psutil, bluez, bluez-hcidump, ruuvitag_sensor, subprocess
Manufacturer URL: [Link](#)
Datasheet URL: [Link](#)

STMicroelectronics: VL53L0X

Measurements: Millimeter (Time-of-Flight Distance)
Dependencies: VL53L0X
Manufacturer URL: [Link](#)
Datasheet URL: [Link](#)
Product URLs: [Link 1](#), [Link 2](#)

Sensirion: SHT1x/7x

Measurements: Humidity/Temperature

Dependencies: sht_sensor

Manufacturer URLs: [Link 1](#), [Link 2](#)

Sensirion: SHT2x

Measurements: Humidity/Temperature

Dependencies: smbus2

Manufacturer URL: [Link](#)

Sensirion: SHT3x (30, 31, 35)

Measurements: Humidity/Temperature

Dependencies: Adafruit_GPIO, Adafruit_SHT31

Manufacturer URL: [Link](#)

Sensorion: SHT31 Smart Gadget

Measurements: Humidity/Temperature

Dependencies: pi-bluetooth, libglib2.0-dev, bluepy

Manufacturer URL: [Link](#)

Sonoff: TH16/10 (Tasmota firmware) with AM2301

Measurements: Humidity/Temperature

Dependencies: requests

Manufacturer URL: [Link](#)

Sonoff: TH16/10 (Tasmota firmware) with DS18B20

Measurements: Temperature

Dependencies: requests

Manufacturer URL: [Link](#)

TE Connectivity: HTU21D

Measurements: Humidity/Temperature

Dependencies: pigpio

Manufacturer URL: [Link](#)

Datasheet URL: [Link](#)

Product URL: [Link](#)

Texas Instruments: ADS1256

Measurements: Voltage (Waveshare, Analog-to-Digital Converter)

Dependencies: wiringpi, pipyadc_py3

Texas Instruments: ADS1x15

Measurements: Voltage (Analog-to-Digital Converter)

Dependencies: Adafruit_GPIO, Adafruit_ADS1x15

Texas Instruments: HDC1000

Measurements: Humidity/Temperature

Manufacturer URL: [Link](#)

Datasheet URL: [Link](#)

Texas Instruments: TMP006

Measurements: Temperature (Object/Die)
Dependencies: Adafruit_TMP
Datasheet URL: [Link](#)
Product URL: [Link](#)

Winsen: MH-Z16

Measurements: CO2
Dependencies: smbus2
Manufacturer URL: [Link](#)
Datasheet URL: [Link](#)

Winsen: MH-Z19

Measurements: CO2
Datasheet URL: [Link](#)

This is the version of the sensor that does not include the ability to conduct automatic baseline correction (ABC). See the B version of the sensor if you wish to use ABC.

Winsen: MH-Z19B

Measurements: CO2
Manufacturer URL: [Link](#)
Datasheet URL: [Link](#)

This is the B version of the sensor that includes the ability to conduct automatic baseline correction (ABC).

Winsen: ZH03B

Measurements: Particulates
Manufacturer URL: [Link](#)
Datasheet URL: [Link](#)

Xiaomi: Miflora

Measurements: EC/Light/Moisture/Temperature
Dependencies: libglib2.0-dev, miflora, btlewrap, bluepy

I2C Multiplexers

NOTE: As of March, 2020, it has been discovered that the device tree overlay technique for using I2C multiplexers does not work with Raspbian Buster. It will work for Raspbian Stretch, but Mycodo will not work properly with this old version of Raspbian and will disable the API. If you do not need access to the API and do require the use of a multiplexer, it is recommended to install Raspbian Stretch prior to installing Mycodo, until a fix for Buater can be developed. For more information, see [issue #755](<https://github.com/kizniche/Mycodo/issues/755>). Alternatively, you will need to write your own Python script (or other language) to switch to the specific multiplexer channel and acquire a measurement for use with Mycodo. This script can then be executed by either the Linux Command or Python Code Input to store the measurement(s). This workaround isn't ideal, but is all there is at this point.

All devices that connected to the Raspberry Pi by the I2C bus need to have a unique address in order to communicate. Some inputs may have the same address (such as the AM2315), which prevents more than one from being connected at the same time. Others may provide the ability to change the address, however the address range may be limited, which limits by how many you can use at the same time. I2C multiplexers are extremely clever and useful in these scenarios because they allow multiple sensors with the same I2C address to be connected.

For instance, the TCA9548A/PCA9548A: I2C Multiplexer has 8 selectable addresses, so 8 multiplexers can be connected to one Raspberry Pi. Each multiplexer has 8 channels, allowing up to 8 devices/sensors with the same address to be connected to each multiplexer. 8 multiplexers x 8 channels = 64 devices/sensors with the same I2C address.

Multiplexers can be set up by loading a kernel driver to handle the communication, producing a new I2C bus device for each multiplexer channel. To enable the driver for the TCA9548A/PCA9548A, visit [GPIO-pca9548](#) to get the code and latest install instructions. If successfully set up, there will be 8 new I2C buses on the [Gear Icon] -> **System Information** page.

The driver for the TCA9545A can be found at <https://github.com/camrex/i2c-mux-pca9545a> and other drivers are available elsewhere. See the manufacturer or user forums for details. Some multiplexers I've tested are below.

- TCA9548A/PCA9548A: I2C Multiplexer link (I2C): 8 selectable addresses, 8 channels
- TCA9545A: I2C Bus Multiplexer link (I2C): The linked Grove board creates 4 new I2C buses, each with their own selectable voltage, either 3.3 or 5.0 volts.

Analog-to-Digital Converters

An analog to digital converter (ADC) allows the use of any analog sensor that outputs a variable voltage. A voltage divider may be necessary to attain your desired range.

- ADS1x15: Analog-to-digital converter link
- ADS1256: Analog-to-digital converter link
- MCP3008: Analog-to-digital converter link
- MCP342x: Analog-to-digital converter link

I2C Information

The I2C interface should be enabled with `raspi-config`.

1-Wire Information

The 1-wire interface should be configured with these instructions.

UART Information

This documentation provides specific installation procedures for configuring UART with the Raspberry Pi version 1 or 2.

Because the UART is handled differently higher after the Raspberry Pi 2 (due to the addition of bluetooth), there are a different set of instructions. If installing Mycodo on a Raspberry Pi 3 or above, you only need to perform these steps to configure UART:

Run `raspi-config`

```
sudo raspi-config
```

Go to **Advanced Options** -> **Serial** and disable. Then edit `/boot/config.txt`

```
sudo vi /boot/config.txt
```

Find the line "enable_uart=0" and change it to "enable_uart=1", then reboot.

Output Devices

Built-In Outputs

- On/Off (Python code)
- On/Off (GPIO)
- On/Off (Shell script)
- Pulse-Width-Modulation (Python code)
- Pulse-Width-Modulation (GPIO)
- Pulse-Width-Modulation (Shell script)
- Peristaltic Pump (Generic, GPIO)
- Peristaltic Pump (Atlas Scientific) link
- Wireless 315/433 MHz (rpi-rf, GPIO)

Device Notes

This information may not be current, so always reference and follow manufacturer recommendations for operating their devices.

Edge Detection

The detection of a changing signal, for instance a simple switch completing a circuit, requires the use of edge detection. By detecting a rising edge (LOW to HIGH), a falling edge (HIGH to LOW), or both, actions or events can be triggered. The GPIO chosen to detect the signal should be equipped with an appropriate resistor that either pulls the GPIO up [to 5-volts] or down [to ground]. The option to enable the internal pull-up or pull-down resistors is not available for safety reasons. Use your own resistor to pull the GPIO high or low.

Examples of devices that can be used with edge detection: simple switches and buttons, PIR motion sensors, reed switches, hall effect sensors, float switches, and more.

LCD Displays

There are only a few number fo LCDs that are supported. 16x2 and 20x4 character LCD displays with I2C backpacks and the 128x32 / 128x64 OLED displays are supported. The below image is the type of device with the I2C backpack that should be compatible.



Raspberry Pi

The Raspberry Pi has an integrated temperature sensor on the BCM2835 SoC that measure the temperature of the CPU/GPU. This is the easiest sensor to set up in Mycodo, as it is immediately available to be used.

AM2315

From @Theoi-Meteoroi on GitHub:


I figured out why this [AM2315] sensor is unreliable with Rpi3 hardware I2C. It is among a number of I2C devices that really hates the BCM2835 clock stretching blunder (hardware bug: raspberrypi/linux#254). The wakeup attempts fail, consistently. I checked the bitstream with a sniffer, and see that the sensor may respond once out of 20 or so tries (or not at all) but only with a single byte returned. The solution is to use a software implementation of the I2C bus. You need to add pull-up resistors (4.7k is dandy) to 3.3v and install the `i2c-gpio` device overlay. Seems to work fine now, will run for a few days, but the CRC failures are gone and I get good readings, every time. And no twiddling the power for the sensor is required.

To enable software I2C, add the following line to your `/boot/config.txt`

```
dtoverlay=i2c-gpio,i2c_gpio_sda=23,i2c_gpio_scl=24,i2c_gpio_delay_us=4
```

After rebooting, a new I2C bus at `/dev/i2c-3` should exist with SDA on pin 23 (BCM) and SCL on pin 24 (BCM). Make sure you add the appropriate pull-up resistors before connecting any devices.

K-30

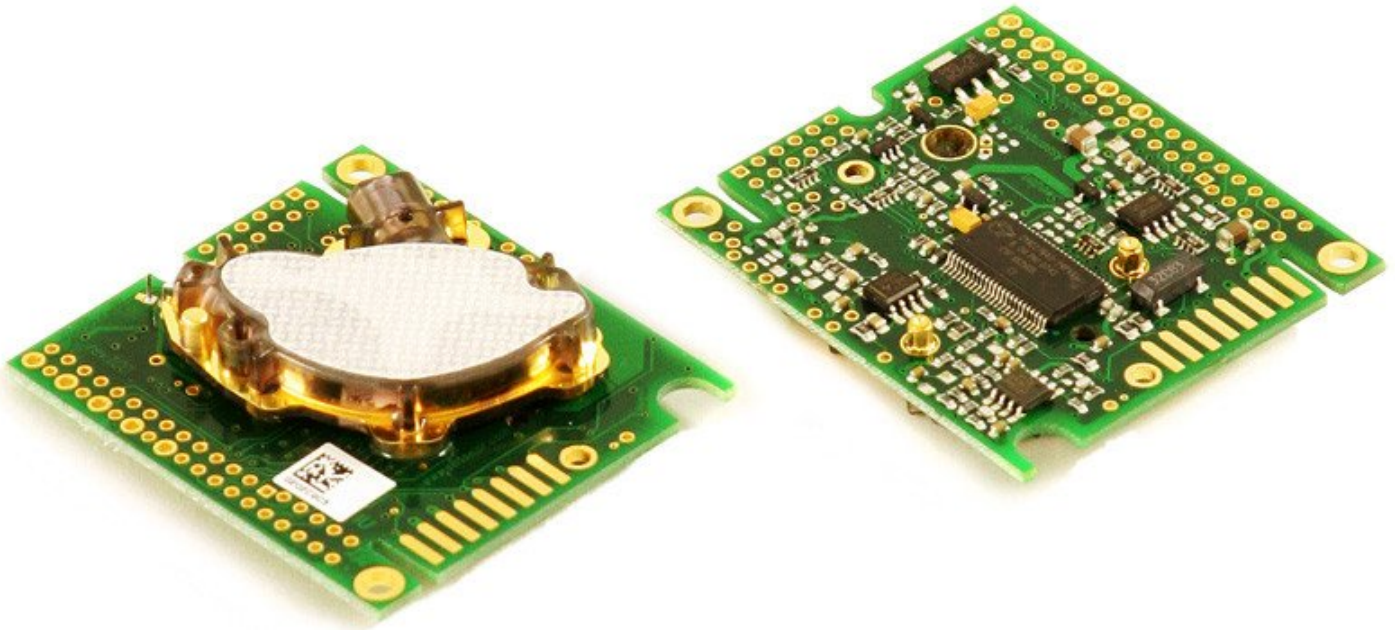

Be very careful when connecting the K-30, as there is no reverse-voltage protection and improper connections could destroy your sensor.

Wiring instructions for the Raspberry Pi can be found [here](#).

USB Device Persistence Across Reboots

From (#547) Theoi-Meteoroi on Github:

Using USB devices, such as USB-to-serial interfaces (CP210x) to connect a sensor, while convenient, poses an issue if there are multiple devices when the system reboots. After a reboot, there is no guarantee the device will persist with the same name. For instance, if Sensor A is `/dev/ttyUSB0` and Sensor B is `/dev/ttyUSB1`, after a reboot Sensor A may be `/dev/ttyUSB1` and Sensor B may be `/dev/ttyUSB0`. This will cause Mycodo to query the wrong device for a measurement, potentially causing

a mis-measurement, or worse, an incorrect measurement because the response is not from the correct sensor (I've seen my temperature sensor read 700+ degrees celsius because of this!). Follow the instructions below to alleviate this issue.

I use udev to create a persistent device name ('/dev/dust-sensor') that will be linked to the /dev/ttyUSBn that is chosen at device arrival in the kernel. The only requirement is some attribute returned from the USB device that is unique. The common circumstance is that none of the attributes are unique and you get stuck with just VID and PID, which is ok as long as you don't have any other adapters that report the same VID and PID. If you have multiple adapters with the same VID and PID, then hopefully they have some unique attribute. This command will walk the attributes. Run on each USB device and then compare differences to possibly find some attribute to use.

```
udevadm info --name=/dev/ttyUSB0 --attribute-walk
```

I ended up using the serial number on the ZH03B to program the USB adapter serial field. This way guarantees unique serial numbers rather than me trying to remember what was the last serial number I used to increment by 1.

When you plug a USB device in it can be enumerated to different device names by the operating system. To fix this problem for this sensor on linux, I changed attributes that make the connection unique.

First - find the VID and PID for the USB device:

```
pi@raspberrypi:~ $ lsusb
Bus 001 Device 008: ID 10c4:ea60 Cygnal Integrated Products, Inc. CP210x UART Bridge / myAVR mySmartUSB light
Bus 001 Device 003: ID 0424:ec00 Standard Microsystems Corp. SMSC9512/9514 Fast Ethernet Adapter
Bus 001 Device 002: ID 0424:9514 Standard Microsystems Corp. SMC9514 Hub
Bus 001 Device 001: ID 1d6b:0002 Linux Foundation 2.0 root hub
```

In this case the Vendor ID is 10c4 The Product ID is ea60

Note: If you have multiple devices and you find your IDs to be the same, you can change IDs with the Simplicity Studio Xpress Configurator tool (discussed starting on page 6 of the AN721: USBXpress™ Device Configuration and Programming Guide).

Since I changed the serial number field - this will be unique.

```
pi@raspberrypi:~ $ udevadm info --name=/dev/ttyUSB0 --attribute-walk | grep serial
SUBSYSTEMS=="usb-serial"
ATTRS{serial}=="ZH03B180904"
ATTRS{serial}=="3f980000.usb"
```

Now I have an attribute to tell udev what to do. I create a file in /etc/udev/rules.d with a name like "99-dustsensor.rules". In that file I tell udev what device name to create when it sees this device plugged in:

```
SUBSYSTEM=="tty", ATTRS{idVendor}=="10c4", ATTRS{idProduct}=="ea60", ATTRS{serial}=="ZH03B180904"
SYMLINK+="dust-sensor"
```

To test the new rule:



```
pi@raspberrypi:/dev $ sudo udevadm trigger
pi@raspberrypi:/dev $ ls -al dust-sensor
lrwxrwxrwx 1 root root 7 Oct 6 21:04 dust-sensor -> ttyUSB0
```

Now, every time the dust sensor is plugged in, it shows up at /dev/dust-sensor




Diagrams

DHT11 Diagrams

DHT11 pins	
1	VCC
2	DATA
3	NC
4	GND

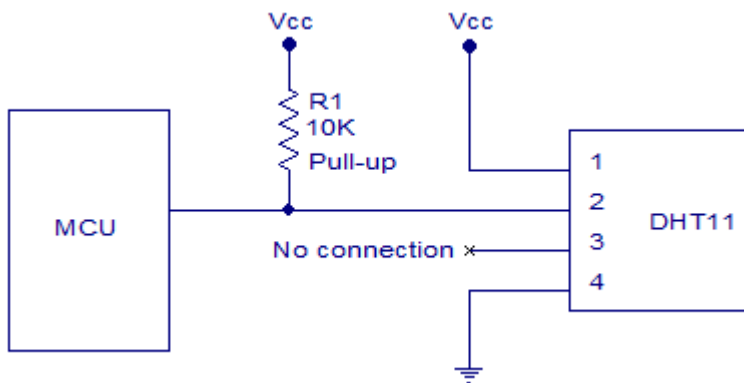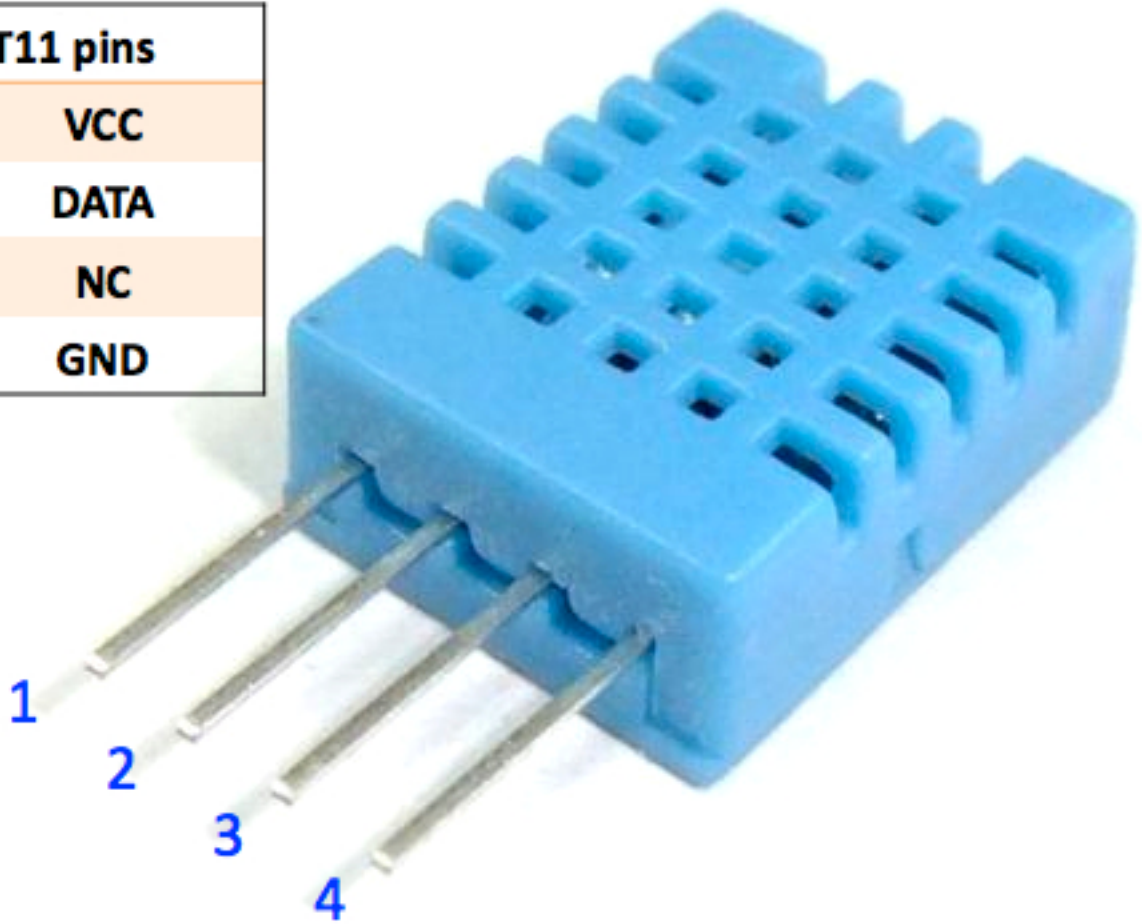


DS18B20 Diagrams

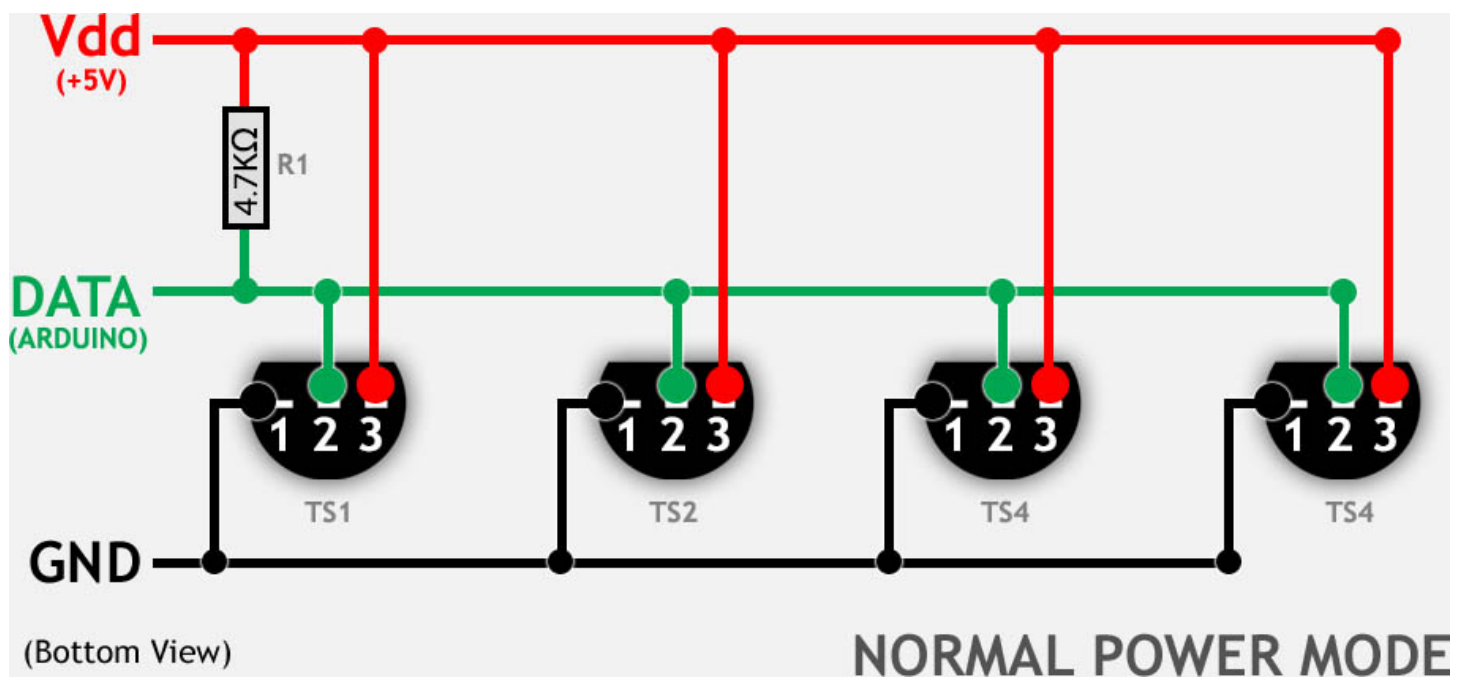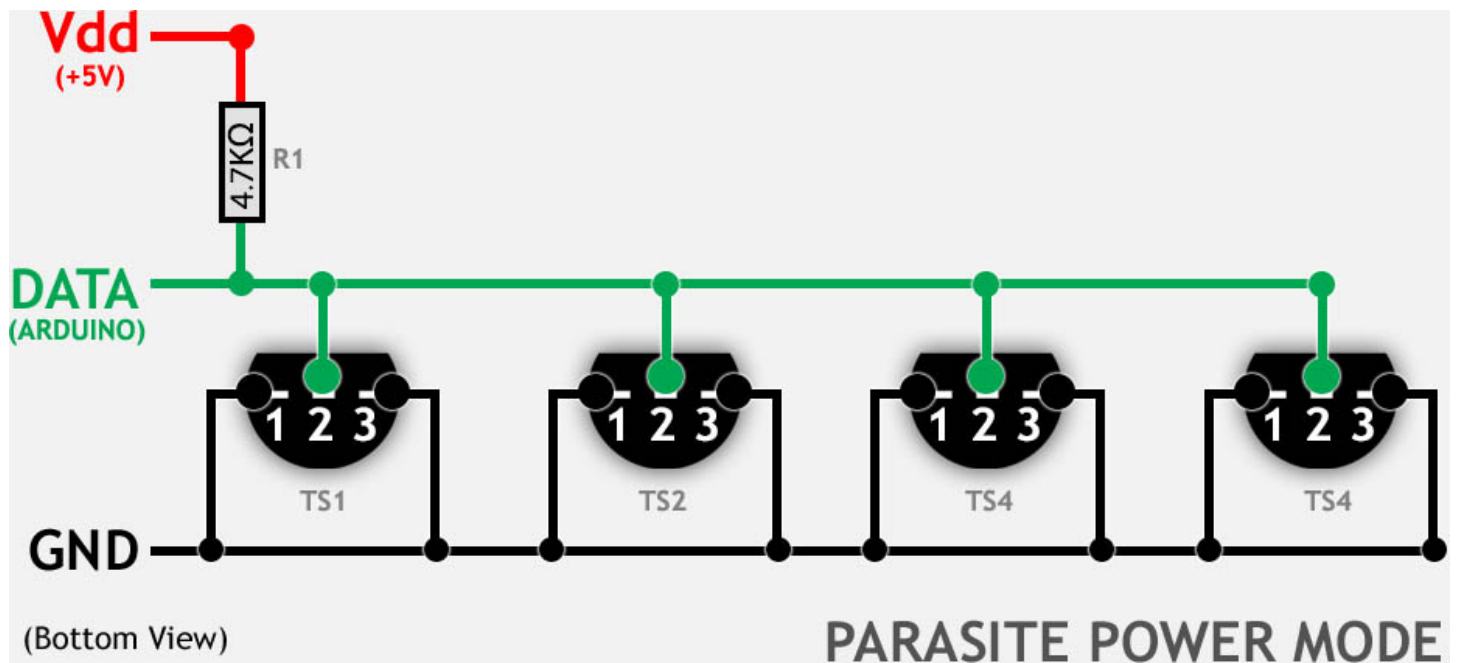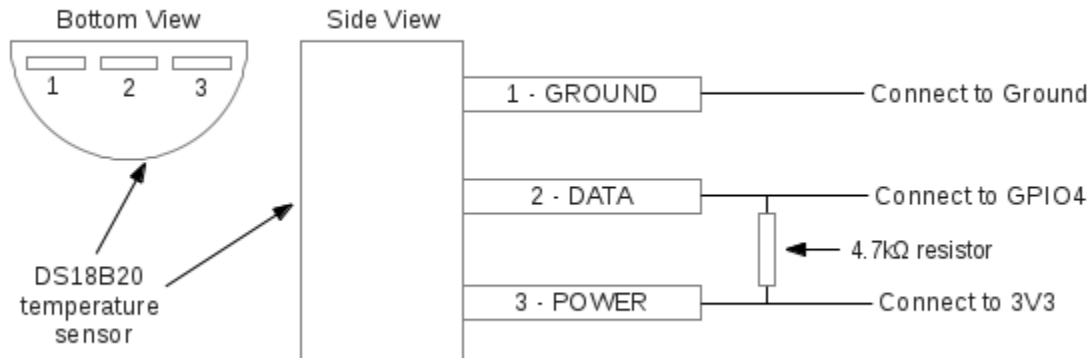

Raspberry Pi and Relay Diagrams

Raspberry Pi, 4 relays, 4 outlets, 1 DS18B20 sensor:

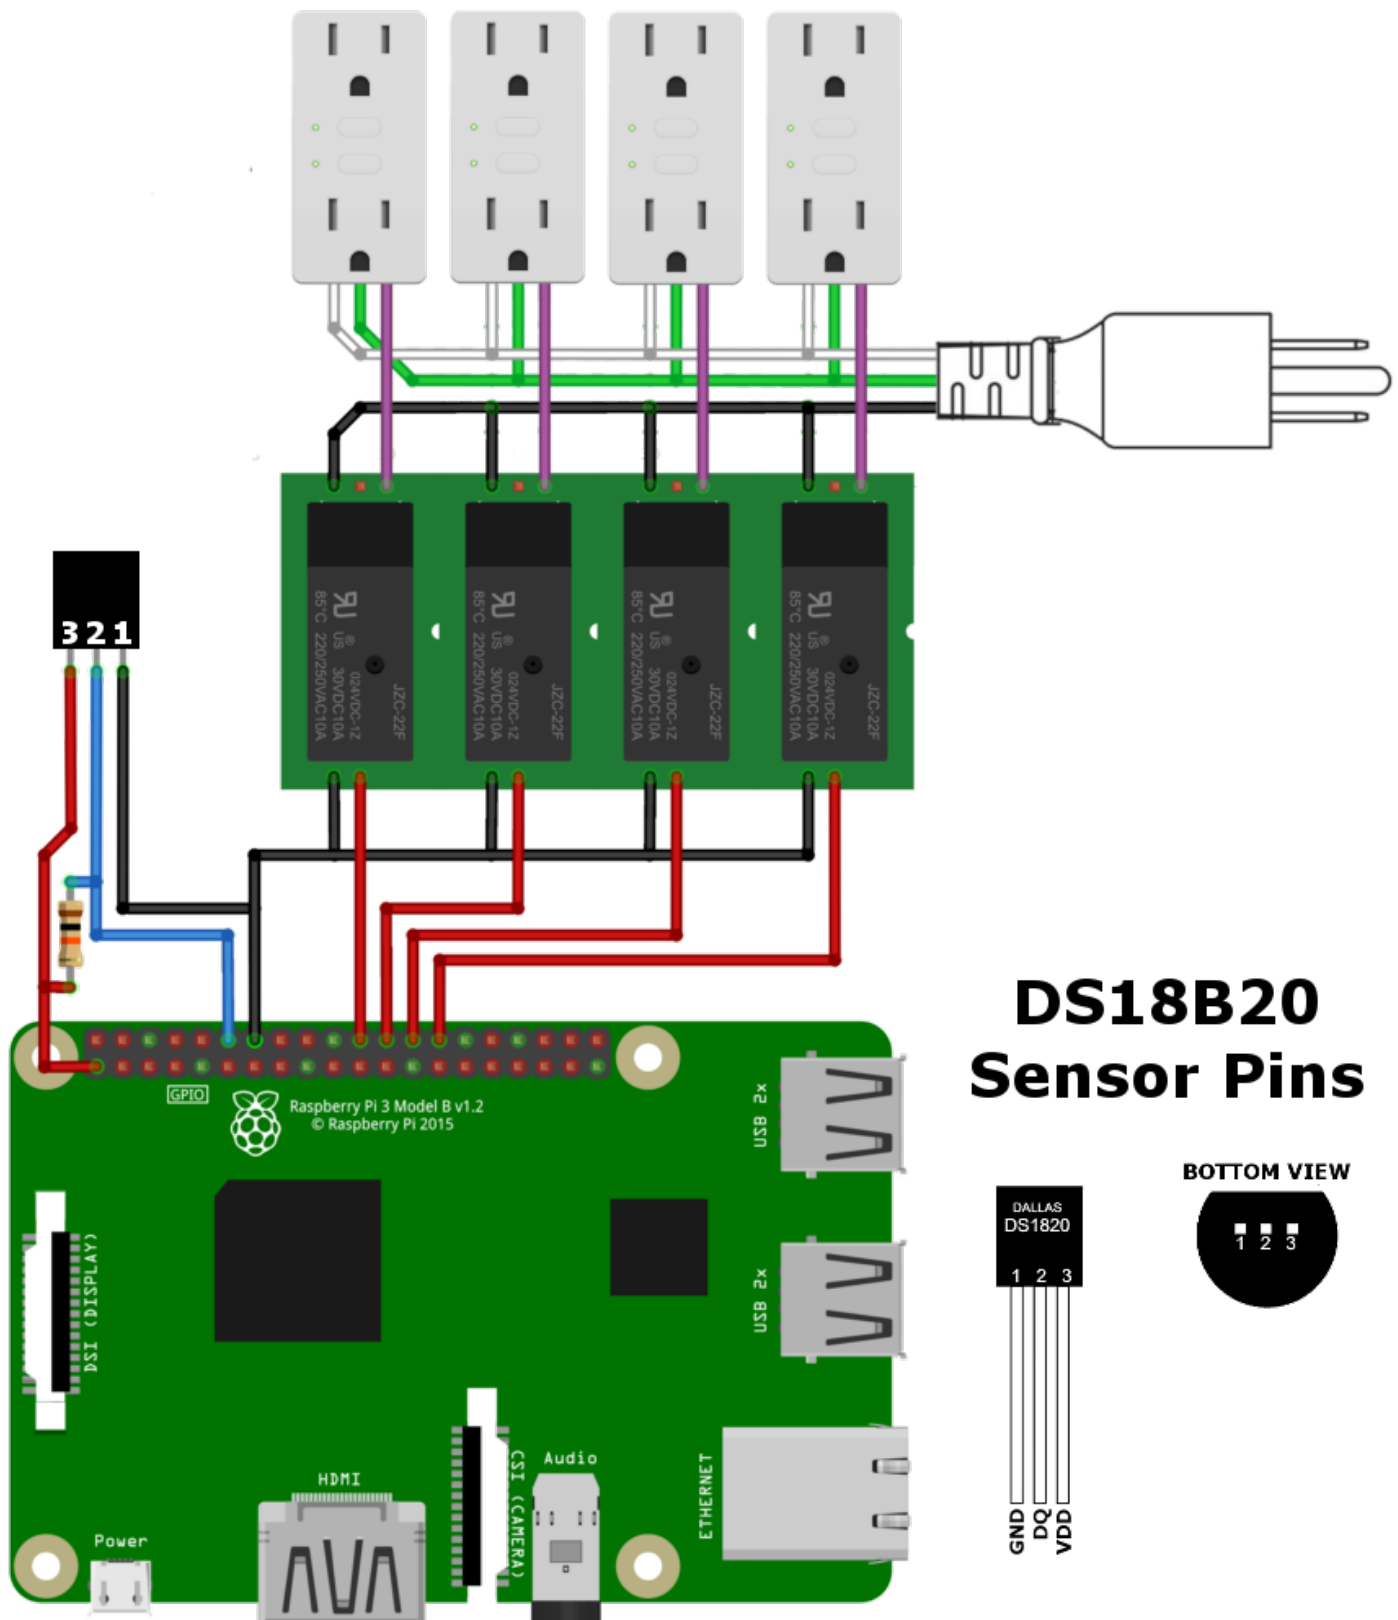

Raspberry Pi, 8 relays, 8 outlets:

8-Outlet
Power Strip

8 Relays

