



Pumping test 'B2'

- B2 $r=0.08$
- B1 $r=5.09$
- B3 $r=9.77$
- B4 $r=15.29$
- B5 $r=19.88$

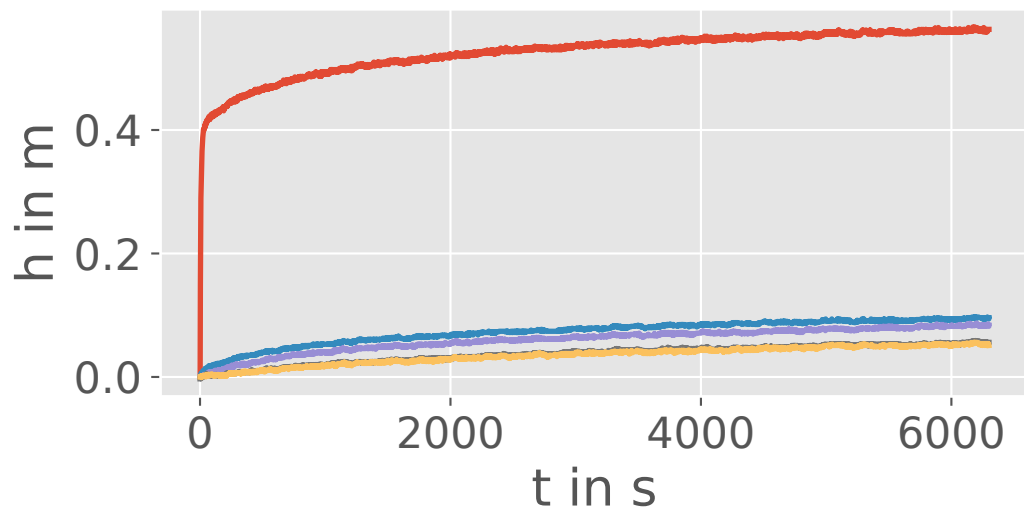


Pumping test 'B3'

- B3 $r=0.08$
- B2 $r=9.77$
- B1 $r=10.54$
- B5 $r=23.01$
- B4 $r=23.96$

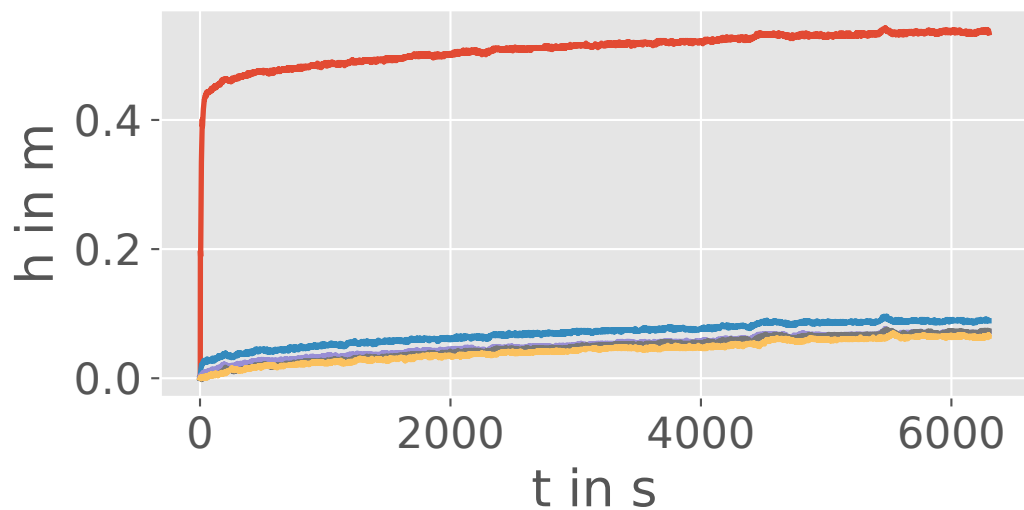

Pumping test 'B4'

- B4 $r=0.08$
- B5 $r=15.25$
- B2 $r=15.29$
- B1 $r=19.01$
- B3 $r=23.96$

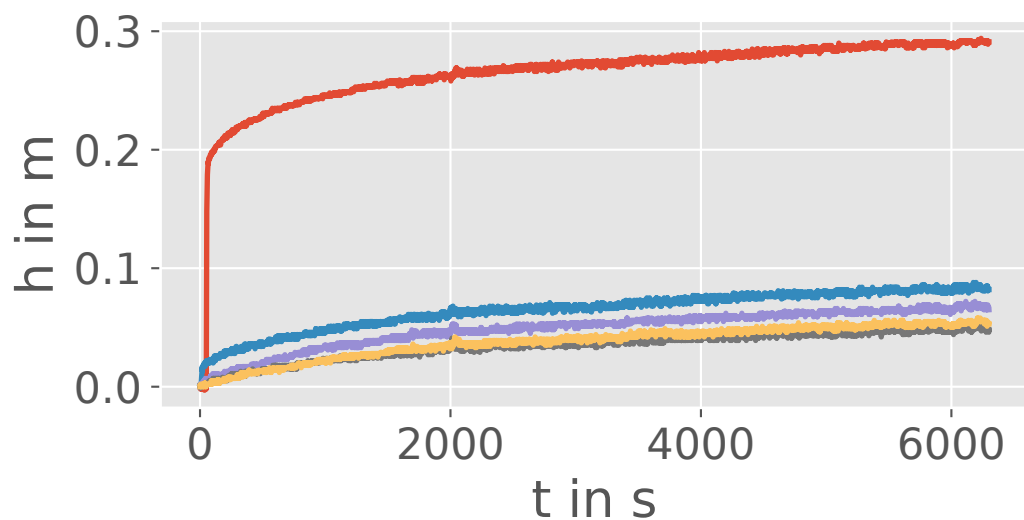

Pumping test 'B5'

- B5 $r=0.08$
- B4 $r=15.25$
- B2 $r=19.88$
- B3 $r=23.01$
- B1 $r=24.97$