

Manuscript Number:

Title: EXPERIMENTAL TESTS FOR THE CHARACTERIZATION OF SISAL FIBER
REINFORCED CEMENTITIOUS MATRIX FOR STRENGTHENING MASONRY STRUCTURES

Article Type: Research Paper

Keywords: NFRCM, TRM, FRCM, masonry, natural fiber, sisal fiber, tensile
test, shear test, experimental test

Corresponding Author: Dr. Claudia Brito de Carvalho Bello,

Corresponding Author's Institution:

First Author: Claudia Brito de Carvalho Bello

Order of Authors: Claudia Brito de Carvalho Bello; Ingrid Boem, PhD;
Antonella Cecchi, Full professor; Natalino Gattesco, Associate Professor;
Daniel V Oliveira, Associate Professor

Abstract: The experimental characterization of a Natural Fiber Reinforced
Cementitious Matrix (NFRCM), made of sisal fibers yarns impregnated with
a water-based resin and embedded in an inorganic matrix based on natural
lime, is presented in the paper. The Sisal-NFRCM performances are
investigated through tensile and single-lap shear tests, adopting the
dispositions of the Round Robin Tests developed for the FRCM
characterization by the RILEM Technical Committee 250-CSM.
The tensile stress-strain curve evidenced the tension stiffening effect
of the mortar between cracks, which tended progressively to reduce. In
shear tests, the failure and the progressive slippage of the sisal yarns
was observed.

Suggested Reviewers: Antonio Michele Tralli
University of Ferrara
antoniomichele.tralli@unife.it
The professor deals with numerical models for masonry and composites.

Maria Antonietta Aiello
full professor, University of Salento
antonietta.aiello@unisalento.it
The professor investigates FRCM systems for masonry strengthening.

Pierre Argoul
IFSTTAR
argoul@lami.enpc.fr
The professor investigates numerical models for the nonlinear analysis of
masonry structures

Emanuele Reccia PhD
Sapienza University of Rome
emanuele.reccia@uniroma1.it
The researcher deals with masonry and homogenization procedures

Renato sante Olivito
full professor, University of Calabria
rs.olivito@unical.it

The resaearcher investigates NFRCM systems made with natural fibers for
masonry strengthening.



Università Iuav di Venezia

Dorsoduro 2206 Terese
30123 Venezia
f. +39 041 257 1297

DIPARTIMENTO DI
ARCHITETTURA COSTRUZIONE
CONSERVAZIONE

Antonella Cecchi direttore

Venice, 12/11/2018

Dear Editor,

Antonella Cecchi, Boem Ingrid, Gattesco Natalino, Daniel V. Oliveira and myself would like to submit the manuscript: "Experimental tests for the characterization of sisal fiber reinforced cementitious matrix for strengthening masonry structures" for possible publication on Construction and Building Materials, An International Journal.

This is an original paper that has not been simultaneously submitted, in whole or in part, in English or in any other language, without the written consent of the publisher.

Best regards,

Claudia Brito de Carvalho Bello.

Università IUAV di Venezia
DACC - Department of Architecture Construction Conservation
Dorsoduro 2206, ex convento Terese
30123 Venezia - Italy
tel: +39 041 257 1298
fax: +39 041 257 1282
e-mail: decarvalho@iuav.it

***Conflict of Interest**

This piece of the submission is being sent via mail.

EXPERIMENTAL TESTS FOR THE CHARACTERIZATION OF SISAL FIBER REINFORCED CEMENTITIOUS MATRIX FOR STRENGTHENING MASONRY STRUCTURES

Claudia Brito de Carvalho Bello^{1*}, Ingrid Boem², Antonella Cecchi³, Natalino Gattesco⁴, Daniel V. Oliveira⁵

* Corresponding author

¹ e-mail: decarvalho@iuav.it - tel.: +390412571297 - fax: +390412571282

² e-mail: ingrid.boem@dia.units.it

³ e-mail: cecchi@iuav.it

⁴ e-mail: gattesco@units.it

⁵ e-mail: danvco@civil.uminho.pt

^{1,3} Department of Architecture Construction Conservation (DACC)

University IUAV of Venice

Dorsoduro 2206, 30123 Venezia, Italy

^{2,4} Department of Engineering and Architecture

University of Trieste

Piazzale Europa 1, 34127 Trieste, Italy

⁵ Department of Civil Engineering (ISISE)

University of Minho

Largo do Paço, 4704-553 Braga, Portugal

Abstract

The experimental characterization of a Natural Fiber Reinforced Cementitious Matrix (NFRCM), made of sisal fibers yarns impregnated with a water-based resin and embedded in a inorganic matrix based on natural lime, is presented in the paper. The Sisal-NFRCM performances are investigated through tensile and single-lap shear tests, adopting the dispositions of the Round Robin Tests developed for the FRCM characterization by the RILEM Technical Committee 250-CSM. The tensile stress-strain curve evidenced the tension stiffening effect of the mortar between cracks, which tended progressively to reduce. In shear tests, the failure and the progressive slippage of the sisal yarns was observed.

Keywords

NFRCM, TRM, FRCM, masonry, natural fiber, sisal fiber, tensile test, shear test, experimental test

1. Introduction

The Fiber Reinforced Cementitious Matrix (FRCM), also known, in the literature, as Textile Reinforced Mortar (TRM), represents an innovative structural method for masonry strengthening. The first use of FRCM was in the late 1990s in Europe, on few construction applications. FRCM systems are constituted by fibers - arranged as open fabric meshes - embedded in a cementitious matrix. The fibers carry tensile stresses and the mortar matrix ensures the load transfer among the fibers and improve long-term durability. Moreover, the fiber may also be coated with resin, to improve the adhesion with the matrix. The fiber materials commonly used are carbon, glass, steel, aramid, basalt, polyparaphenylenbenzobisoxazole (PBO): they are from non-renewable sources or synthetic materials and FRCM systems with vegetal fibers are not in commerce yet.

At present time, only the US AC434 [1] and ACI 549.4R-13 [2] codes are available as a guide to the FRCM design and experimental tests for the application on masonry and reinforced concrete structures. In Europe, the RILEM TC 250-CSM (Composites for Sustainable strengthening of Masonry) organized a Round Robin Test (RRT), involving 19 research institutions from 6 European countries (France, Germany, Greece, Italy, Poland, Portugal and Slovenia), and 11 industrial partners (10 Italians and 1 Greek). The overall investigation included direct tensile and bond tests [3]-[4]. The first experimental results of the Round Robin are reported in detail in five papers, organized by textile material: basalt [5], carbon [6], glass [7], aramid and PBO [8] and steel [9].

Despite the big effort on research in the last years, the knowledge on FRCM mechanical behavior is still incomplete: further experimental data are needed to better understand how the influence of the textile layout, the fibers coating and the mortar matrix composition affects the mechanical behavior of the FRCM composite. Moreover, long-term durability in aggressive environments needs to be investigated and it will be the next RILEM TC 250-CSM experimental investigation.

Also further FRCM experimental and numerical investigations are necessary to gain a sustainable reinforcement technique, using composites consisted by renewable resources, as meshes or textiles made of natural fibers. In fact, sustainability is becoming a very current, crucial issue in the building sector, due to the growing attention on the environmental impact of building materials and processes.

Natural fiber-reinforced composites are emerging very rapidly thanks to developments in research aimed to improve the durability limitations, as treatments and coating systems [10] or bio-based resins production for bio composite systems with natural fibers [11]-[12]. Natural fibers can actually replace metal or ceramic-based materials in several applications for the automotive, aerospace, electronics and construction industries [13]-[15]. In particular, vegetal fibers textiles composites show good mechanical properties, implying reduced thickness and low weight [16]-[17].

Considering plant fibers, the mostly used in the civil engineering field are bast fibers (flax, hemp, jute and ramie) and leaf fibers (abaca, sisal, banana, pineapple).

This work is part of a research program that investigates on the strengthening of masonry through FRCM systems using sustainable materials and deals with the possibility of replacing the most commonly used inorganic or synthetic fibers with organic natural ones and, in particular, plant fibers. The paper focuses on sisal fibers: some researchers already investigated on their properties and in their use for a Natural FRCM (NFRCM) strengthening technique for masonry structures [18]-[21]. In particular, Olivito et al. [21] performed characterization tests on NFRCM made of sisal and flax fabrics, demonstrating for such composites an appreciable ductile behaviour and moderate tensile strengths.

To investigate the mechanical performances of sisal-NFRCM, experimental tests were carried out following the Round Robin Test methodology formulated by the RILEM Technical Committee TC 250-CSM (Composites for Sustainable strengthening of Masonry).

As required by the RILEM protocol, the tests were performed in different laboratories: at the University IUAV of Venice and at the University of Trieste. The same samples characteristics and

test set-ups were adopted in the two laboratories. The sisal-NFRCM samples, produced by the composite factory Fibrenet SpA (Pavia di Udine, Italy), were made with sisal fibers yarns impregnated with a water-based adhesive promoter and embedded into a natural lime mortar. The characterization of the NFRCM constituents (sisal yarns and mortar) was achieved. Then, both laboratories performed:

- tensile tests on sisal-NFRCM samples, to determine the main composite material tensile behavior and parameters as strength, strain and stiffness;
- single-lap shear tests on the sisal-NFRCM reinforcement applied to a brickwork substrate, to set the bond performances.

The tests permitted to obtain important and original information on the behavior of sisal-NFRCM, useful for design purposes and also for numerical simulations. Considering, for example, the application of the sisal-NFRCM on a masonry wall to improve its out-of-plane bending performances, it is necessary to know the actual tensile behavior of the reinforcement acting on the tensed wall face; moreover, to provide an effective contribution, the reinforcement has to be properly anchored.

The tests permitted also to make some considerations on the application of the RILEM RRT testing protocol, developed for common FRCM, on this specific type of reinforcement.

2. Sisal-FRCM constituents characterization

A full characterization of the composite constituents (yarns and mortar) was performed.

2.1 Natural and impregnated Sisal yarns characterization

Sisal yarns from Tanzania were used (Fig. 1a): the yarn is composed by twisted filaments of long fibers.

The specimens were obtained by cutting 500 mm length samples from the sisal roll (Fig. 1b). The samples were conditioned 15 days into an alkaline solution with calcium hydroxides and pH 12.5 to stabilize the cellular structure and the tensile response [22].

The geometric and mechanical characterization of both non-impregnated and impregnated sisal yarns was accomplished. An Interpenetrating Polymer Network (IPN), based on a two-component, water-based adhesive with low viscosity, was used for the impregnation. This IPN is suitable for the preparation of concrete, masonry or wood surfaces and the impregnation of fiberglass or carbon fiber reinforcements; it is durable into lime or cement mortars alkaline environment and fire proof.

The fiber area, A , was evaluated by dividing the yarn linear density, T_x , expressed in Tex [g/km], with the yarn density, ρ [g/cm³]:

$$A = \frac{T_x}{\rho \cdot 1000} . \quad (1)$$

The calculation T_x was obtained in accordance with EN ISO 1889:2009 [23]:

$$T_x = \frac{P \cdot 1000}{L} , \quad (2)$$

where P is the weight of the sample [g] and L the length [m].

The average values of T_x and A obtained from 5 samples are 3130 tex and 2.09 mm² (CoV 3.4%), respectively. The considered yarn density ρ was 1.5 g/cm³, according to Pickering et al. [24].

The equivalent area of impregnated yarns, A_{eq} , was estimated from the measurement of the specimen volume V , in accordance with CNR-DT 200 R1/2013 standard [25]:

$$A_{eq} = \frac{V}{L} . \quad (3)$$

The average value of A_{eq} , obtained from 5 samples, is 5.4mm² (CoV 13.1%).



Fig. 1 Detail of a sisal yarn (a) and yarn roll (b)

Direct tensile tests on both natural and impregnated fibers were carried out on single yarns at a normal atmosphere, using a Galdabini Sun 20 machine (20 kN capacity), conducted at displacement control with a speed rate of 10 mm/min.

The stress-strain curves of natural yarns are plotted in Fig. 2, in green color: they show an initial linear elastic branch and a second non-linear phase associated to the progressive rupture of the fibers, due to an uneven stress distribution. The results are similar to those obtained by De Carvalho Bello and Cecchi [22], with an average of 437 N maximum tensile load (CoV 9.5%). The calculated tensile strength thus results equal to 209.1 MPa.

The blue stress-strain curves in Fig. 2 refer to impregnated yarns and evidence an elastic brittle behavior, with an average tensile maximum load of 500 N (CoV 11.4%), an average axial stiffness of 16412 N (CoV 11.6%) and mean ultimate strain 3.07% (CoV 4.9%). The average tensile strength resulted of 239.7 MPa, referring to the cross-section of the non-impregnated yarn (A), and of 92.6 MPa, using the area of the impregnated one (A_{eq}).

Considering the results of non-impregnated yarns, the impregnated ones presented a higher resistance (about +14%): actually, the impregnation allowed a more uniform distribution of the stresses between the fibers, avoiding their gradual failure.

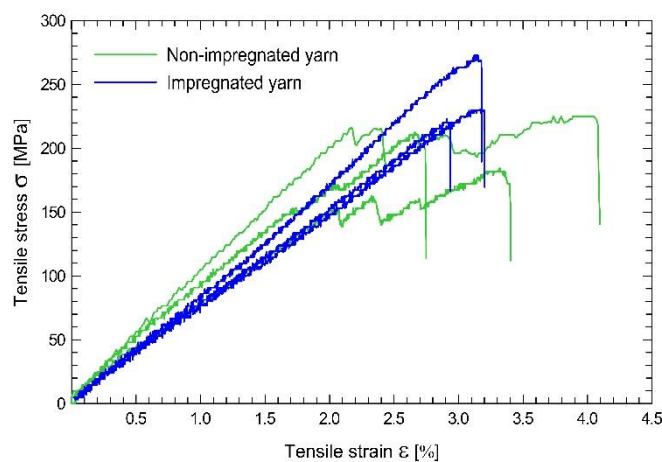


Fig. 2 Tensile tests on sisal yarns: non-impregnated (green) and impregnated (blue) yarns stress-strain curves (the stresses are calculated considering a non-impregnated yarn cross-section of 2.09 mm^2)

2.2 Mortar characterization

The inorganic matrix considered for the NFRCCM is a pre-mixed mortar in which the main binder is the Natural Hydraulic Lime (NHL). The NHL-based mortar is suitable for building restoration, in

accordance to EN 1998-1:2004 standard [26]. The mortar mechanical characterization was set by compressive and flexural tensile tests on six prismatic samples ($40 \times 40 \times 160 \text{ mm}^3$), tested after about 60 days air curing, in accordance to EN1996-1-1:2005 standard [27] (Fig. 3). Samples provided an average mass density of about 1624 kg/m^3 . The average strengths obtained are 13 MPa (CoV 1.8%) and 3.5 MPa (CoV 3.5%) for the compressive and the flexural tensile strengths, respectively.

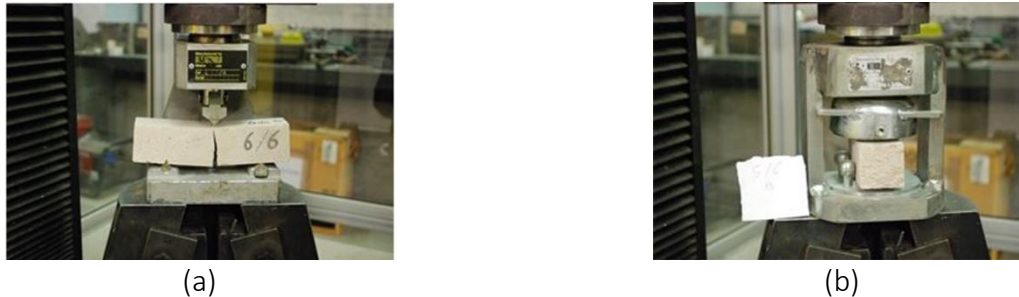


Fig. 3 Flexural (a) and compressive (b) tests on mortar prismatic specimens

3. Sisal-NFRCM tensile tests

The tensile tests on the Sisal-FRCM aim to study the tensile response of the composite and the effect of the intact mortar between cracks (tension stiffening effect).

3.1 Specimens

The specimens were prismatic samples of mortar with a layer of sisal yarns embedded. The prisms dimensions were 75mm width, 500mm length and 10mm thick (Fig. 4). The reinforcement is constituted by 5 impregnated yarns disposed in the longitudinal direction and placed in the middle of the specimen thickness.



Fig. 4 Sisal-FRCM specimen geometry: frontal and lateral view

The specimens were produced with particular attention to the alignment of the yarns, to avoid parasitic stresses during test execution. Fig. 5 illustrates the specimens manufacturing process, with the first half thickness layer of mortar, about 5 mm thick (a), the sisal yarns disposed in the longitudinal direction (b), the manual impregnation with the adhesion promoter (c) and the last half of mortar, about 5 mm thick (d). It is worth to note that, in actual applications on existing masonry walls, this type of reinforcement should reasonably be composed of bidirectional yarns (arranged as a textile or a mesh). Thus, transversal yarns can somehow improve the anchorage performances of the longitudinal ones to the matrix, depending on the consistency of the intersection between yarns (e.g. simple weft-warp weaving or making knots). However, since this was a preliminary characterization study, the contribution of the transversal yarns was prudentially neglected.

The specimens were cured for 60 days, at $23 \pm 2^\circ\text{C}$ temperature and 50-60% relative humidity conditions. Specific tabs, $75 \times 75 \text{ mm}^2$, were then applied at the samples extremities, according to the RILEM indications developed for “classic” FRCMs fabrics or textiles embedded in high performances cementitious matrices, so to avoid cracking and crushing in correspondence of the

grip areas during the experimental test [3]. Actually, two overlapped CFRP (Carbon Fiber Reinforced Polymer) strips were applied by the impregnation of the carbon-based fabric with epoxy resin (Fig. 6a).

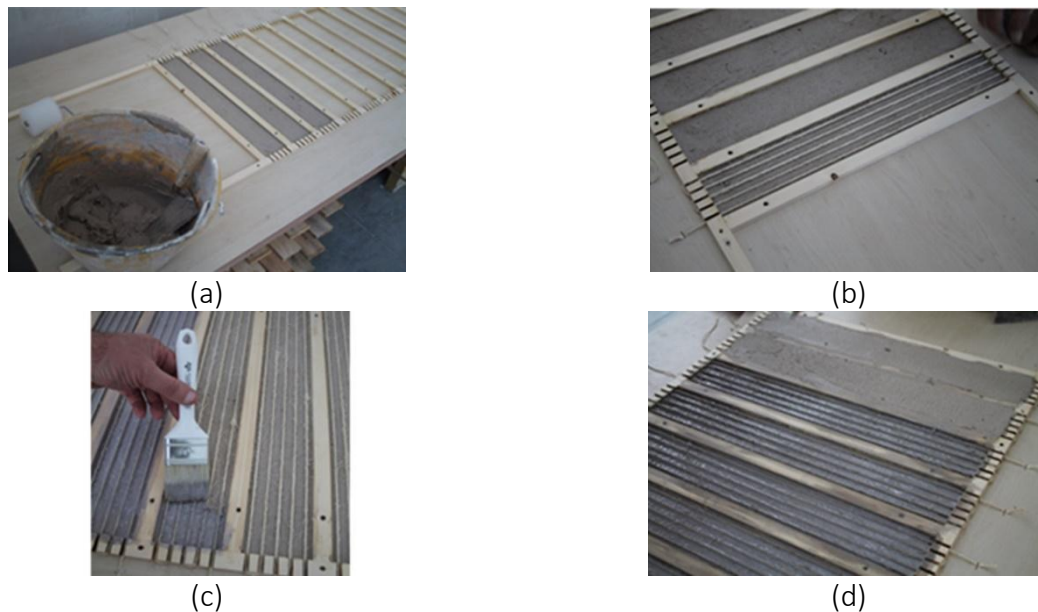


Fig. 5 Sisal-NFRCM samples manufacturing for tensile tests: application of the first layer of mortar (a), positioning of the sisal yarns (b), impregnation of the yarns with the adhesive promoter (c) and application of the second layer of mortar (d)

3.2 Test set-up and procedure

At the University IUAV of Venice laboratory, the tests were carried out with a universal Dartec machine, controlled by a Zwick-Roll system, using the software Testexpert II, under displacement control (Fig. 6b). Two digital transducers were positioned along the specimens, one on each side, with a base length, l_d of 250 mm, for monitoring the elongation during the load application.

An illustration of the test setup adopted in the University of Trieste laboratory is reported in Fig. 6c [28]: the apparatus consisted of a metallic portal connected to a stiff reinforced concrete pavement and an electromechanical actuator, fixed at the pavement and placed between the two portal posts. The actuator (Costamasnaga K150, 300 kN capacity, 300 mm stroke) was installed at the top of the metallic base and was controlled by an electrical engine. On the top of the actuator, two coupled steel plates were installed so to create the lower clamping head for the samples. A loading cell (AEP Transducers, Type TC4 AMP 50kN) was mounted on the portal beam and, below, the upper holding of the sample (coupled steel plates) was positioned. The interposition of knuckle joints permitted to overcome for possible parasitic bending forces that may arise in the samples. The test apparatus was dimensioned so to limit as close as possible the elastic deformation related to the metallic elements and connections (apparatus deformation < 0.005 mm for a tensile load of 1 kN). Two potentiometer transducers (base lengths $l_d = 250$ mm and 325 mm) were placed along the specimens for monitoring the sample elongation during the loading procedure.


In both laboratories, the clamping of the specimens at both ends was realized by friction, applying a compressive load of about 20 kN (compressive stress ≈ 3.6 MPa). The load rate was about 0.3 mm/min, in the un-cracked phase (in order to provide recording the first phase of the test) and 0.5 mm/min after the cracking phase and with an acquisition frequency equal to 5 Hz.



(a)



(b)

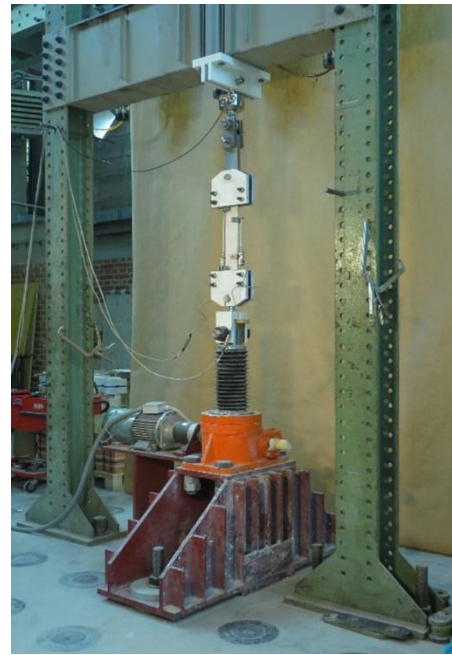


(c)


Fig. 6 Tensile tests on sisal-NFRCM samples: some specimens before testing (a) and test set-up at University IUAV of Venice (b) University of Trieste (c)

3.3 Results and discussions

The samples tested in Trieste (named TT1 up to TT6) and in Venice (named TT7 up to TT12) after the tensile tests are illustrated in Fig. 7. The stress-strain curves are reported in Fig. 8: it is observed that the curves obtained from each laboratory are, in general, coherent among them and that the Trieste and Venice results are comparable. Actually, sample TT8 attained to significant lower values in terms of both strength and strain, as a consequence of a premature damage.

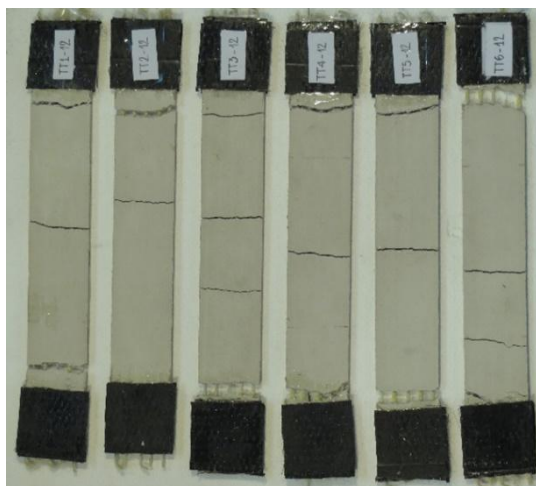

(a)

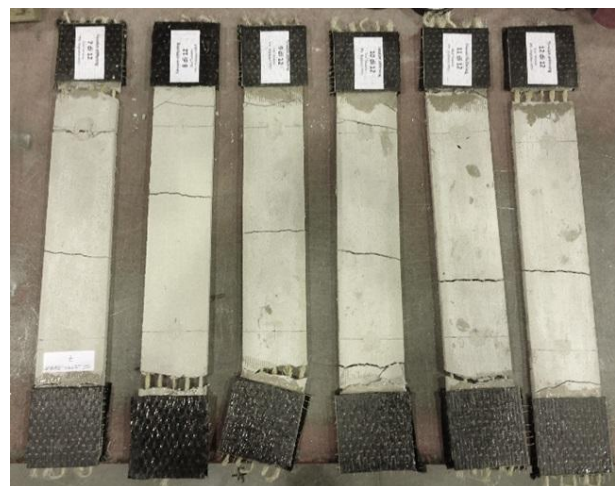

(b)

Fig. 7 Cracked samples after the tensile tests: samples TT1-TT6 tested in Trieste (a) and TT7-TT12 tested in Venice (b)

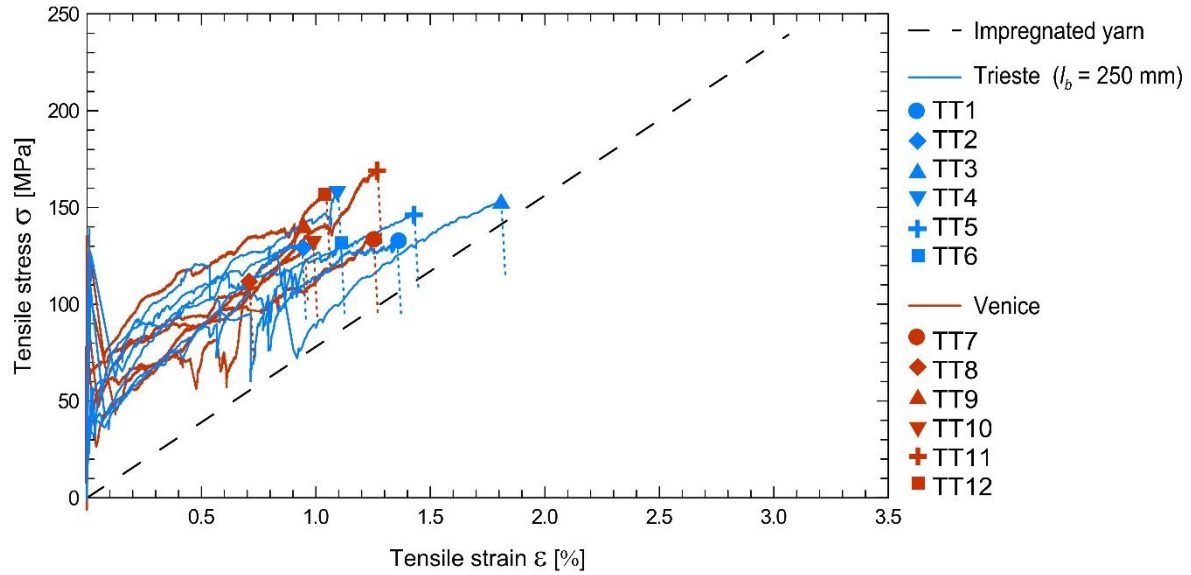


Fig. 8 Tensile behavior of Sisal-FRCM: stress-strain curves obtained by the Trieste laboratory (using transducers with a 250 mm base length) and of samples obtained by the Venice laboratory.

The main results are summarized in Tab. 1, reporting: the first cracking load (F_{cr}), the peak load (F_{max}), the tensile stress in correspondence of the maximum resistance (σ_{max}) related to the fibers cross section ($2.09 \text{ mm}^2 \times 5 \text{ yarns} = 10.45 \text{ mm}^2$), the transducers base lengths (l_{d1} , l_{d2}), the measured displacements in correspondence of F_{max} (D_{max1} , D_{max2}), the mean tensile strains values ($\epsilon_{max1} = D_{max1}/l_{d1}$, $\epsilon_{max2} = D_{max2}/l_{d2}$). Moreover, the collapse mode of samples is indicated, according to the classification adopted by De Santis et al. [9] (Fig. 9).

Tab. 1 Tensile tests results on sisal-NFRCM samples

Sample	F_{cr} [N]	F_{max} [N]	σ_{max} [MPa]	l_{d1} [mm]	l_{d2} [mm]	D_{max1} [mm]	D_{max2} [mm]	ϵ_{max1} [%]	ϵ_{max2} [%]	Collapse mode
TT1	595	1402	134.2	250	325	3.41	10.73	1.36	3.30	A-C
TT2	1134	1367	130.8	250	325	2.27	10.03	0.91	3.09	A-C
TT3	1434	1599	153.0	250	325	4.52	5.39	1.81	1.66	A-C
TT4	-*	1666	159.4	250	325	2.73	3.53	1.10	1.09	A-C
TT5	402	1527	146.1	250	325	3.56	7.29	1.42	2.24	A-C
TT6	385	1376	131.7	250	250	2.93	2.61	1.17	1.04	A-C
TT7	618	1401	134.1	250	250	2.83	3.44	1.13	1.38	A-C
TT8**	430	1169	111.9	250	250	1.94	1.60	0.78	0.64	A-C
TT9	1140	1465	140.2	250	250	2.11	2.68	0.84	1.07	A-C
TT10	830	1381	132.2	250	250	1.95	2.97	0.78	1.19	A-C
TT11	1012	1767	169.1	250	250	2.44	3.84	0.98	1.55	A-C
TT12	1415	1650	157.9	250	250	2.33	2.91	0.93	1.64	A-C

* presence of a crack before testing, due to damage during transportation

** premature sample collapse

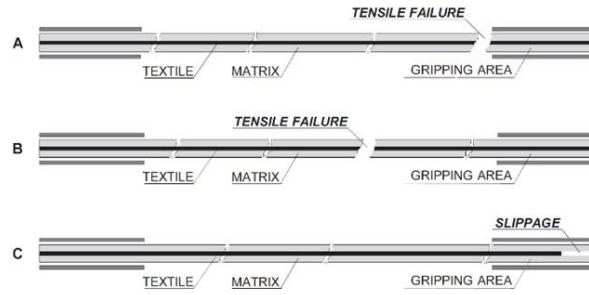


Fig. 9 Possible failure mode of FRCM samples subjected to tensile tests [9]

The typical FRCM behavior under tension generally presents a stress-strain curve with a trilinear behavior characterized by: a first phase that represents the uncracked stage or elastic branch, where the material stiffness depends on the mortar Young's modulus; a second phase, that corresponds to the formation of multiple transversal, parallel cracks in the mortar; a third, post-cracking phase, until the tensile fibers rupture; in this phase, the curve is almost parallel to the tensile curve of the yarns alone. The horizontal gap between the third branch and the yarns curve is due to the tension stiffening effect of the mortar between the cracks. The composite behavior depends on the constituent materials properties and interactions [29].

In Fig. 8 the typical trilinear behavior of the curves is evident. Actually, the specimens revealed a first elastic phase, in which the stiffness is very high and difficult to measure accurately. Then, the first cracking of the mortar occurred, with a sudden drop of load. The load associated the first cracking showed a great variability; in fact, considering the reduced thickness of the samples, small defects may anticipate the cracking. However, the load increased again and the curves attain rapidly to the third phase, in which the slope well accords to the stiffness of the yarns alone. The horizontal gap between the third phase and the yarns curve evidenced, in general, a not negligible tension stiffening effect. This indicates that the yarns are, to some extent, still adherent to the mortar between the cracks. However, at the increasing of the load, a gradual reduction of the tension stiffening effect was observed in some samples (in particular TT3), indicating the progressive increase in the detachment of the yarns from the matrix.

Excluding TT8, where a premature collapse occurred, the average maximum tensile stress obtained (related to the dry fibers cross section) is about $\sigma_{max} = 144.4$ MPa (CoV 9.3%). The average distance among cracks is about 135-140 mm, with a mean ultimate strain of about 1.19%.

A combined collapse mode was, in general, detected (A-C, with reference to Fig. 9): in fact, once the mortar cracked in the vicinity of the clamping heads, the yarns-mortar slip activated in the clamping area. This partial, progressive slippage, which reasonably was not identical in the yarns, induced an uneven stress distribution among them and the tensile failure only of some yarns was achieved.

The occurrence of the slippage is evident in the stress-strain curves plotted Fig. 10, which refer to the strains evaluated from the transducers with higher base length ($l_d = 325$ mm), in samples TT1 to TT5: the stiffness of the third branch, initially parallel to that of the yarns alone, rapidly decreases at the increase of the strain (exception only for sample TT4, as the slippage occurred out of the measurement base). A similar slippage phenomena already emerged in some tensile tests performed by Gattesco and Boem [28].

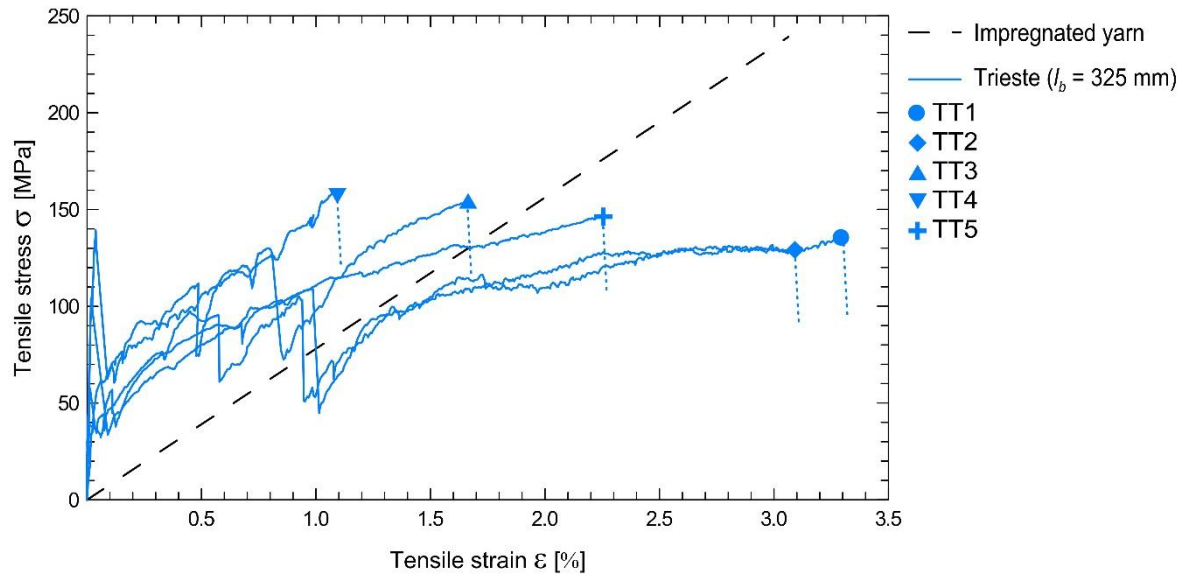


Fig. 10 Tensile behavior of Sisal-FRCM: stress-strain curves obtained by the Trieste laboratory (using transducers with a 325 mm base length).

Nevertheless, the curves in Fig. 8 result meaningful to describe the actual behavior of the composite: reasonably, in the absence of the yarns slippage from the mortar in correspondence of the clamping heads, the stress-strain curves would have shown the same trend. The third branch would have continued until reaching, at most, 239.7 MPa in case of perfectly uniform stress distribution among the yarns. However, this hypothesis is unrealistic: as emerged in bond tests (section 4), the reinforcement is able to attain to a lower stress value, associated to the progressive failure of the yarns (169.5 MPa).

The results presented show for the FRCM composite system with sisal yarns a moderate tensile strength and a ductile behavior, according to the tensile tests results on NFRCM made with sisal and flax textiles obtained by Olivito et al. [21].

However, the detected collapse mode leads to conclude that the clamping method adopted for high performance, “classic” FRCM, is not properly adequate for lower performance composites such NFRCMs. Actually, to avoid the slippage, it is not possible to increase significantly the compression of the clamping heads, as the crushing of the mortar will occur. Possible effective strategies can be, instead, the clamping of the yarns without the mortar matrix, by employing e.g. dry metallic tabs or the casting of holding heads made of high performances, cement-based or resin matrices.

4. Sisal-NFRCM single lap shear tests

The bond behavior of Sisal-FRCM was evaluated through-single lap shear test.

4.1 Specimens

The specimens for the single lap shear tests (Fig. 11) consisted in a sisal-NFRCM layer applied on a masonry substrate. Five solid bricks (55x120x250 mm³) and 4 mortar joints (with 10mm thickness) form the masonry wallets (120x250x315mm³). The bricks have a normalized compressive strength of 15.7 MPa [30]. The mechanical properties of the masonry mortar were determined through flexural and compressive strength on 40x40x160 mm³ prism samples and provide an average flexural tensile strength of 2.1 MPa and an average compressive strength of 5.4 MPa.

The Sisal-FRCM is applied on one wallet face, at a distance of 30 mm from the wallet upper face and 20 mm from both sides, following RILEM indications [31]. The un-bonded yarns length is 400 mm.

The geometry and arrangement of the yarns are the same of tensile tests samples (section 3): five impregnated yarns embedded in a NHL matrix and placed in the center of the mortar thickness (Fig. 12).

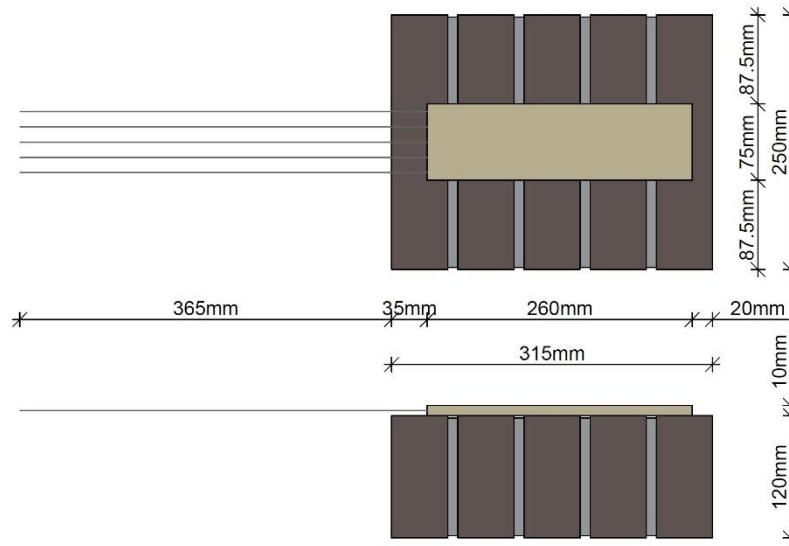


Fig. 11 Single-lap shear tests: specimen geometry

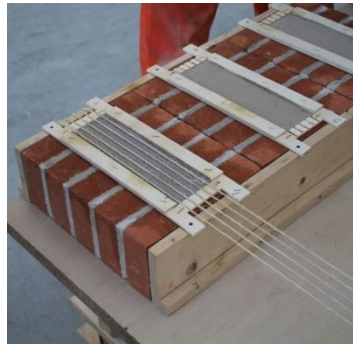


Fig. 12 Single-lap shear tests: specimen construction

4.2 Test set-up and procedure

In the University IUAV of Venice laboratory, the tests were carried out with the same testing machine described for tensile tests, under displacement control (Fig. 13 a). A metallic device, shaped as a seat, was used to support the masonry wallet. The device was set so to maintain the yarns in the vertical direction and ensure the vertical alignment of the load along the specimens, taking care to avoid parasitic forces, perpendicular to the masonry surface, which could anticipate the sample failure. Two digital transducers were positioned along the specimens to measure the relative displacement between the masonry substrate and the yarns (Fig. 13 b).

The test apparatus of the University of Trieste laboratory (Fig. 13 c and d) was for the most the same of that employed for the tensile tests, but replacing the upper clamps with the same metallic device already described for the setup of the University IUAV of Venice. Two potentiometer transducers measured the displacement between the yarns and the masonry wallet. Two adjunctive potentiometer transducers monitored the displacement between the mortar layer and the masonry. However, these potentiometers revealed negligible displacements (< 0.1 mm).

In both laboratories, the yarns extremities were clamped through two metallic plates, coupled with bolts, to avoid the yarns slippage. At the beginning of the tests, the length of unbounded yarns included in the measurement base was $l_d = 200$ mm. A load rate of about 0.6 mm/min (acquisition frequency 5 Hz) was considered.




(a)



(b)



(c)

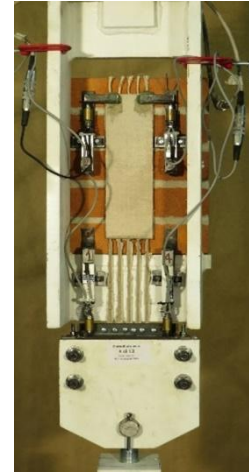


(d)

Fig. 13 Single-lap shear test: University IUAV of Venice test set-up (a) and transducers (b); University of Trieste test set-up (c) and transducers (d)


4.3 Results and discussions

Fig. 14 show the samples after the tests; the samples tested at the University of Trieste were named ST1 up to ST6 and University IUAV of Venice ones are ST7 up to ST12. Actually, samples ST7 and ST8 were not considered, due to a premature damage emerged during testing, due to a sample defect in the construction.

The stress-strain curves obtained from the single lap shear test are plotted in Fig. 15 (the stresses are related to the global fibers cross section, 10.45 mm^2 , the strains are referred to a base length $l_d = 200 \text{ mm}$). The results of each laboratory are coherent and the Trieste and Venice curves are quite comparable.

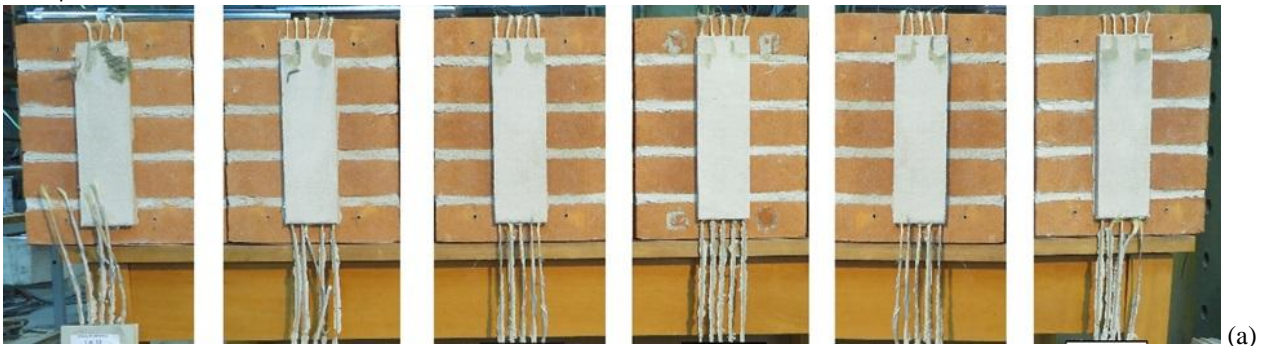

(a)

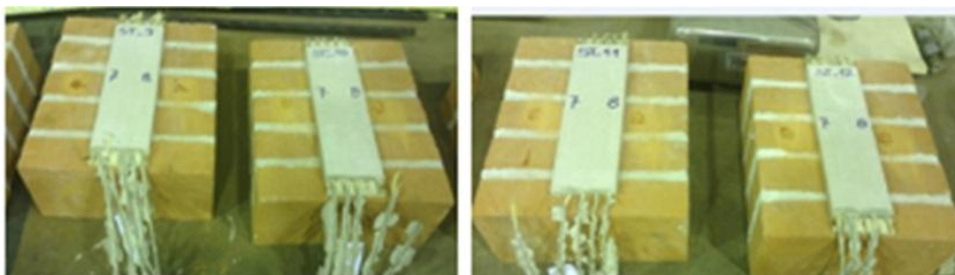

(b)

Fig. 14 Sisal-FRCM samples after the shear bond tests performed in Trieste ST1-ST6 (a) and in Venice ST9-ST12 (b)

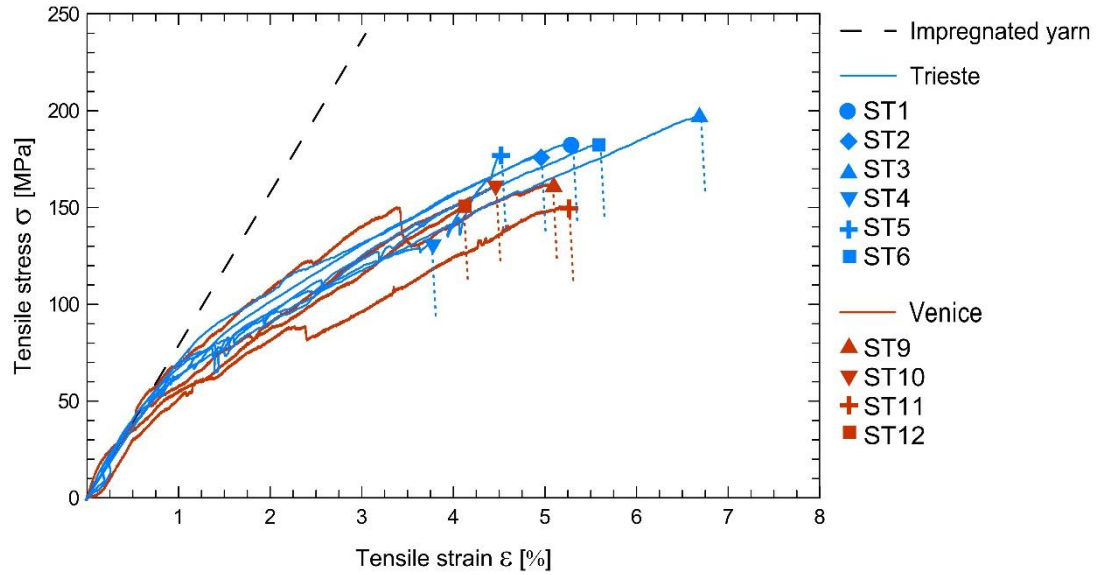


Fig. 15 Single-lap shear tests of Sisal-FRCM: stress-strain curves obtained by the Trieste and Venice laboratories.

The main results are summarized in the table Tab. 2, that reports: the peak load (F_{max}), the average displacement measured by the transducers in correspondence of the peak load (D_{max}), the average strain at peak load (ϵ_{max}) obtained by dividing D_{max} for l_d , the peak load per unit of width (F_{max}/w), where $w = 75\text{mm}$; the peak stress in the yarns ($\sigma_{max} = F_{max}/A_f$), where A_f is the fibers cross section ($2.09\text{mm}^2 \times 5 = 10.45 \text{ mm}^2$) and the failure mode, in accordance with RILEM protocol (Fig. 16).

Tab. 2 Single-lap shear tests results

Sample	F_{max} [N]	D_{max} [mm]	ϵ_{max} [%]	F_{max}/w [N/mm]	σ_{max} [N/mm ²]	Failure mode
ST1	1912	10.50	5.25	25.84	183.0	E2
ST2	1850	9.84	4.92	25.00	177.0	E2
ST3	2062	13.38	6.69	27.86	197.3	E2
ST4	1391	6.74	3.37	18.80	133.1	E2
ST5	1858	9.01	4.50	25.11	177.8	E2
ST6	1911	11.22	5.61	25.82	182.9	E2
ST9	1693	9.86	4.93	22.87	162.0	E1
ST10	1751	14.10	7.05	23.67	167.6	E2
ST11	1573	10.32	5.16	21.26	150.5	E2
ST12	1715	13.42	6.71	23.17	164.1	E2

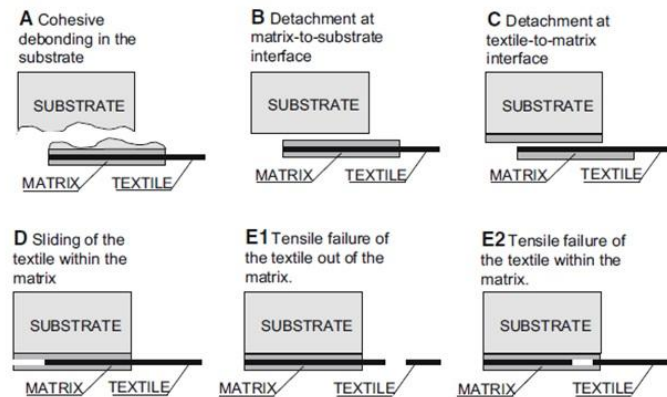


Fig. 16 FRCM failure modes for single-lap shear tests [31]

It is evidenced that the monitored displacements may be due, in general, both to the elongation of the yarns and to the relative yarns-mortar slippage. Actually, at the beginning of the test, there was the perfect adhesion between the yarns and the mortar, thus the displacement was initially determined only by the strain of the unbounded yarns portion ($l_d = 200$ mm), as evidenced in Fig. 15. The progressive deviation of the ST curves from that of the yarns, which started at about 60 MPa, revealed the progressive slip and partial detachment of the yarns from the mortar matrix, due to the failure of the chemical adhesion. However, no evident yarns slippage emerged in correspondence of the upper edge of the mortar layer.

In general, the samples demonstrated a similar behavior, with the fibers rupture within the bond area, corresponding with the failure mode E2 (Fig. 16). Exception for the sample ST9, whose behavior corresponds to the failure mode E1 (fibers rupture out of the matrix). A bond length of 260 mm resulted thus adequate for Sisal-NFRCM to attain to the yarns rupture, avoiding premature failures for debonding or sliding. The average maximum tensile stress obtained (related to the dry fibers cross section) is about $\sigma_{max} = 169.5$ MPa (CoV 11%). These value resulted about 29% lower than that obtained from tensile tests on a single impregnated yarn (239.7 MPa) and is attributable to an uneven distribution of the stresses among the yarns.

No slips or detachments were observed at the masonry-mortar interface (failure modes A or B in Fig. 16), thus it was not possible to quantify the masonry-mortar bond strength. However, for the considered sisal-NFRCM, it is reasonable to consider unrealistic these kinds of failure, even for lower bond lengths, due to the reduced tensile load and the activation of the yarns slippage from the mortar matrix.

5. Conclusions

A first approach to the mechanical characterization of a NFRCM (FRCM made with natural fibers) was performed. In particular, the investigated reinforcement consisted in sisal fibers yarns impregnated with a water-based resin and embedded in a inorganic matrix based on natural lime.

Firstly, the mechanical characterization of the NFRCM constituents (sisal yarns and mortar matrix) was performed. The results provided an average tensile strength of 209.1 MPa for dry fibers yarns and 239.7 MPa for yarns impregnated with the water-based resin, evidencing that the impregnation allows a more uniform distribution of the stresses between the fibers. Impregnated yarns evidenced a linear elastic (axial stiffness of about 16 kN), with a brittle failure mode.

Afterwards, tensile tests (TT) and single-lap shear tests (ST) on sisal-NFRCM samples were carried out, to investigate on the composite material tensile and bond behaviour, following the RILEM group recommendations for "classic" FRCMs (based on inorganic or synthetic fibers, embedded in high performances, cementitious matrices). The experimental tests were performed in two laboratories, as required by the RRT protocol: in the laboratory of the University IUAV of Venice and in the laboratory of the University of Trieste. In general, the results of the two laboratories resulted in good agreement, proving the repeatability of the tests.

In TT, the stress-strain curves revealed a first, un-cracked phase, with high stiffness, followed by a sudden drop of resistance as the mortar cracked; then, the stress increased again and the slope of the curves was similar to the stiffness of the sisal yarns alone. A not negligible tension stiffening effect emerged, which however tended gradually to reduce at the increasing of the strain. The average distance among cracks resulted about 135-140 mm.

Actually, an anticipated failure of the samples emerged, due to the progressive yarns-mortar slip in the gripping area, once the mortar cracked in the vicinity of the clamping heads. This induced an uneven stress distribution in the fibers and the tensile failure only of some yarns occurred. This occurrence evidenced that the clamping of the yarns without the mortar matrix should be

preferred for NFRCMs, where the bond between the reinforcement and the matrix is significantly weaker than in classical FRCMs.

However, TT resulted meaningful for the sisal-NFRCM characterization: the maximum tensile stress reached (about 144.4 MPa, in correspondence of a mean ultimate strain of 1.19%) resulted only a little lower than that emerged from ST, where premature failures did not occur.

In fact, in ST, a progressive, partial detachment of the yarns from the mortar matrix emerged, however the tensile failure of the yarns was always attained and no slip was observed at the masonry-mortar interface: the bond length of 260 mm resulted thus adequate for Sisal-NFRCM to avoid anticipated failures by debonding or sliding.

The maximum tensile strength obtained from ST (169.5 MPa) resulted appreciably lower than that measured on impregnated yarns alone (239.7 MPa), evidencing an uneven load distribution among the yarns, due to a non-uniform loss of the yarns-mortar chemical adhesion.

Actually, further experiments, considering shorter bond lengths could be fulfilled to assess the limit bond length which permits to reach the yarns tensile failure; however, reasonably, the detachment of the mortar from the masonry substrate is not expected, as the yarns slippage occurs.

These first results obtained through the tensile and shear tests on some sisal-FRCM samples represents an initial and an important step on the investigation of the NFRCM mechanical behavior and to set the mechanical tests for the material characterization and design. Furthermore, the results achieved are useful for theoretical and numerical simulations.

Acknowledgments

The authors acknowledge Fibre Net SpA (Pavia di Udine, Italy), the Construction science laboratory of the University IUAV of Venice (Labsco) and the Laboratory of Testing Materials of the University of Trieste for the support given at these experimental tests. This work was partly financed by the research project PRIN 2015 (under grant 2015JW9NJT_014, project “Advanced mechanical modeling of new materials and structures for the solution of 2020 Horizon challenges”) and FEDER funds through the Competitively Factors Operational Programme - COMPETE and by national funds through FCT – Foundation for Science and Technology within the scope of projects POCI-01-0145-FEDE-007633.

References

- [1] AC434. Acceptance Criteria for Masonry and Concrete Strengthening Using Fabric Reinforced Cementitious Matrix (FRCM) Composite Systems. International Code Council standard, 2016.
- [2] ACI 549.4R-13. Guide to Design and Construction of Externally Bonded Fabric-Reinforced Cementitious Matrix (FRCM) Systems for Repair and Strengthening Concrete and Masonry Structures. American Concrete Institute. Farmington Hills, MI, USA, 2013.
- [3] S. De Santis, F.G. Carozzi, G. de Felice, C. Poggi, Test Methods for Textile Reinforced Mortar Systems, Composites Part B: Engineering. 127 (2017) 121-132.
- [4] L. Ascione, G. De Felice, S. De Santis, A Qualification Method for Externally Bonded Fibre Reinforced Cementitious Matrix (FRCM) Strengthening Systems, Composites Part B: Engineering 78 (2015) 497-506.
- [5] G.P. Lignola, C. Caggegi, F. Ceroni, S. De Santis, P. Krajewski, P.B. Lourenço, M. Morganti, et al., Performance Assessment of Basalt FRCM for Retrofit Applications on Masonry, Composites Part B: Engineering 128 (2017) 1-18.

- [6] F.G. Carozzi, A. Bellini, T. D'Antino, G. de Felice, F. Focacci, Ł. Hojdys, L. Laghi, et al., Experimental Investigation of Tensile and Bond Properties of Carbon-FRCM Composites for Strengthening Masonry Elements, *Composites Part B: Engineering* 128 (2017) 100-119.
- [7] M. Leone, M.A. Aiello, A. Balsamo, F.G. Carozzi, F. Ceroni, M. Corradi, M. Gams, et al., Glass Fabric Reinforced Cementitious Matrix: Tensile Properties and Bond Performance on Masonry Substrate, *Composites Part B: Engineering* 127 (2017) 196-214.
- [8] C. Caggegi, F.G. Carozzi, S. De Santis, F. Fabbrocino, F. Focacci, Ł. Hojdys, E. Lanoye, L. Zuccarino, Experimental Analysis on Tensile and Bond Properties of PBO and Aramid Fabric Reinforced Cementitious Matrix for Strengthening Masonry Structures, *Composites Part B: Engineering* 127 (2017) 175-195.
- [9] S. De Santis, F. Ceroni, G. de Felice, M. Fagone, B. Ghiassi, A. Kwiecień, G.P. Lignola, M. Morganti, M. Santandrea, M.R. Valluzzi, A. Viskovic, Round Robin Test on tensile and bond behaviour of Steel Reinforced Grout systems, *Composites Part B: Engineering* 127 (2017) 100-120.
- [10] S.F. Santos, G.H.D. Tonoli, J.E.B. Mejia, J. Fiorelli, H. Savastano Jr., Non-Conventional Cement-Based Composites Reinforced with Vegetable Fibers: A Review of Strategies to Improve Durability, *Materiales De Construccion*, 65 (2015) 317:e041.
- [11] T. Gurunathan, S. Mohanty, S.K.A. Nayak, Review of the Recent Developments in Biocomposites Based on Natural Fibres and their Application Perspectives, *Composites Part A: Applied Science and Manufacturing* 77 (2015) 1-25.
- [12] M.E.A. Fidelis, F. De Andrade Silva, R.D.T. Filho, The Influence of Fiber Treatment on the Mechanical Behavior of Jute Textile Reinforced Concrete, *Key Engineering Materials* 600 (2014) 469-474.
- [13] G. Cicala, G. Cristaldi, G. Recca, A. Latteri. Composites Based on Natural Fiber Fabrics in: Polona Dobnik Dubrovski ed., *Woven Fabric Engineering*, InTech, 2010.
- [14] A. Ticoalu, T. Aravinthan, F. Cardona, A Review of Current Development in Natural Fiber Composites for Structural and Infrastructure Applications, *Southern Region Engineering Conference*, 10-12 November, 2010, Toowoomba, Australia.
- [15] K. Begum, M.A. Islam, Natural Fiber as a substitute to Synthetic Fiber in Polymer Composites: A Review, *Research Journal of Engineering Sciences* 2 (2013) 3:46-53.
- [16] L.C. Roma Jr, L.S. Martello, H. Savastano Jr, Evaluation of Mechanical, Physical and Thermal Performance of Cement-Based Tiles Reinforced with Vegetable Fibers, *Construction and Building Materials* 22 (2008) 4:668-674.
- [17] M. Ardanuy, J. Claramunt, J.A. García-Hortal, M. Barra, Fiber-Matrix Interactions in Cement Mortar Composites Reinforced with Cellulosic Fibers, *Cellulose* 28 (2011) 2:281-289.
- [18] R.D. Toledo Filho, K. Scrivener, G.L. England, K. Ghavami, Durability of Alkali-Sensitive Sisal and Coconut Fibres in Cement Mortar Composites, *Cement and Concrete Composites* 22 (2000) 2:127-143.
- [19] P.R.L. Lima, R.D. Toledo Filho, Use of metakaolin to improve the durability of sisal fiber-cement based composites, *Ambiente Construído* 8 (2008) 4:7-19.
- [20] L. Ferrara, A.R. Ferreira, V. Krelani, F. Silva, R.D. Toledo Filho, Effect of natural fibres on the self healing capacity of high performance fibre reinforced cementitious composites, in: *Proceedings*

of shcc rilem 3rdInternational RILEM Conference on Strain Hardening Cementitious Composites, 2014, Dordrecht, the Netherlands.

- [21] R.S. Olivito, O.A. Cevallos, A. Carrozzini, Development of Durable Cementitious Composites using Sisal and Flax Fabrics for Reinforcement of Masonry Structures, *Materials and Design* 57 (2014) 258-268.
- [22] C.B. De Carvalho Bello, A. Cecchi, Experiments on natural fibers: durability and mechanical properties, *Advances in Materials & Processing Technologies journal* 3 (2017) 4:632-639.
- [23] EN ISO 1889:2009, Reinforcement yarns - Determination of linear density, 2009, CEN, Brussels (BE).
- [24] K.L. Pickering, M.G. Aruan Efendy, T.M. Le. Review of recent developments in natural fibre composites and their mechanical performance, *Composites Part A: Applied Science and Manufacturing* 83 (2016) 98-112.
- [25] CNR-DT 200 R1/2013, Guide for the design and construction of externally bonded FRP systems for strengthening existing - Materials, RC and PC structures, masonry structures, CNR - Advisory Committee on Technical Recommendations for Construction, 2013.
- [26] EN 1998-1:2004, Eurocode 8: Design of structures for earthquake resistance - Part 1: General rules, seismic actions and rules for buildings, 2004, CEN, Brussels (BE).
- [27] EN1996-1-1:2005, Eurocode 6: Design of masonry structures - Part 1-1: General rules for reinforced and unreinforced masonry structures. 2005, CEN, Brussels (BE).
- [28] N. Gattesco, I. Boem, Characterization Tests of GFRM Coating as a Strengthening Technique for Masonry Buildings, *Composite Structures* 165 (2017) 209-222.
- [29] G. Tumilan, A. De Luca, The Second Generation of Externally-Bonded Composite Systems for Strengthening of Concrete and Masonry Structures, *Structure Magazine* Setp.29 (2014) 22-24.
- [30] EN772-1:2011+A1:2015, Methods of test for masonry units. Part 1: Determination of compressive strength, 2015, CEN, Brussels (BE).
- [31] G. De Felice, M.A. Aiello, C. Caggegi et al., Recommendation of RILEM Technical Committee 250-CSM: Test method for Textile Reinforced Mortar to substrate bond characterization, *Mater Struct* 51 (2018) 95.

- Characterization of innovative FRCM with natural fibers is performed
- Sisal-NFRCM performances are investigated through tensile and shear tests
- Dispositions of the Round Robin Tests RILEM Technical Committee 250-CSM are adopted
- Tensile tests evidenced an appreciable tension stiffening effect
- Single-lap shear tests evidenced the failure of the yarns with progressive slippage