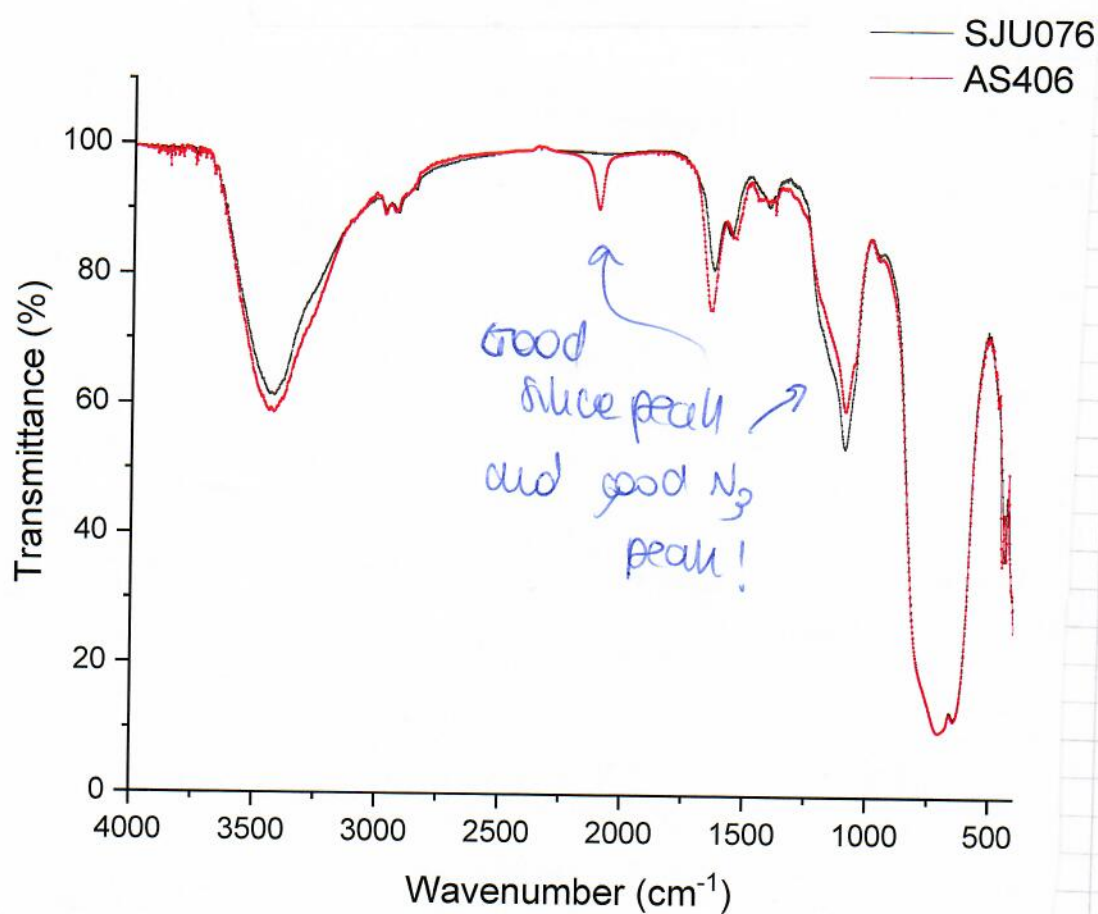


Continued from page:

DTA results:PBS: $150.5 \pm 3.4 \text{ nm}$ (PDI: 0.09)DMA: $150.0 \pm 5.5 \text{ nm}$ (PDI: 0.09)pH 7: $-33.9 \pm 8.0 \text{ mV}$ pH 3: $-8.3 \pm 0.7 \text{ mV}$ FTIR results:

Continued to page:

DATE

SIGNATURE

DATE

DISCLOSED TO AND UNDERSTOOD BY