


M_13C1D
M_13C1D CDC13 /opt/data/mate/nmr mate 92



Current Data Parameters
NAME 171124-MTRM01
EXPNO 12
PROCNO 1

F2 - Acquisition Parameters
Date_ 20171125
Time 18.35 h
INSTRUM spect
PROBHD Z140404_0001 (
PULPROG zgrrse
TD 102400
SOLVENT CDC13
NS 2048
DS 4
SWH 50000.000 Hz
FIDRES 0.976562 Hz
AQ 1.0240000 sec
RG 121.54
DW 10.000 usec
DE 18.60 usec
TE 298.0 K
D1 0.10000000 sec
D11 0.03000000 sec
D16 0.00020000 sec
TD0 256
SFO1 201.1898320 MHz
NUC1 13C
CNST1 0.3000000
P1 13.40 usec
P13 2000.00 usec
P26 500.00 usec
P50 4.02 usec
PLW1 24.00000000 W
SPNAM[5] Crp80comp.4
SPOAL5 0.500
SPOFFS5 0 Hz
SPW5 8.77910042 W
SPNAM[8] Crp80,0.5,20.1
SPOAL8 0.500
SPOFFS8 0 Hz
SPW8 8.77910042 W
SFO2 800.0339992 MHz
NUC2 1H
CPDPRG[2] waltz65
PCPD2 60.00 usec
PLW2 13.00000000 W
PLW12 0.37570000 W
PLW13 0.18897000 W
GPNAM[1] SMSQ10.100
GPZ1 6.00 %
GPNAM[2] SMSQ10.100
GPZ2 10.00 %
P16 1000.00 usec
P19 600.00 usec

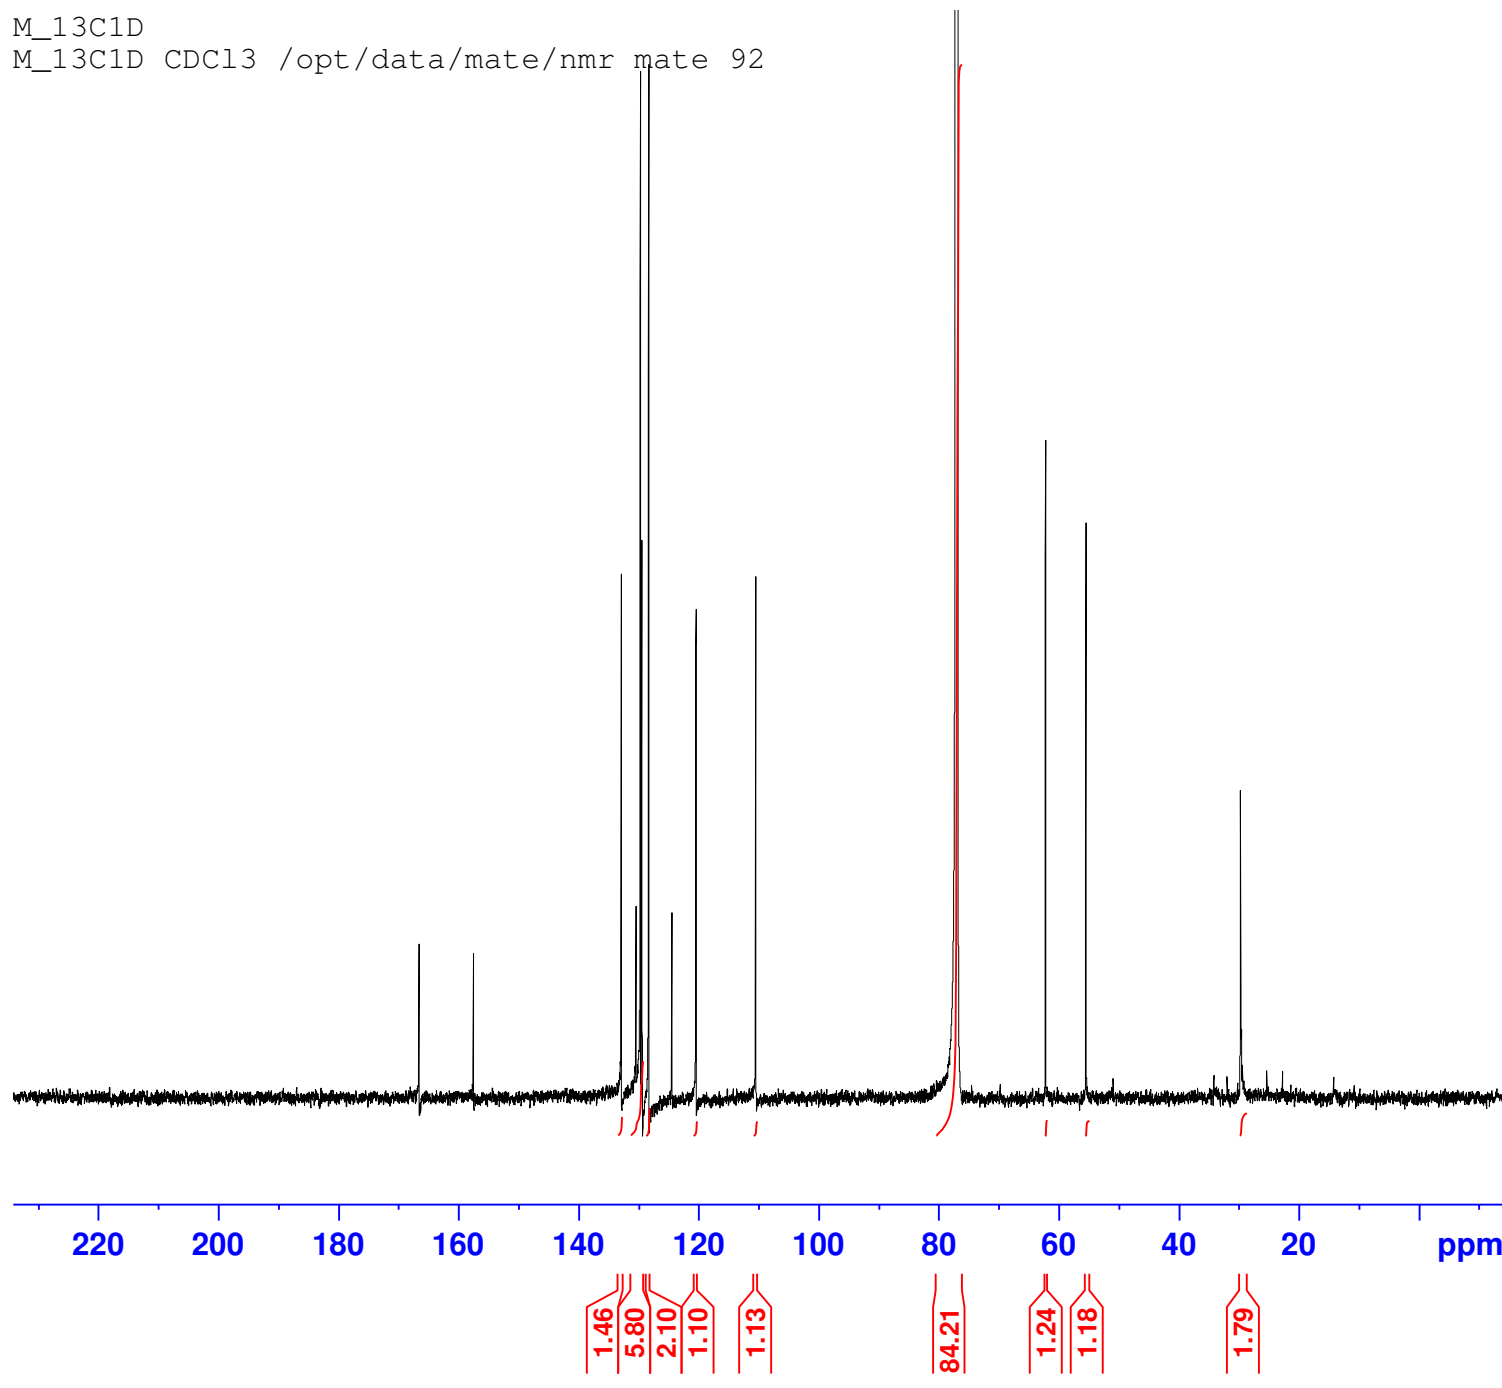

F2 - Processing parameters
SI 262144
SF 201.1677035 MHz
WDW EM
SSB 0
LB 5.00 Hz
GB 0
PC 1.00